

Table 1: February 2026 and March 2026 Sites 2/12 GWTP and SVTU Statistics

Monthly Statistics	Volume Treated	Temporal Average Flow	Percent of Time Online	COC Mass Removed (pounds)
February 2026 GWTP	1,221,600	30 gpm	76 %	0.04
March 2026 GWTP	1,389,600	31 gpm	78 %	0.10
Total since April 1999	2.4 billion gal			501.0
December 2025 SVTU	0	0 scfm	0 %	0
January 2026 SVTU	0	0 scfm	0 %	0
Total since September 2015	1.68 billion scf			11.7

Notes:
gpm: gallon(s) per minute
gal: gallon(s)
COC: chemical of concern
NC: Not calculated
scf: standard cubic foot or feet
scfm: standard cubic feet per minute

February 2026 and March 2026 Sites 2/12 Treated Water at TS-212-INJ did not exceed discharge limits

Remedial Summary

- **8 COCs:** 1,1-DCE; 1,2-DCA; chloroform; cis-1,2-DCE; PCE; total 1,3-DCP; TCE; and VC.
- **Remediation:** Pump and treat with GAC in the unconfined Upper 180-Foot Aquifer since 1999. Extraction wells added in 2007 and 2015.
- **Monitoring:** Quarterly groundwater monitoring and reporting, including annual 3Q monitoring and reports. Described in the most recent Groundwater QAPP.

Recent Key Events

- Jan 14: EW-12-05-180M offline due to pump motor failure
- Feb 2-13: First Quarter SGMP sampling event
- Feb 9-13: First Quarter GWMP sampling event

Future Key Events

- May 4-15: Second Quarter SGMP sampling event
- May 11-15: Second Quarter GWMP sampling event
- TBD pump replacement at EW-12-05-180M

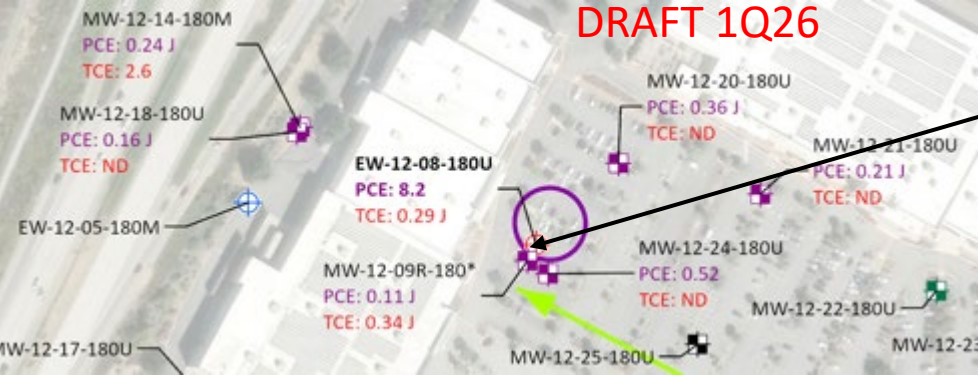


Table 2. Sites 2/12 Groundwater Extraction/Monitoring Well PCE Data


Well Identification ¹	PCE Concentrations (µg/L) ²														
	3Q2022	4Q2022	1Q2023	2Q2023	3Q2023	4Q2023	1Q2024	2Q2024	3Q2024	4Q2024	1Q2025	2Q2025	3Q2025	4Q2025	1Q2026*
ACL:	5.0														
EW-12-03-180M	0.39 J	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	NS	NS	NS	ND (0.25)	NS	NS	NS	ND (0.25)	NS	NS
EW-12-05-180M	0.56 0.50 0.52	ND (0.25)	0.46 J 0.47 J	0.44 J 0.49 J 0.50 0.47 J	0.52 0.51 0.54 0.56	0.5 0.37 J 0.53	NS	NS	NS	NS	NS	ND (0.25)	ND (0.25)	0.80	NS
EW-12-07-180M	ND (0.25)	ND (0.25)	ND (0.25)	0.13 J	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	NS	NS	NS	NS	ND‡ ND‡ ND‡ ND
EW-12-08-180U	4.5 5.4 6.9 7.1 6.9 6.1 J+	5.1 5.2 4.7 5.8 6.4 11	9.6 10.8 3.3 3.1 3.6 7.7 7.4	9.1 8.7 4.7 4.2 J- 5.9 10.7	9.0 11.2 13.6 5.1 14.0 6.2 15.7 8.1	8.3 8.3 6.4 7.8	9.4 ND (0.25) 3.8 3.9	3.2 10.1 8.6 10.6 11.1	11.8 14.5 11.9 5.9 ³ 16.1 10.4 J+ ⁴ 2.5 ⁵ 1.0 ⁶ 1.1 ⁷ ND (0.25)	7.5 ⁵ 16.1 10.4 J+ ⁴ 2.5 ⁵ 1.0 ⁶ 1.1 ⁷	ND (0.25) ⁵ ND (0.25) ⁹ 3.4 2.5 ⁵ 0.48 J ⁷	3.2 ⁵ 7.8 3.2 ⁵ ND (0.25) 3.1 ⁵ 7.8	3.8 ⁵ 8.1 ND (0.25) ⁴ ND (0.25) 5.4 ⁵ 7.7 5.3 ⁵ 13.7	ND (0.25) ⁶ 6.1 3.6 ⁶ 8.7 2.9 ⁵	ND (0.25) ND (0.25) ⁶ 5.4 3.0 ⁶ 8.2
MW-12-09R-180	0.65	0.16 J	0.12 J	0.14 J	0.12 J	0.17 J	ND (0.25)	0.14 J	0.15 J	ND (0.25)	ND (0.25)	ND (0.25)	0.13 J	0.16 J	0.11 J
MW-12-14-180M	0.27 J	0.20 J	0.20 J	0.22 J	0.23 J	0.19 J	ND (0.25)	0.54	0.37 J	ND (0.25)	0.70	0.56	0.11 J	0.18 J	0.24 J
MW-12-16-180M	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)
MW-12-20-180U	1.0	0.73	0.68	6.2 2.8	68.9 97.9	15.5‡ 19.1‡ 19.1‡ 8.7	ND (0.25)	2.0	39.8	4.8 ND (0.25)	0.55	0.72	0.8	0.49 J	0.36 J
MW-12-21-180U	0.24 J	0.30 J	0.11 J	0.17 J	0.22 J	0.24 J	ND (0.25)	0.22 J	0.27 J	ND (0.25)	ND (0.25)	ND (0.25)	0.25 J	0.27 J	0.21 J
MW-12-24-180U	0.56	0.39 J	0.43 J	0.47 J	5.7	3.6	ND (0.25)	1.5	32.1	ND (0.25)	2.4	1.9	3.4	0.33 J	0.52
MW-12-28-180U	0.33 J	NS	NS	NS	0.34 J	NS	NS	NS	0.39 J	NS	NS	NS	0.37 J	NS	NS
MW-12-30-180U	0.39 J	0.33 J	0.24 J	0.18 J	0.27 J	NS	NS	NS	0.36 J	NS	NS	NS	0.31 J	NS	NS
MW-12-32-180U	0.37 J	0.34 J	0.28 J	0.18 J	0.33 J	NS	NS	NS	0.49 J	NS	NS	NS	ND (0.25)	NS	NS



Notes:
¹ Extraction wells not listed have met the QAPP decision rules to no longer operate.
² Concentration in **bold** and shaded exceeds the Aquifer Cleanup Level (ACL). Concentrations in gray text are ND.
³ Sample was collected following one week online
⁴ Sample was collected following two weeks online
⁵ Sample was collected following three weeks online
⁶ Sample was collected following four weeks online
⁷ Sample was collected following two weeks offline
⁸ Sample was collected following eight weeks offline
⁹ Sample was collected following six weeks online
J: Estimated results below the limit of quantitation (LOQ)
ND: The analyte was not detected at or above the limit of detection (LOD)
NS: No sample (annual well)
COC: chemical of concern
µg/L: micrograms per liter
* Preliminary results
‡ Profile of Stations 1-3





EW-12-08-180U
(pulse pumping)

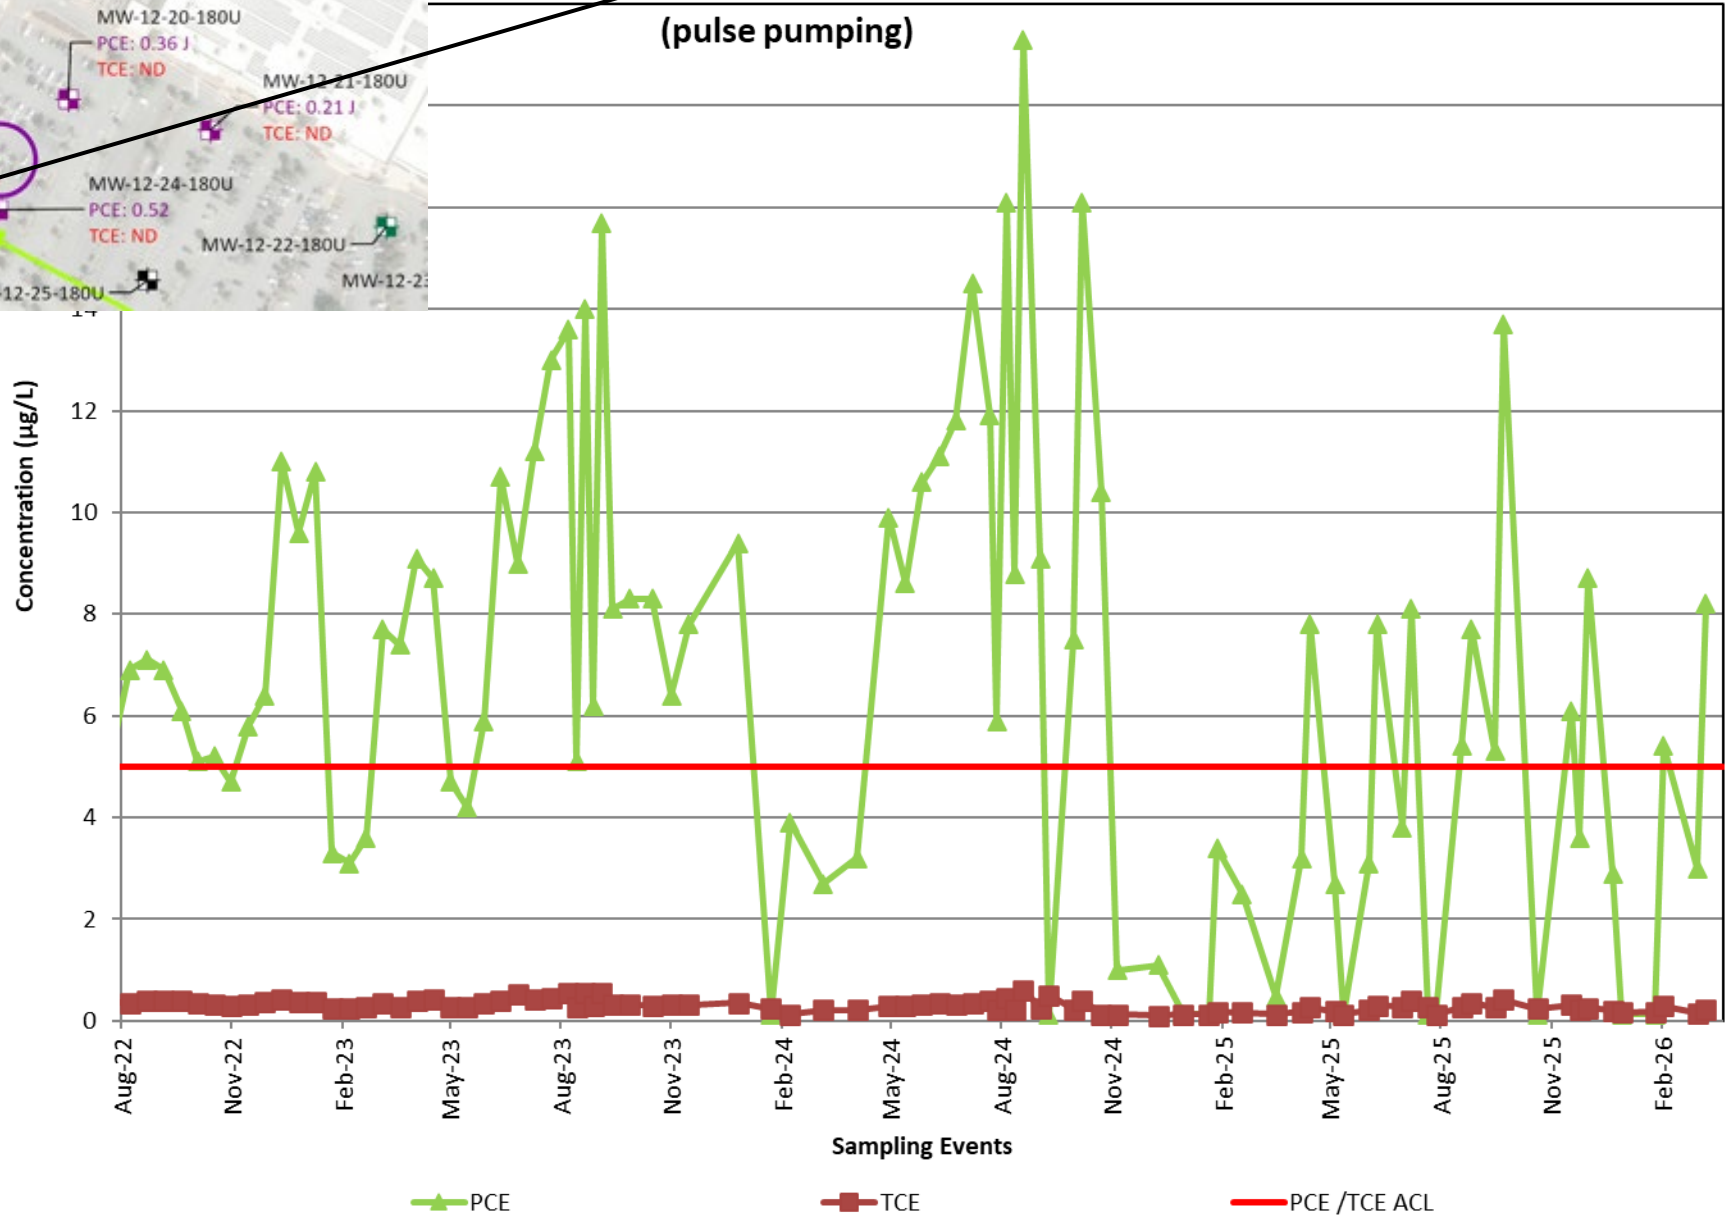

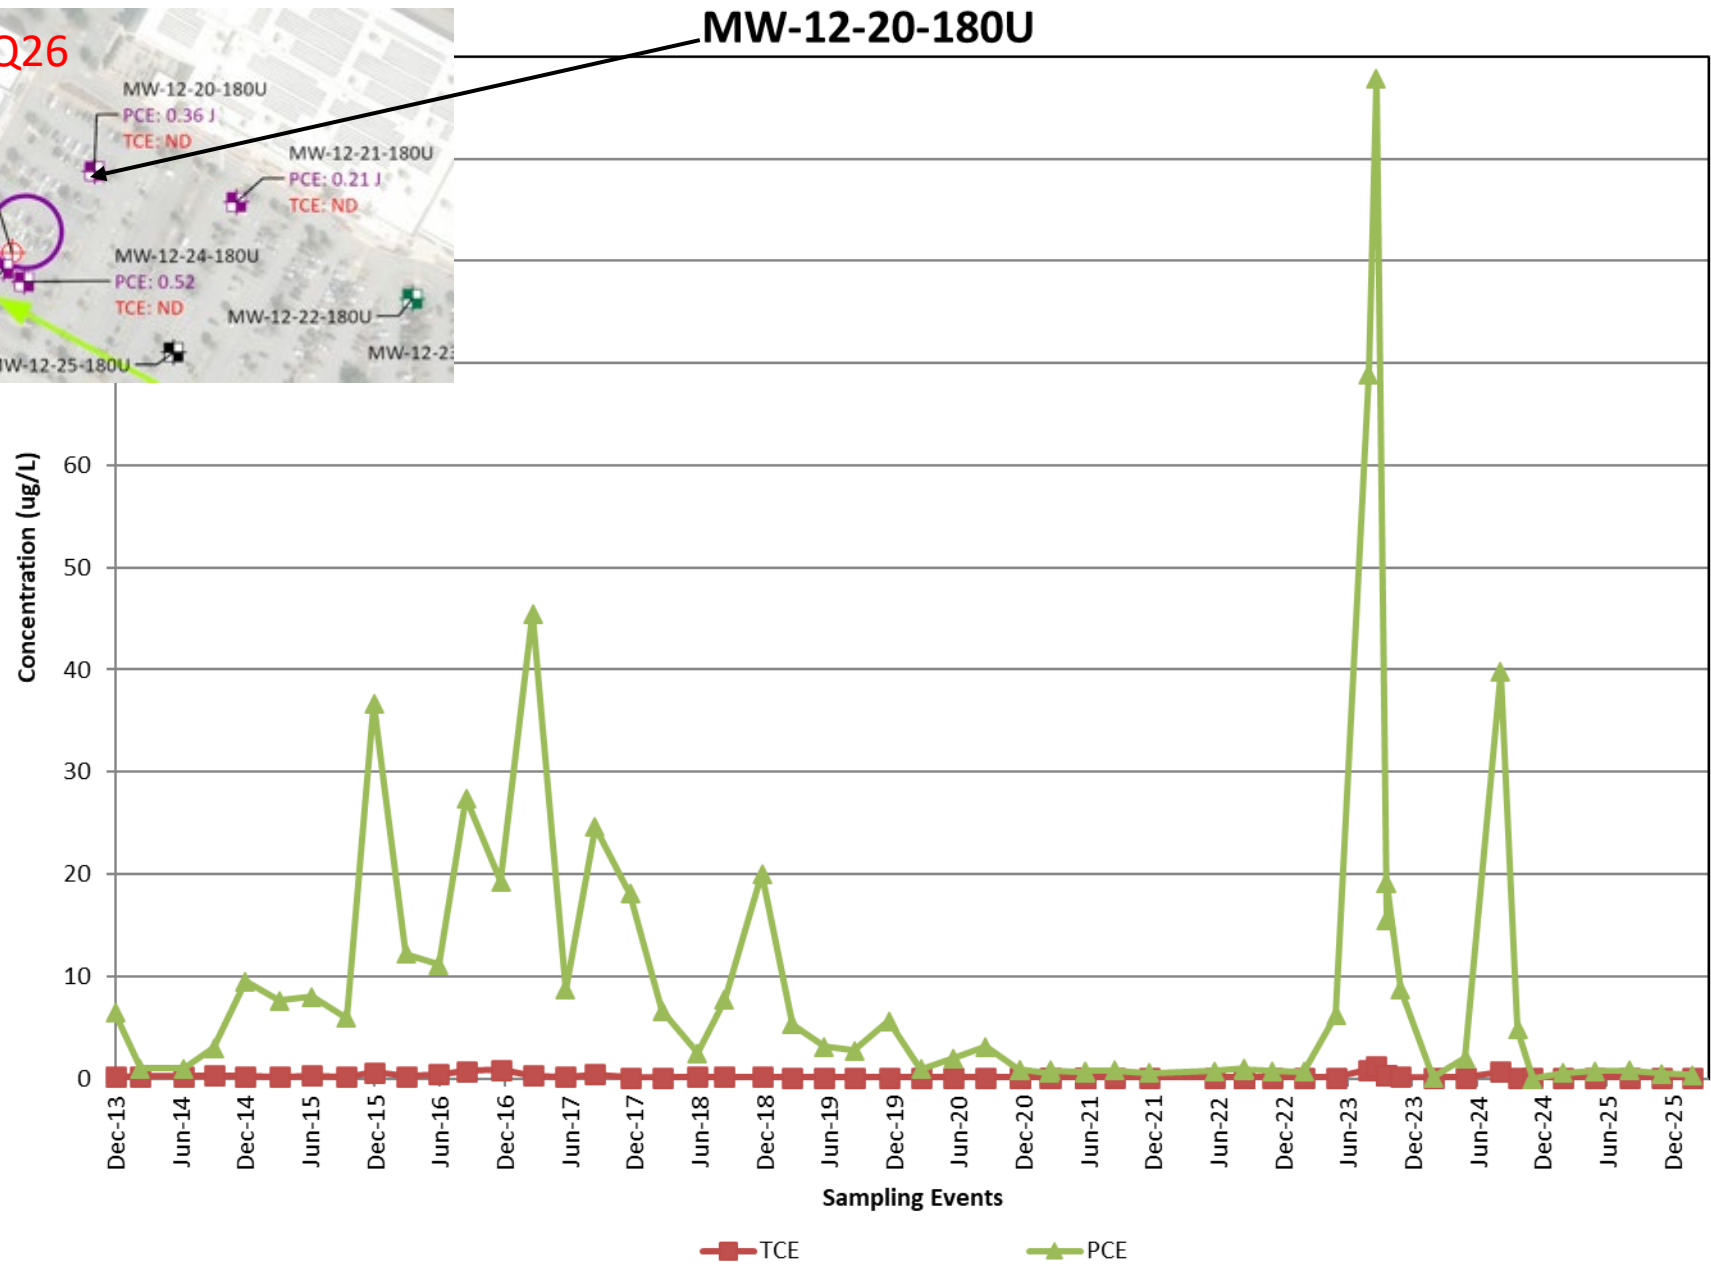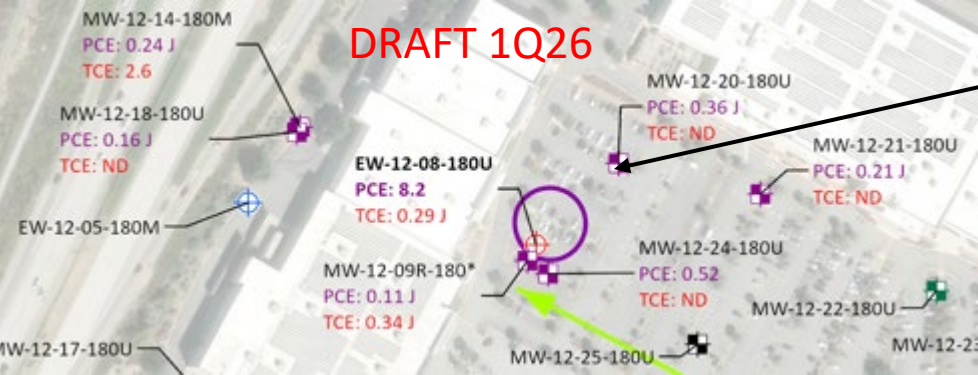



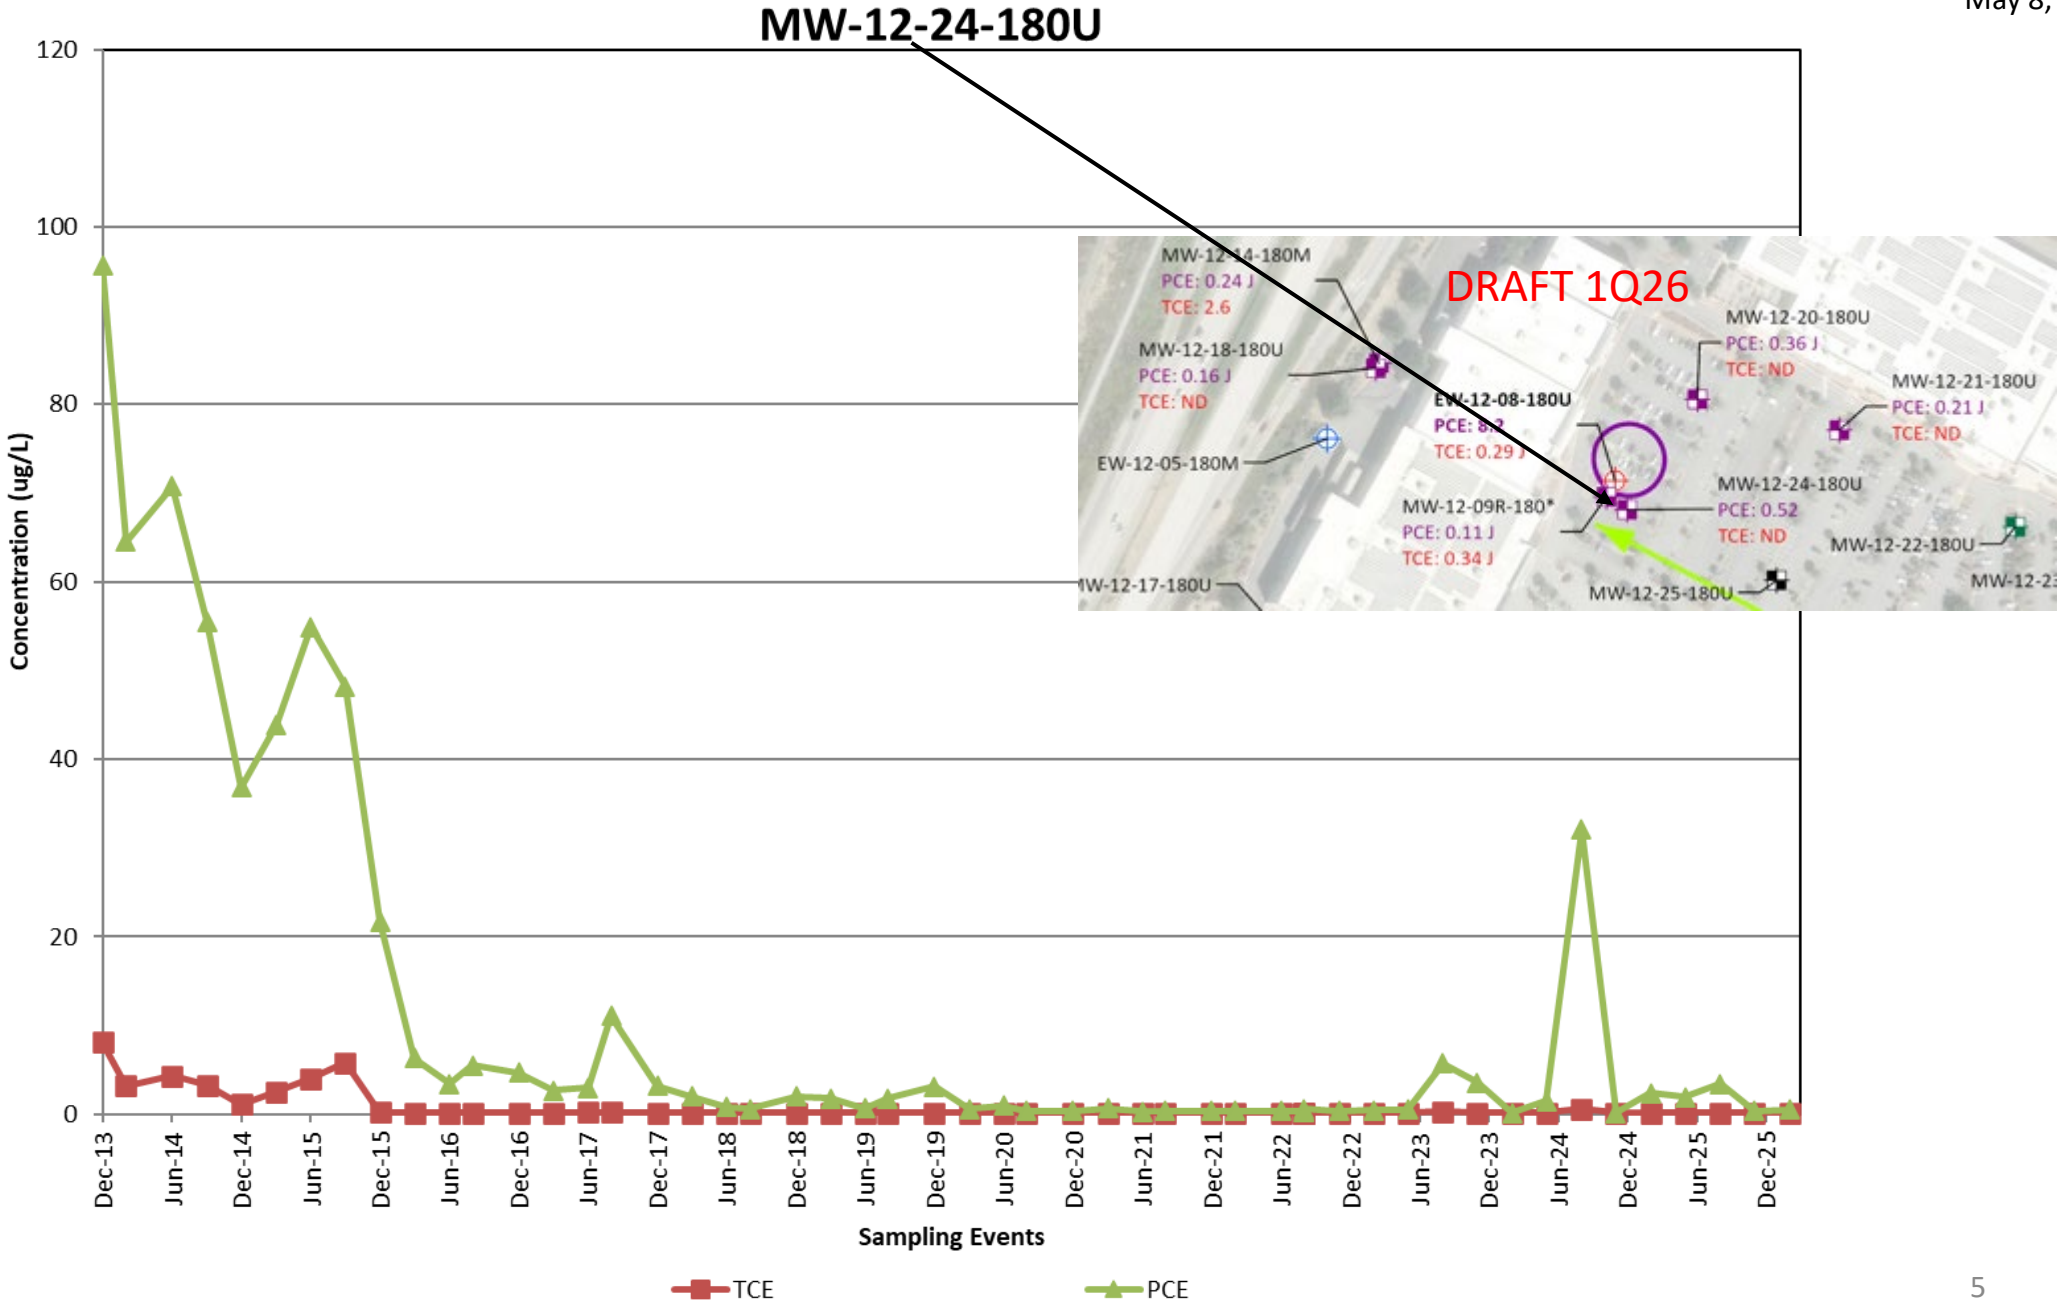



Table 3. Sites 2/12 Monitoring Well TCE Data

Well Identification ¹	Select COC Concentrations (µg/L) ²													
	3Q2022	4Q2022	1Q2023	2Q2023	3Q2023	4Q2023	1Q2024	2Q2024	3Q2024	4Q2024	1Q2025	2Q2025	3Q2025	1Q2026
	TCE													
ACL:	5.0													
MW-02-13-180M	1.5	8.8	1.4	1.4	1.5	1.3	1.2	1.4	1.3	1.5	0.62	1.3	1.4	1.3
MW-12-14-180M	1.3	1.2	0.84	1.1	1.1	0.69	2.8	3.2	2.5	4.1	5.3	4.7	0.66	2.6

Notes:
Concentration in **bold** and shaded exceeds the Aquifer Cleanup Level (ACL).
COC: chemical of concern
µg/L: micrograms per liter
*Preliminary data

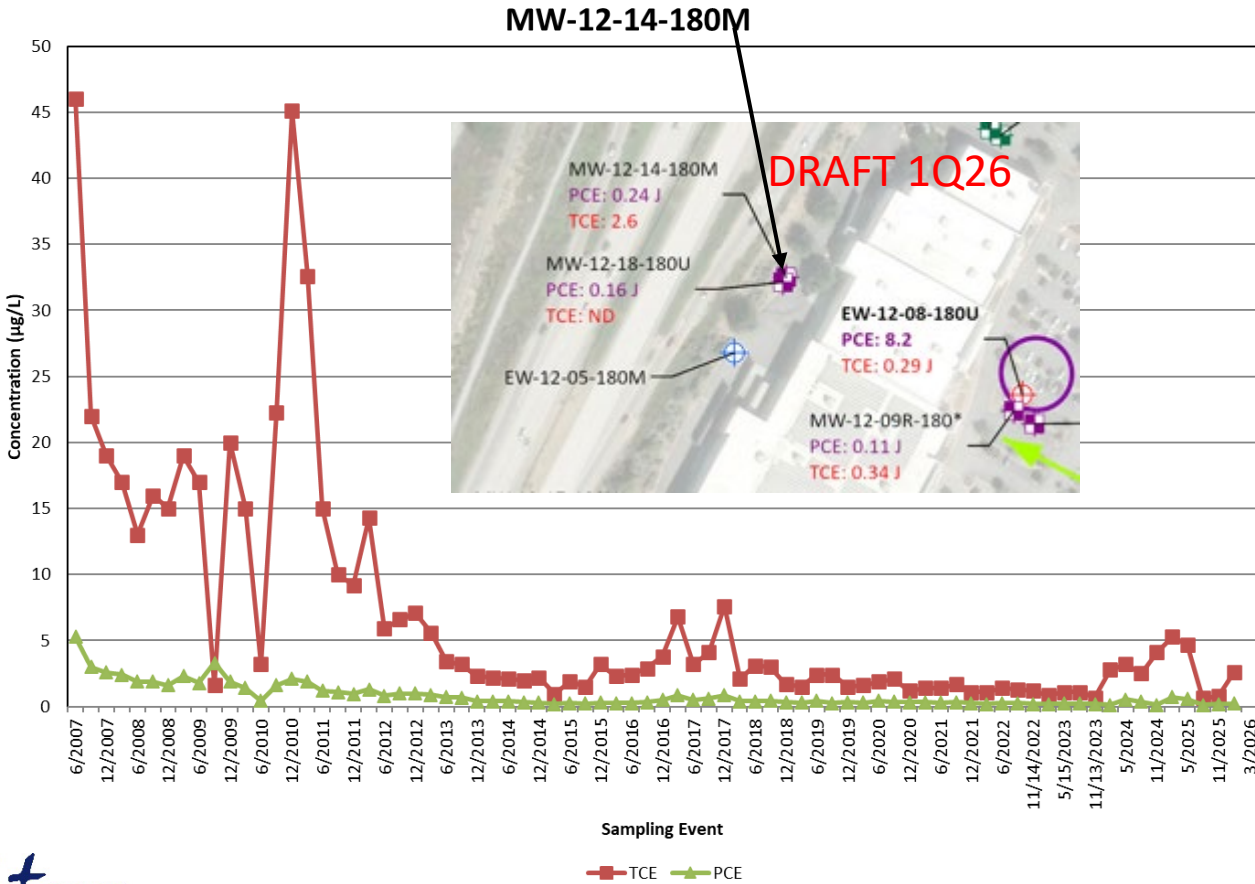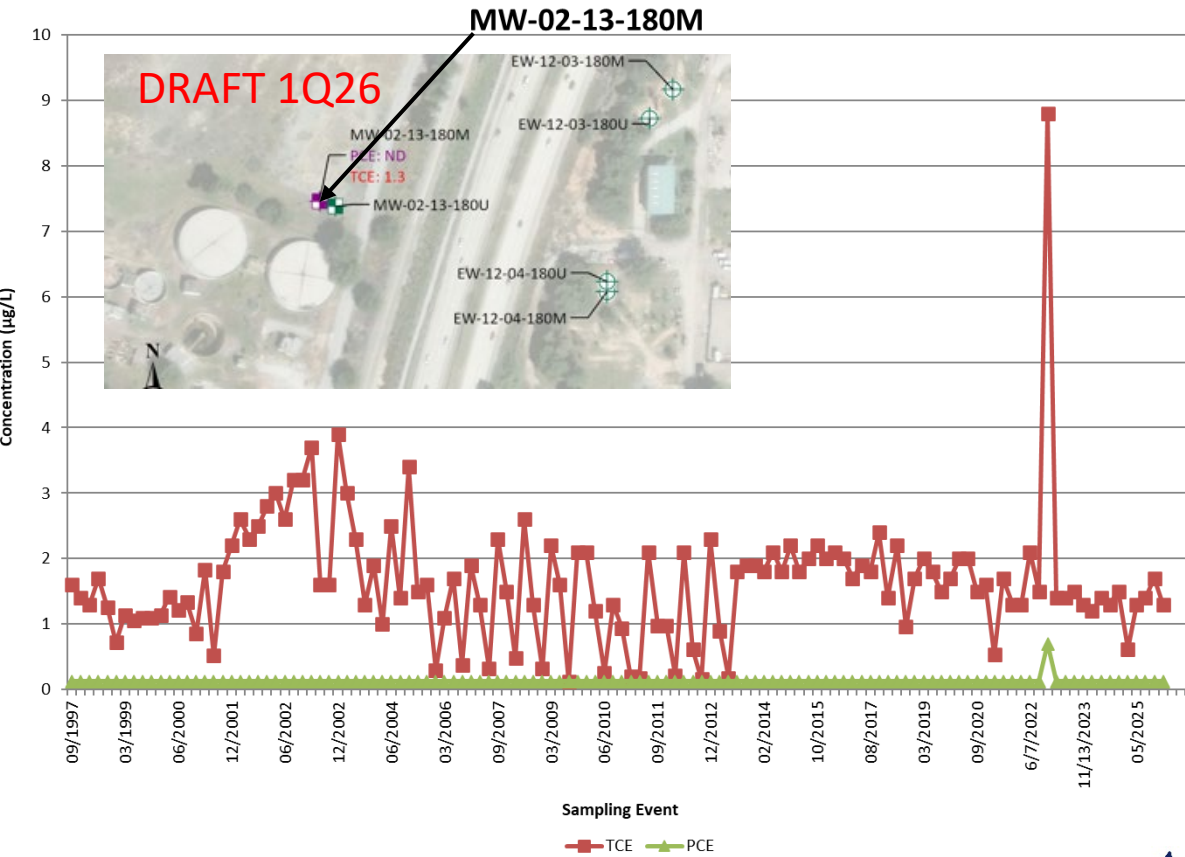

Ahtna

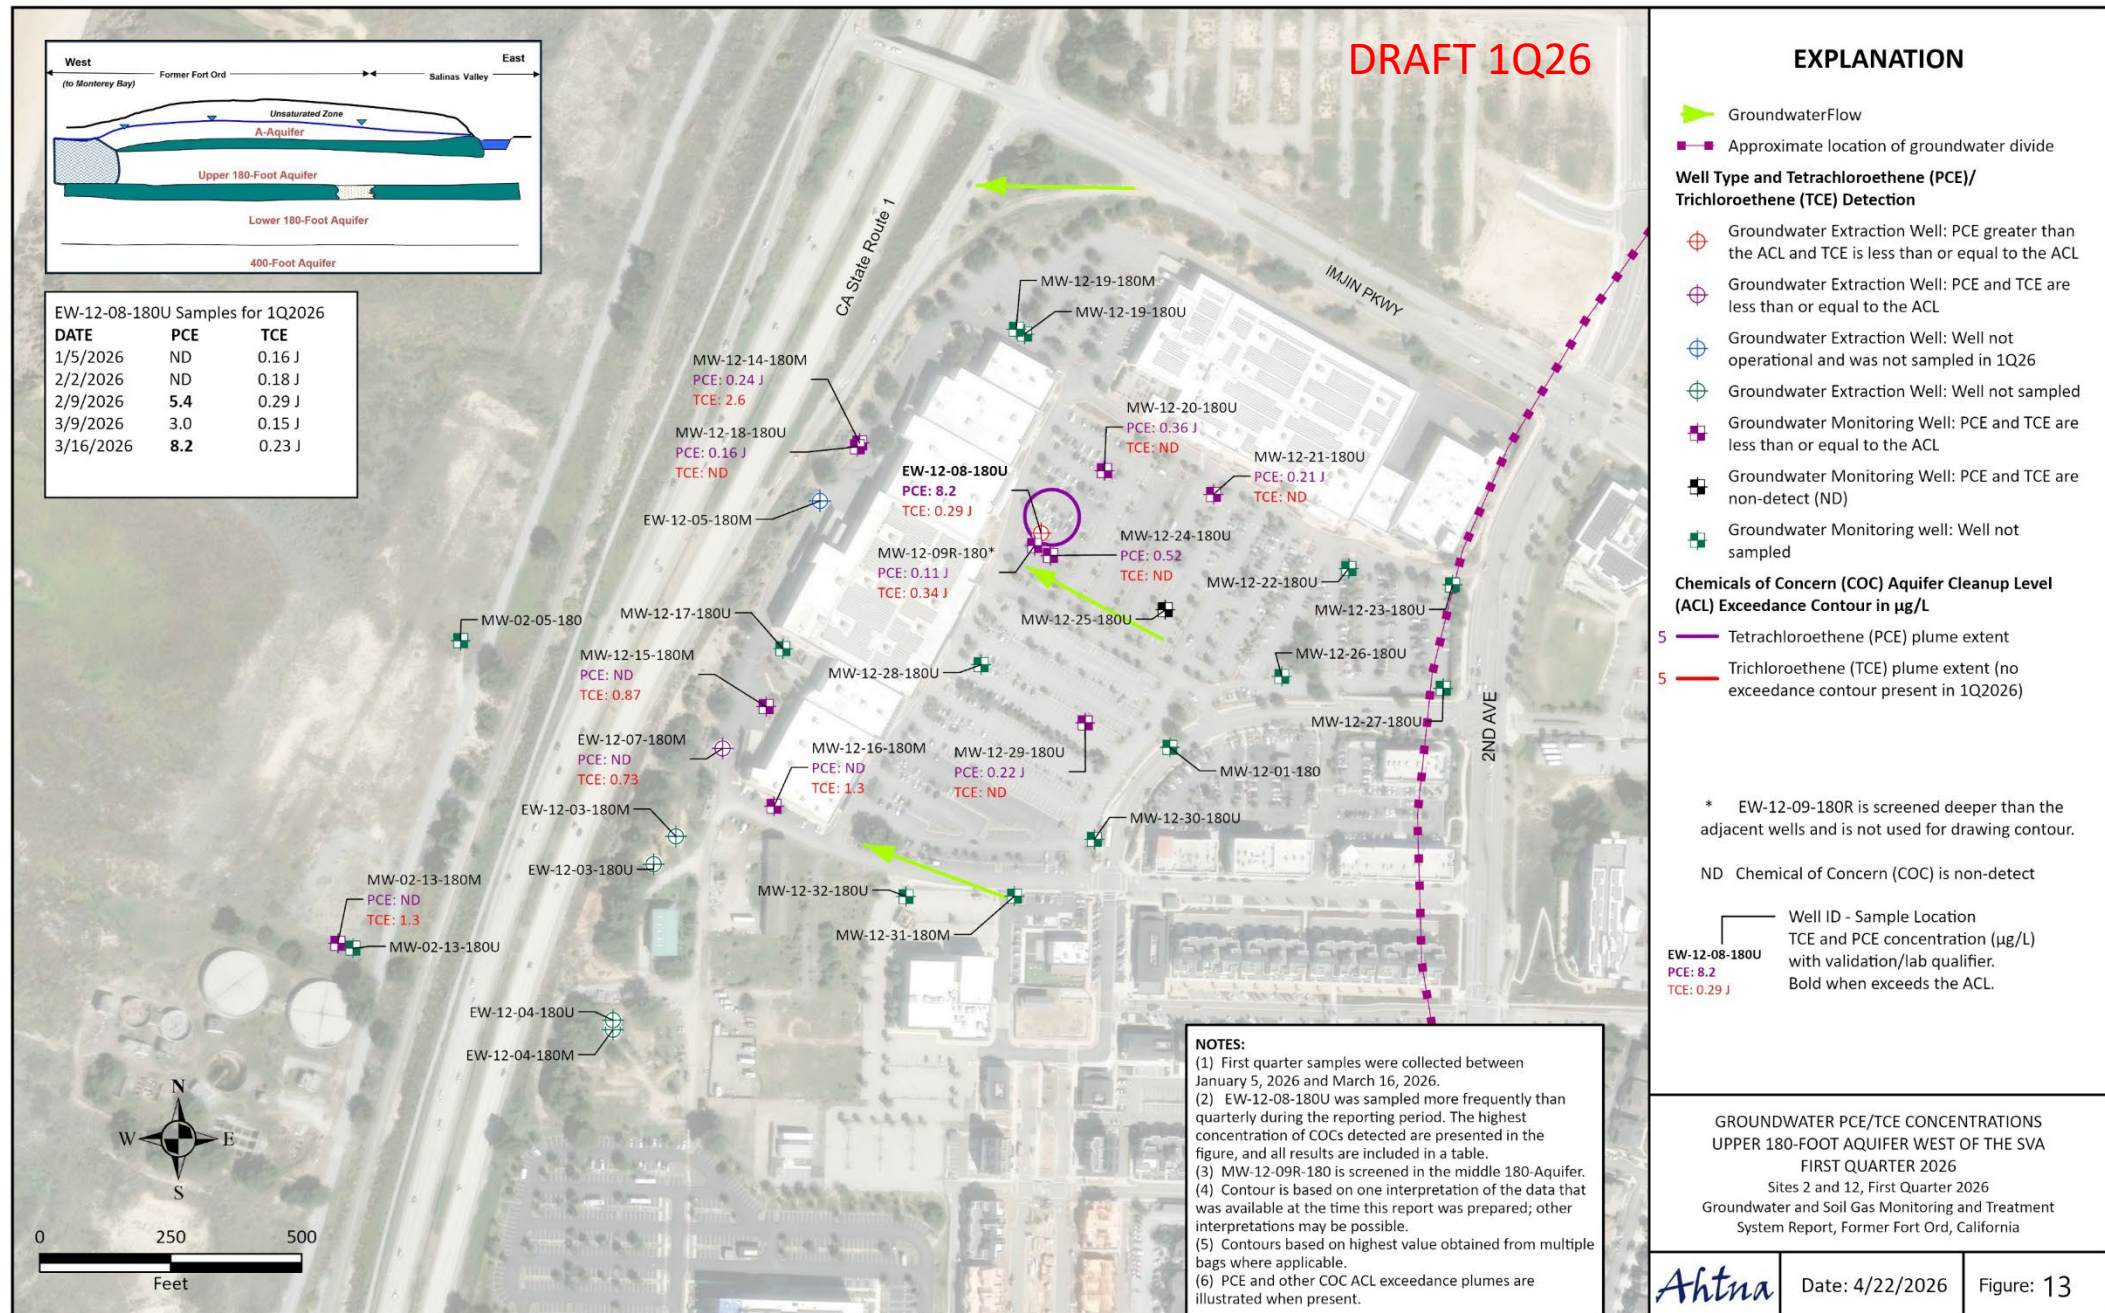

SVETS Operation Summary

- Rebound trends at SG-12-04 indicate TCE trigger level exceedance by 2Q2025.
- SVETS restarted on June 18, 2025
- SVETS shut down September 5, 2025 to assess rebound following 3Q2025 monitoring event.

Table 4. Sites 2/12 SVETS PCE and TCE Monitoring Results

SVETS ID	PCE									TCE								
	1Q24	2Q24	3Q24	4Q24	1Q25	2Q25	3Q25	4Q25	1Q26	1Q24	2Q24	3Q24	4Q24	1Q25	2Q25	3Q25	4Q25	1Q26
VE-12-02	NS	ND	ND	NS	NS	NS	NS	NS	NS	NS	34 J	ND	NS	NS	NS	NS	NS	NS
VE-12-06	NS	86	ND	NS	NS	84	ND	NS	NS	NS	ND	ND	NS	NS	ND	ND	NS	NS
VE-12-07	NS	NS	NS	NS	NS	69 J	ND	NS	NS	NS	NS	NS	NS	NS	ND	ND	NS	NS
VE-12-08	NS	64	ND	NS	NS	85	ND	NS	NS	NS	ND	ND	NS	NS	ND	ND	NS	NS
VE-12-09	NS	160	82	NS	NS	140	56 J	NS	NS	NS	38 J	ND	NS	NS	ND	ND	NS	NS
SVTU-INF	NS	58	33	NS	NS	75	44	NS	NS	NS	22	8.6	NS	NS	4.7	6.4	NS	NS
SVTU-EFF	NS	9.2	11	NS	NS	11	24	NS	NS	NS	1.6	8.5	NS	NS	5.5	6.9	NS	NS

Notes:
*Preliminary results
J = estimated result below the limit of quantitation (LOQ)
ND = not detected above the limit of detection (LOD)
NS = not sampled
Concentrations in **bold** exceed the SGCL
Concentrations in *italics* exceed the SG-SL
Results reported in micrograms per cubic meter (µg/m³)

COC	SGCL (µg/m³)	SG-SL (µg/m³)
PCE	1,800	<i>603</i>
TCE	1,000	<i>888</i>



Table 5. Sites 2/12 Soil Gas PCE and TCE Monitoring Results

Soil Gas Probe ID	Schedule	1Q24	2Q24	3Q24	4Q24	1Q25	2Q25	3Q25	4Q25	1Q26	1Q24	2Q24	3Q24	4Q24	1Q25	2Q25	3Q25	4Q25	1Q26	Last Exceedance			
		PCE									TCE									PCE		TCE	
		SG-SL	SGCL	SG-SL	SGCL	SG-SL	SGCL	SG-SL	SGCL														
SG-12-01-65	Q	260	390	260	340	240	390	200	300	260	ND	ND	ND	ND	ND	ND	ND	ND	ND	2Q15	4Q13	--	--
SG-12-02-10	Q ¹	570	700	1,100	990	640	900	1,000	940	640	ND	ND	ND	ND	ND	ND	ND	ND	ND	3Q25	3Q15	--	--
SG-12-02-20	A	NS	NS	770	NS	NS	NS	800	NS	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	3Q25	4Q13	--	--
SG-12-02-30	A	NS	NS	680	NS	NS	NS	710	NS	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	3Q25	--	--	--
SG-12-02-40	A	NS	NS	660	NS	NS	NS	460 J	NS	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	3Q24	--	--	--
SG-12-02-50	A	NS	NS	690	NS	NS	NS	660	NS	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	3Q25	--	--	--
SG-12-02-57	A	NS	NS	ND	NS	NS	NS	670	NS	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	3Q25	--	--	--
SG-12-02-65	R	NS	NS	NS	NS	NS	NS	540	NS	NS	NS	NS	NS	NS	NS	NS	ND	NS	NS	3Q18	--	--	--
SG-12-04-10	Q ³	200	260	ND	93	79	150	ND	53 J	57	970	1,200	34 J	180	340	790	ND	98	260	2Q15	--	2Q24	2Q24
SG-12-04-20	Q ³	180	240	44 J	79	78	140	ND	66 J	62	910	1,000	73 J	170	310	830	ND	94	270	3Q15	--	2Q24	2Q24
SG-12-04-40	Q ³	180	230	ND	95	85	140	ND	65 J	65	910	960	ND	100	340	820	ND	100	260	1Q15	--	2Q24	4Q22
SG-12-04-50	Q ³	160	180	ND	80	69	140	ND	76	73	690	690	43 J	140	290	640	ND	90	250	1Q15	--	3Q21	4Q22
SG-12-04-58	Q ³	140	210	ND	92	100	140	ND	71 J	89	400	700	ND	160	99	310	ND	60	160	1Q15	--	2Q22	4Q22
SG-12-04-65	Q ³	160	220	ND	86	79	140	ND	65 J	60	730	1,100	ND	180	290	800	ND	100	250	1Q15	--	2Q24	2Q24
SG-12-06-10	Q ¹	120	160	ND	67 J	100	120	ND	77	44 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	3Q15	--	--	--
SG-12-06-70	Q ²	180	210	95	140	180	170	ND	200	91	ND	ND	ND	ND	ND	ND	ND	ND	ND	1Q17	--	--	--
SG-12-07-65	Q	130	240	ND	62 J	85	170	ND	43 J	110	ND	ND	ND	ND	ND	ND	ND	ND	9	4Q22	3Q15	--	--
SG-12-17-60	Q	ND	ND	ND	ND	ND	ND	1 J	1.3 J	1.9	160	160	35 J	87	110	140	210	370	340	--	--	--	4Q15
SG-12-20-10	A	NS	NS	420	NS	NS	NS	350	NS	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	3Q22	3Q15	--	--
SG-12-20-20	A	NS	NS	120	NS	NS	NS	75 J	NS	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	3Q22	2Q15	--	--
SG-12-20-70	Q	90	110	80	72 J	89	120	92	47 J	65 J	ND	ND	ND	ND	ND	ND	ND	ND	ND	3Q15	2Q15	--	--



Notes:
*Preliminary results
-- = Never
A = Annual
J = estimated result below the limit of quantitation (LOQ)
INV = investigation (adjacent probe above SGCL/SG-SL)
ND = not detected above the limit of detection (LOD)
NS = not sampled
Q = Quarterly
R = Removed
Concentrations in **bold** exceed the SGCL
Concentrations in *italics* exceed the SG-SL
Results reported in micrograms per cubic meter (µg/m³)
¹ Quarterly probe due to proximity of store front in an area of historical soil gas concentrations above the SGCL.
² Will continue to sample probe quarterly if it is within the vicinity of the current groundwater plume above the ACL (probe adjacent to deepest probe will be sampled in lieu if deepest probe is in saturated zone).
³ Quarterly probe due to concentration above SGCL.

	SGCL (µg/m³)	SG-SL (µg/m³)
PCE	1,800	603
TCE	1,000	888

Ahtna

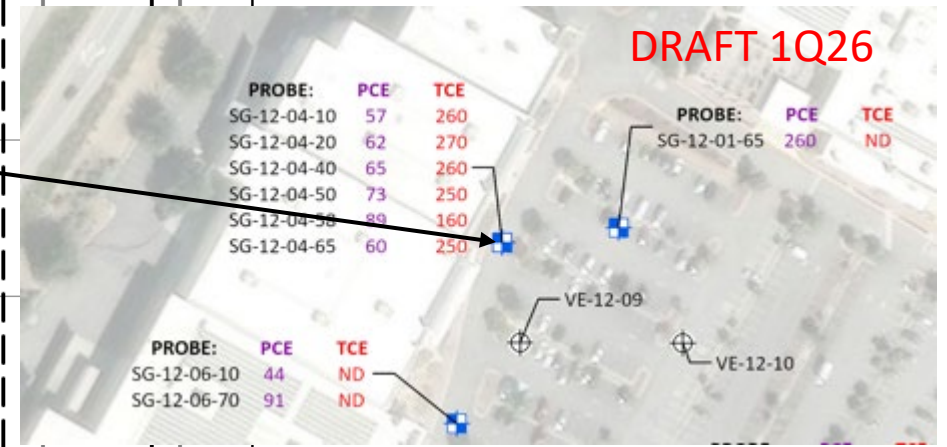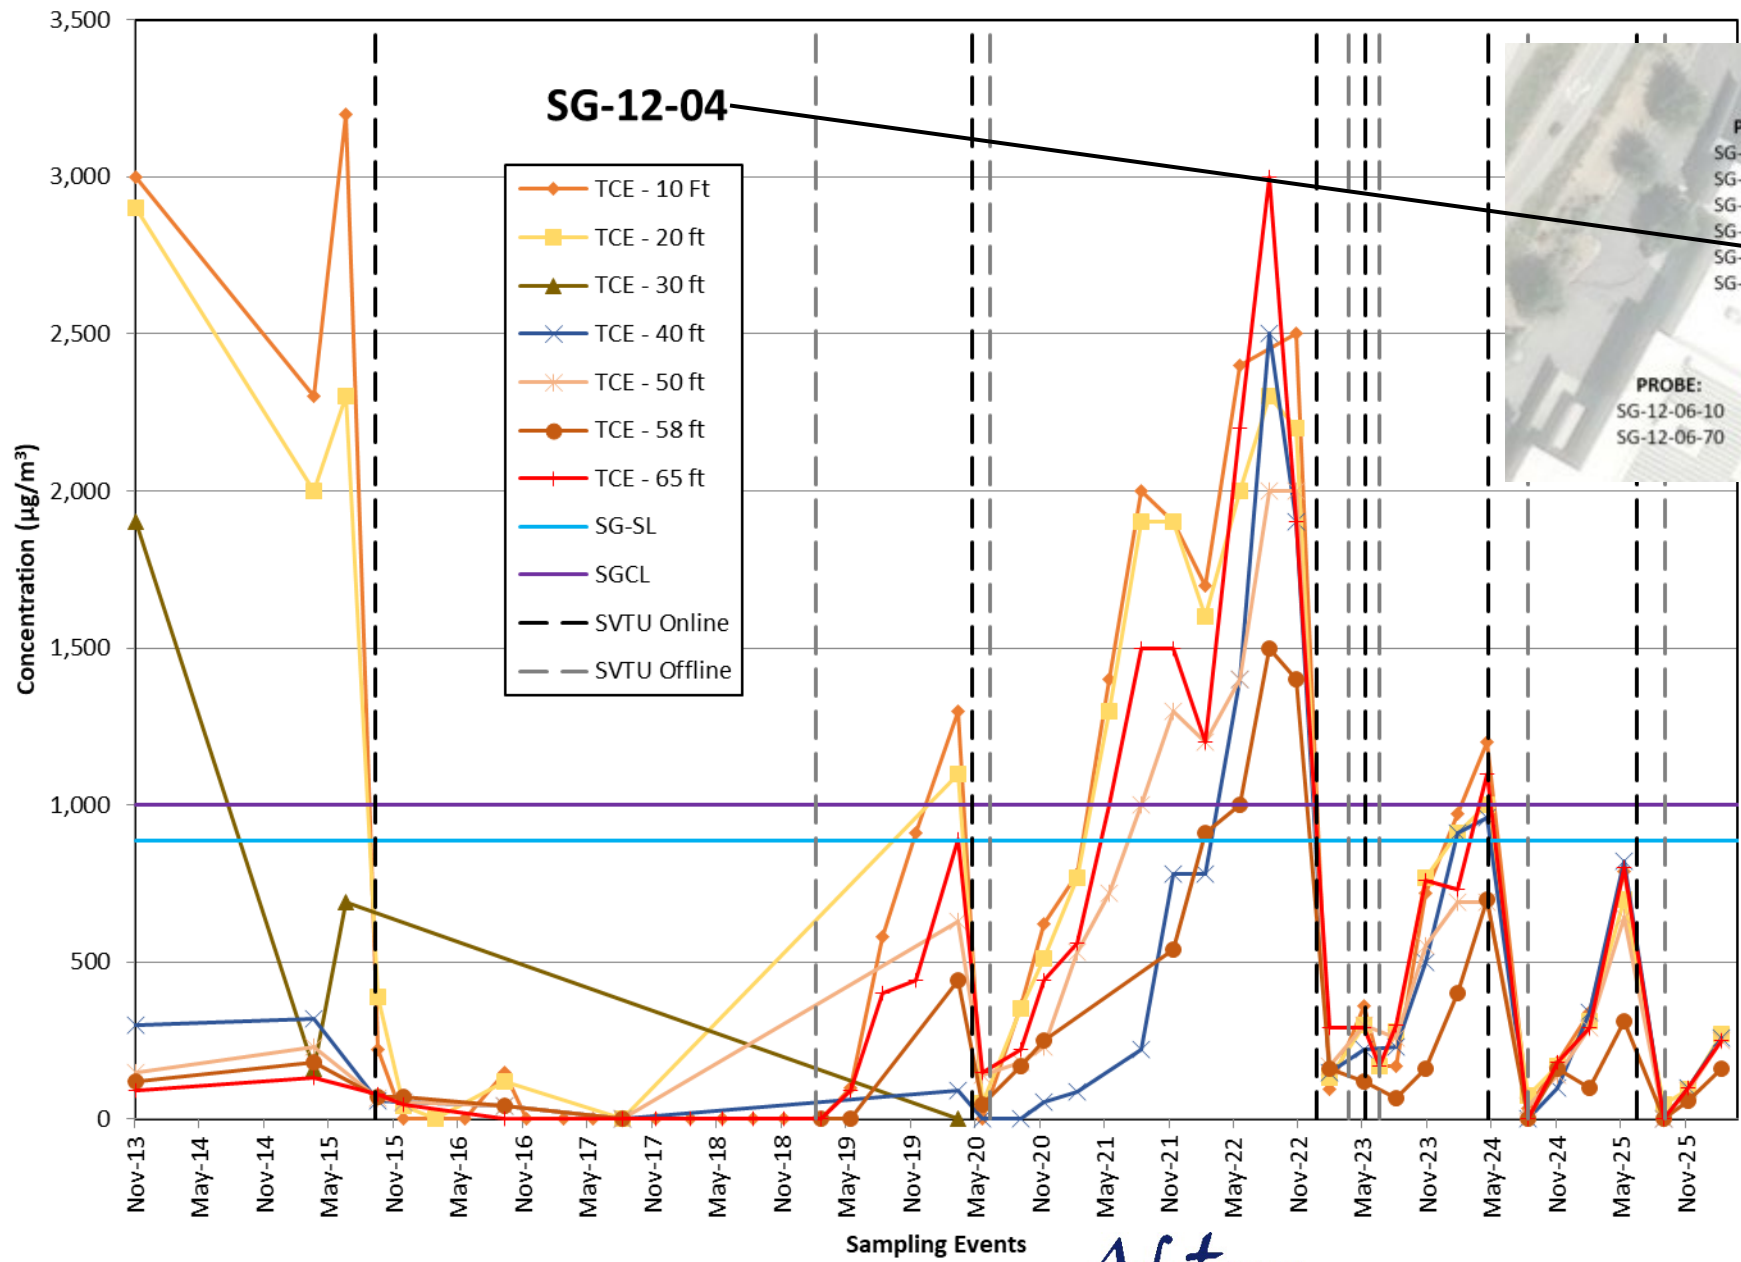

Ahtna

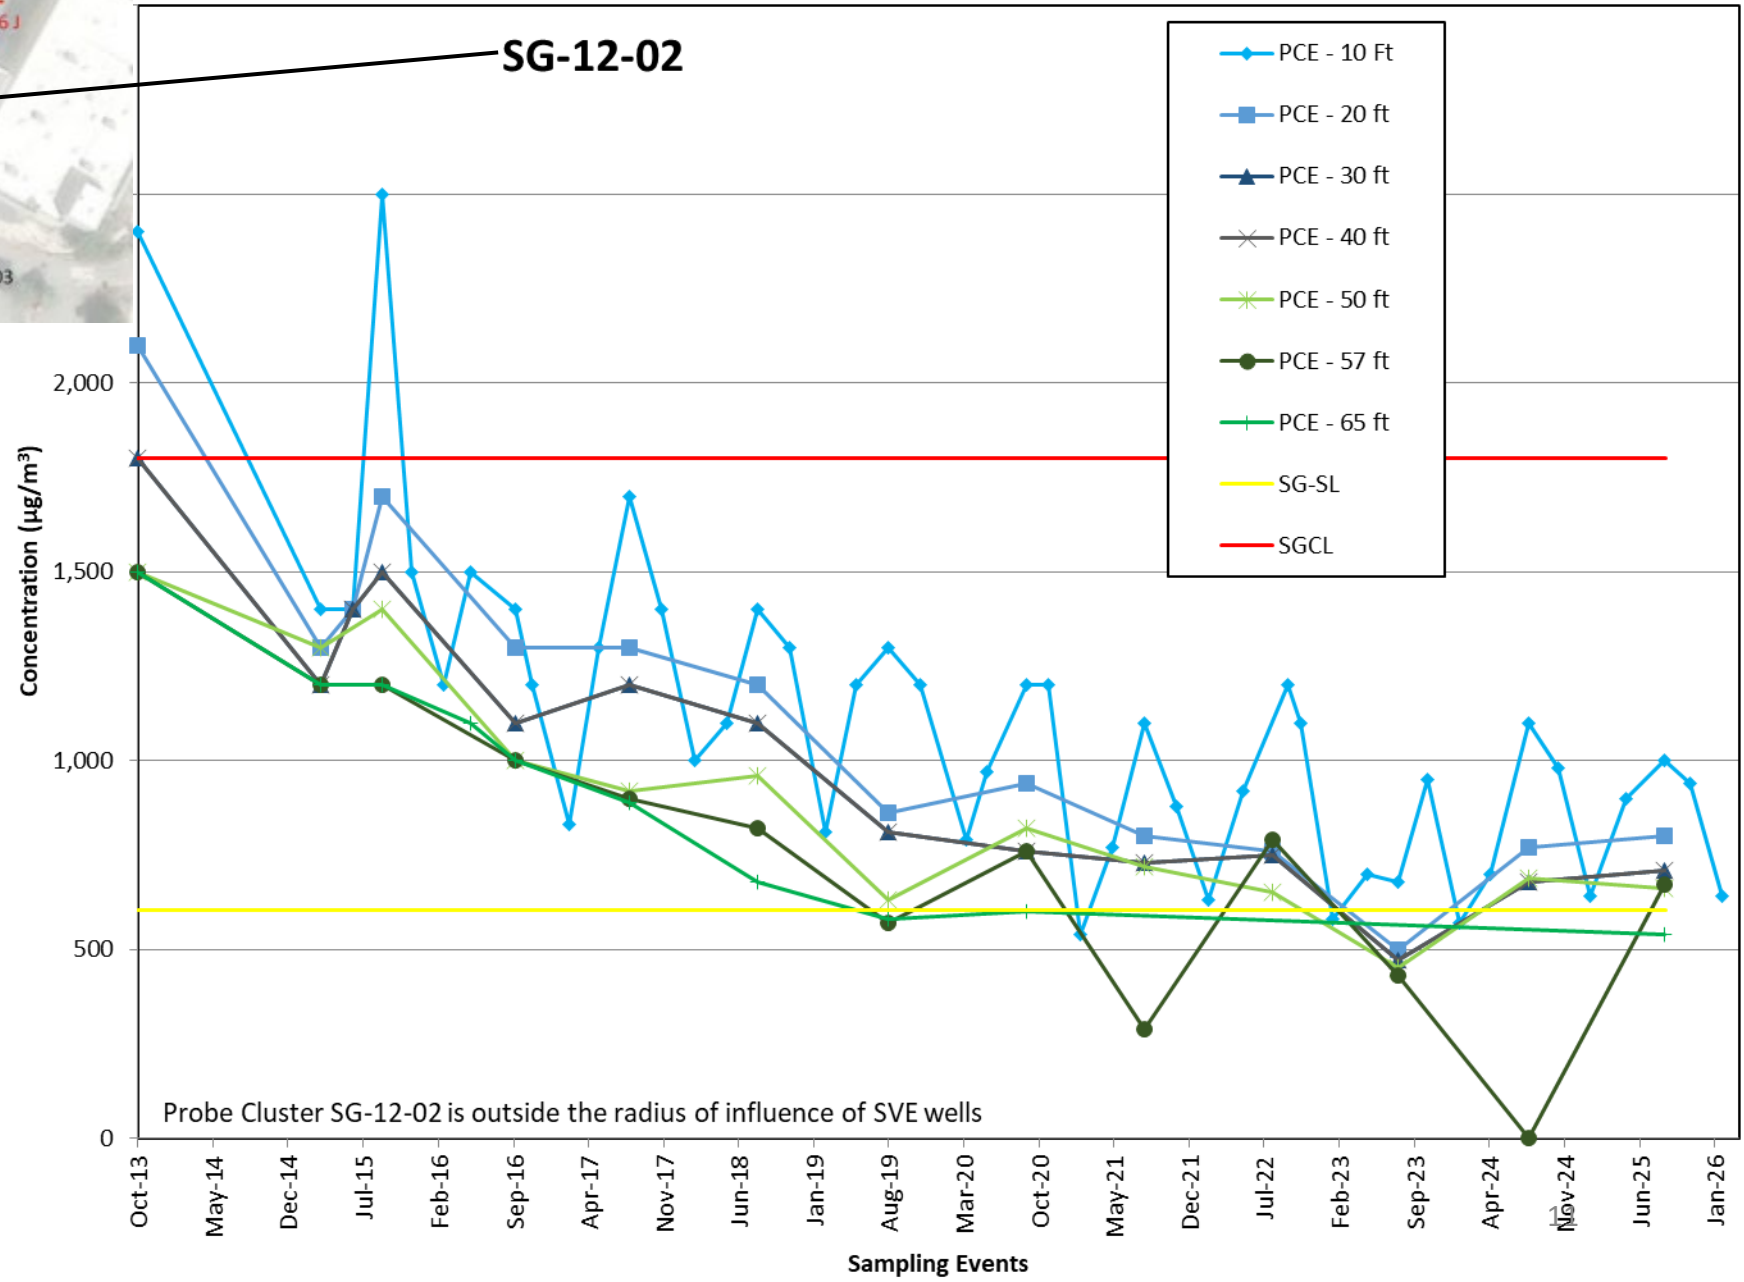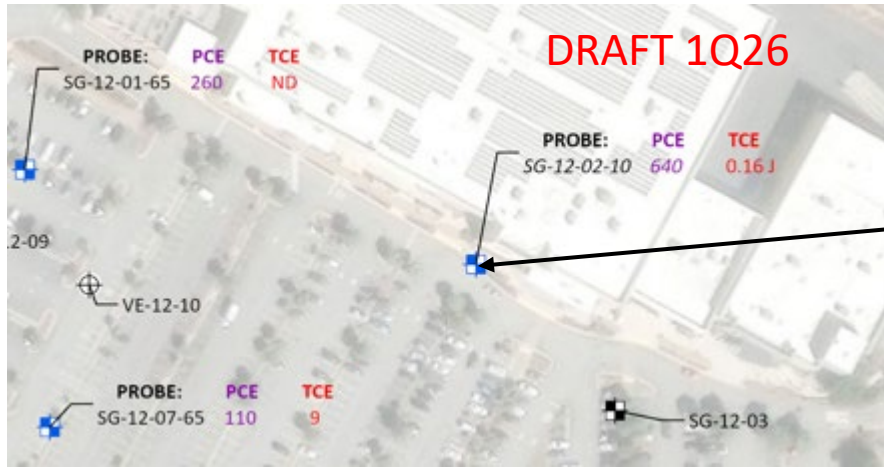

DRAFT 1Q26

EXPLANATION

SoilVaporTreatmentUnit

Well Type and COC Concentration

- Soil Gas Probe Cluster: Tetrachloroethene (PCE) is above SG-SL but below the SGCL and trichloroethene (TCE) is below or equal to SG-SL
- Soil Gas Probe Cluster: PCE and TCE is below or equal to SG-SL
- Soil Gas Probe Cluster: Probes not sampled
- Soil Vapor Extraction Well: Well not sampled
- SVETS Influent: SVETS not sampled
- SVETS Effluent: SVETS not sampled

ND Chemical of Concern (COC) is non-detect

Well ID - Sample Location and Probe Depth
TCE and PCE concentration (µg/L) with validation/lab qualifier.
Italics when exceeds the SG-SL
Bold when exceeds the SGCL.

NOTES:

- (1) Soil gas samples were collected between February 2, 2026 and February 13, 2025 while the SVETS was not in operation.
- (2) SGCL refers to Soil Gas Cleanup Level.
- (3) SG-SL refers to Soil Gas Screening Level.

SOIL GAS PCE/TCE CONCENTRATIONS AND SGCL EXCEEDANCES
FIRST QUARTER 2026

Sites 2 and 12, First Quarter 2026
Groundwater and Soil Gas Monitoring and Treatment
System Report, Former Fort Ord, California

Ahtna

Date: 4/22/2026

Figure: 14


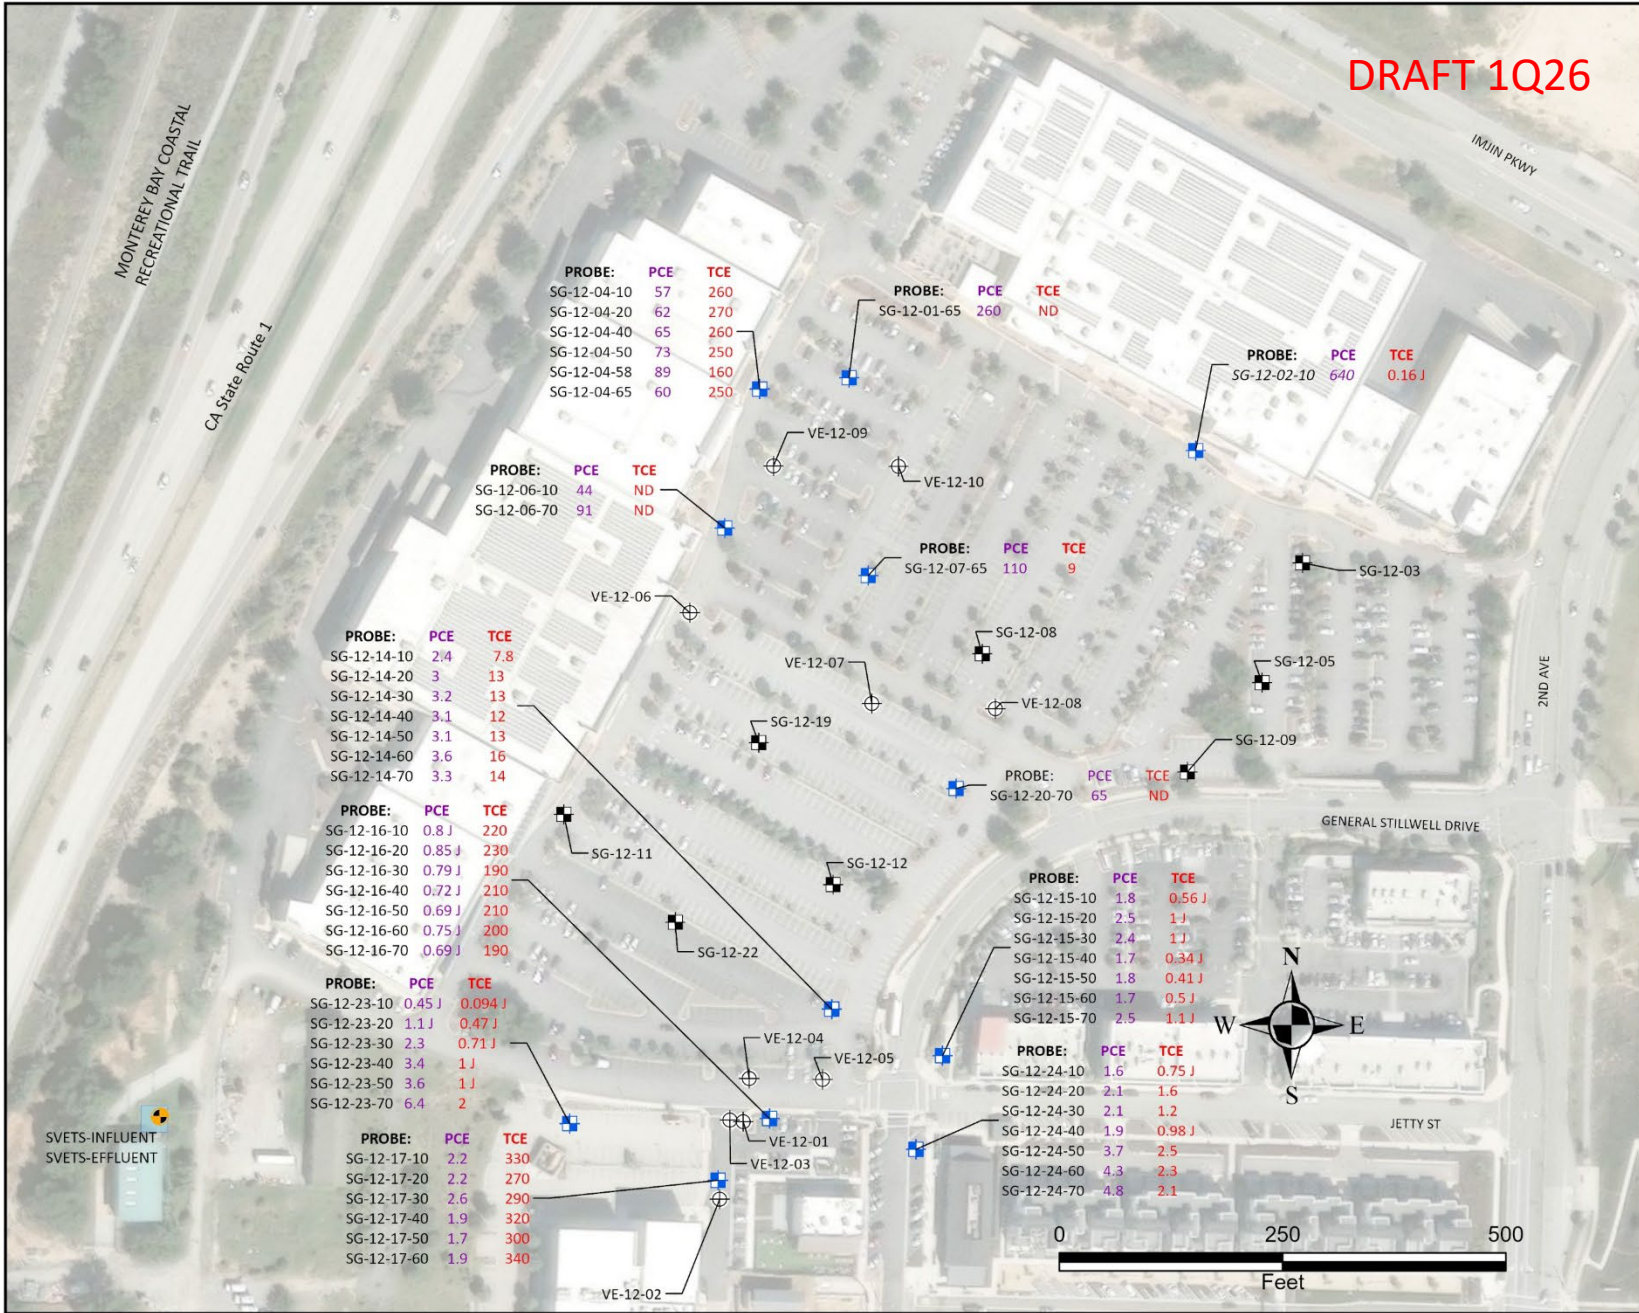


Table 14. First Quarter 2026 Data for Soil Gas Probes in the Jetty Street Area

Probe Cluster	Depth (ft)	PCE (µg/m³)	TCE (µg/m³)
SG-12-14	10	2.4	7.8
	20	3.0	13
	30	3.2	13
	40	3.1	12
	50	3.1	13
	60	3.6	16
	70	3.3	14
SG-12-15	10	1.8	0.56 J
	20	2.5	1.0 J
	30	2.4	1.0 J
	40	1.7	0.34 J
	50	1.8	0.41 J
	60	1.7	0.50 J
	70	2.5	1.1 J
SG-12-16	10	0.8 J	220
	20	0.85 J	230
	30	0.79 J	190
	40	0.72 J	210
	50	0.69 J	210
	60	0.75 J	200
	70	0.69 J	190
Probe Cluster	Depth (ft)	PCE (µg/m³)	TCE (µg/m³)
SG-12-17	10	2.2	330
	20	2.2	270
	30	2.6	290
	40	1.9	320
	50	1.7	300
	60	1.9	340
	70*	--	--
SG-12-23	10	0.45 J	0.094 J
	20	1.1 J	0.47 J
	30	2.3	0.71 J
	40	3.4	1.0 J
	50	3.6	1.0 J
	60*	--	--
	70	6.4	2.0
SG-12-24	10	1.6	0.75 J
	20	2.1	1.6
	30	2.1	1.2
	40	1.9	0.98 J
	50	3.7	2.5
	60	4.3	2.3
	70	4.8	2.1

Additional Soil Gas Sampling – First Quarter 2026

- SVETS is offline
- Soil Gas QAPP Addendum in progress

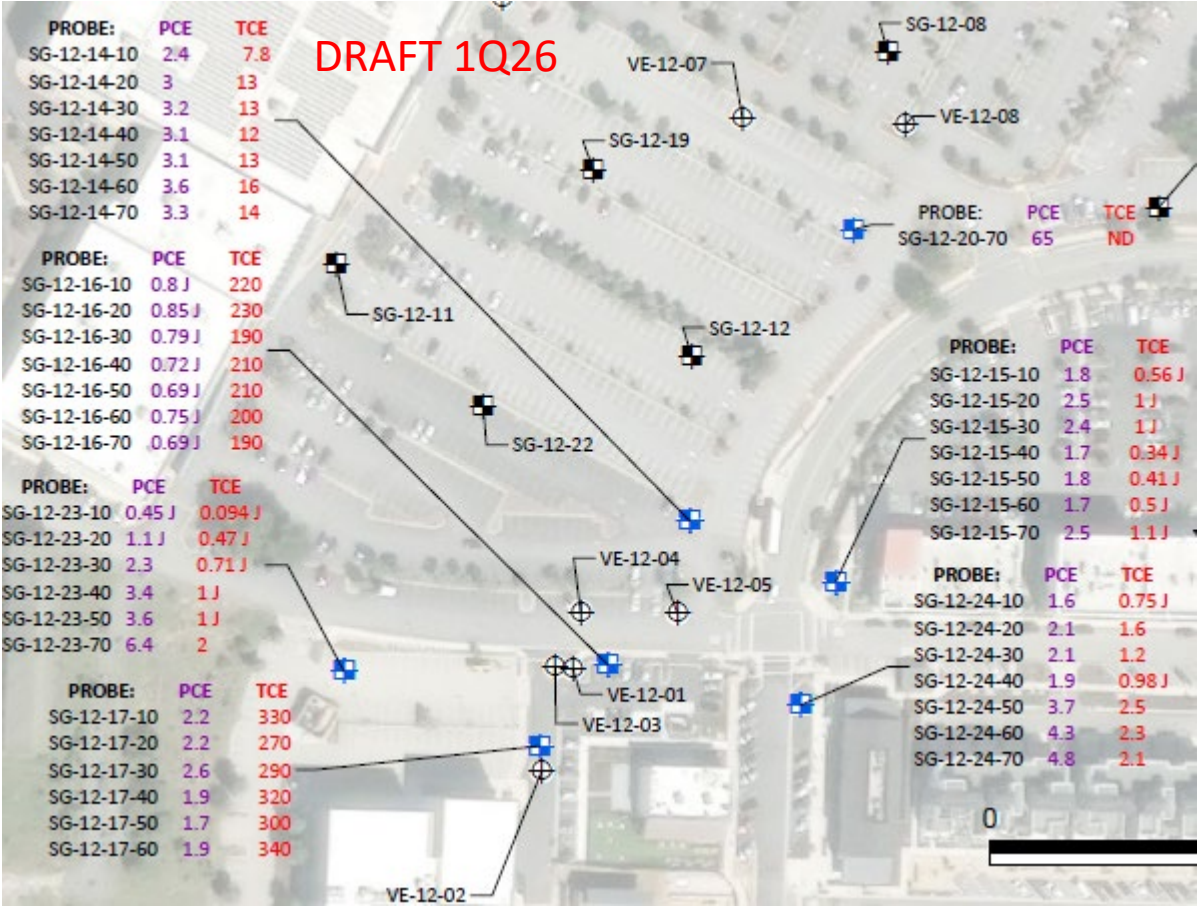

*Probe non-functional

