

Table 1: April - May 2026 – OU2 GWTP Statistics

Month	Volume Treated (gallons)	Temporal Average Flow Rate (gallons per minute)	Percent of Time Online	COC Mass Removed (pounds)
April 2026	36,800,870	852	100	1.5
May 2026	37,973,218	851	100	1.4
Total since October 1995	10.843 billion			1,025

Table 2: April - May 2026 – Treated Water Reuse

Month	Volume Used (gallons)	Use
April 2026	0	
May 2026	2,000	Landfills
Total since October 2016	4.394 million	

Recent Key Events

- Apr 18: Power outage, GWTP low flow for approximately 2 hours.
- May 16: Power outage, GWTP low flow for approximately 12 hours.
- May 11-15: Second Quarter 2026 GWMP event.
- Jun 17: Replaced failed VFD AC unit for EW-OU2-02-180R and restarted fulltime operations.
- Jun 23-25: Replaced failed pump in EW-OU2-10-A and restarted operations. Remove failed pumps in EW-OU2-07-A and EW-OU2-11-180.

Future Key Events

- Third Quarter 2026 GWMP event.

Remedial Summary

- **11 COCs:** 1,1-DCA; 1,2-DCA; 1,2-DCPA; benzene; CT; chloroform; cis-1,2-DCE; methylene chloride; PCE; TCE; and VC. Metals monitored annually near OU2 Landfills.
- **Remediation:** Pump and treat with GAC in the A-Aquifer and Upper 180-Foot Aquifer since 1995. Extraction wells added in 2000 and 2007. OU2 GWTP relocated from the western network area to OU2 Landfills, extraction wells added in 2018.
- **Monitoring:** Quarterly groundwater monitoring and reporting, including annual 3Q monitoring and reports. Described in the most recent Groundwater QAPP.

April – May 2026 OU2 Treated Water at TS-OU2-INJ-01 did not exceed discharge limits.






Table 3. Second Quarter 2026 OU2 A-Aquifer*

Well ID	Station	Sampled	11DCA		12DCA		TCM		cis12DCE		PCE		TCE		VC	
ACL:			5		0.5		2		6		3		5		0.1	
EW-OU2-02-A	-	5/6/2026	0.66		<0.25	U	0.13	JB	<0.25	U	<0.25	U	0.40	J	<0.10	U
EW-OU2-04-A	-	5/6/2026	1.1		0.20	J	0.38	JB	0.28	J	0.66		2.4		<0.10	U
EW-OU2-06-A	-	5/6/2026	0.13	J	<0.25	U	0.20	JB	0.50		0.25	J	2.1		<0.10	U
EW-OU2-09-A	-	5/6/2026	<0.25	U	<0.25	U	<0.25	U	0.14	J	0.31	J	0.26	J	<0.10	U
EW-OU2-11-AR	-	5/6/2026	0.90		0.11	J	0.16	JB	0.57		0.63		1.3		<0.10	U
EW-OU2-12-A	-	5/6/2026	1.4		0.96		0.39	JB	2.0		2.6		5.1		<0.10	U
EW-OU2-13-A	-	5/6/2026	0.46	J	1.9		0.24	JB	1.1		1.3		3.1		<0.10	U
EW-OU2-14-A	8	5/12/2026	<0.25	U	<0.25	U	0.29	JB	<0.25	U	1.0		<0.25	U	<0.10	U
EW-OU2-15-A	6	5/12/2026	<0.25	U	<0.25	U	0.22	JB	<0.25	U	<0.25	U	1.7		<0.10	U
EW-OU2-16-A	-	5/6/2026	2.4		0.77		0.17	JB	3.8		1.3		1.3		0.19	
EW-OU2-17-A	-	5/6/2026	0.25	J	0.57		0.35	JB	0.32	J	2.2		2.3		<0.10	U
EW-OU2-18-A	-	5/6/2026	1.1		0.23	J	0.31	JB	0.63		2.8		6.6		0.059	J
EW-OU2-19-A	-	5/6/2026	2.8		0.61		<0.25	U	3.8		2.4		3.1		0.40	
EW-OU2-20-A	-	5/6/2026	1.4		0.24	J	<0.25	U	2.6		0.86		0.74		0.18	
MW-BW-13-A	6	5/12/2026	2.4		0.15	J	0.35	JB	0.36	J	1.6		3.3		<0.10	U
MW-BW-50-A	5	5/13/2026	1.5		<0.25	U	1.3		<0.25	U	6.2		1.0		<0.10	U
MW-BW-71-A	4	5/13/2026	1.4		<0.25	U	1.1		<0.25	U	0.37	J	0.34	J	<0.10	U
MW-OU2-01-A	4	5/12/2026	<0.25	U	<0.25	U	0.15	JB	<0.25	U	0.28	J	0.89		<0.10	U
MW-OU2-02-A	4	5/11/2026	1.0		0.20	J	<0.25	U	3.7		2.3		3.6		1.9	
MW-OU2-03-A	4	5/11/2026	<0.25	U	<0.25	U	<0.25	U	<0.25	U	<0.25	U	<0.25	U	<0.10	U
MW-OU2-04-A	4	5/11/2026	<0.25	U	<0.25	U	<0.25	U	<0.25	U	0.29	J	0.36	J	<0.10	U
MW-OU2-05-AR	6	5/12/2026	5.3		0.19	J	0.40	JB	0.50		<0.25	U	0.67		0.08	J
MW-OU2-06-AR	6	5/12/2026	<0.25	U	<0.25	U	0.17	JB	<0.25	U	0.30	J	0.60		<0.10	U
MW-OU2-07-A	5	5/12/2026	3.8		0.48	J	0.40	JB	1.4		1.3		1.2		0.096	J
MW-OU2-08-A	6	5/12/2026	26.0		2.6		1.5		10.2		8.7		9.0		0.13	
MW-OU2-12-A	4	5/12/2026	8.7		0.93		1.4		3.9		3.3		9.2		<0.10	U

Notes:

- *Preliminary data
- Results in micrograms per liter by EPA Method 8260-SIM
- B: lab calibration outside of range
- J: estimated detection below the limit of quantitation with a high (+) or low (-) bias
- U: not detected above the limit of detection shown
- <: not detected above the limit of detection shown
- Gray box with bold text is above the ACL

Analytes:

- 11DCA: 1,1-dichloroethane
- 12DCA: 1,2-dichloroethane
- cis12DCE: cis-1,2-dichloroethane
- PCE: tetrachloroethene
- TCE: trichloroethene
- TCM: trichloromethane (chloroform)
- VC: vinyl chloride

 Increase in concentration above the ACL compared to previous quarter

Table 3. Second Quarter 2026 OU2 A-Aquifer*

Well ID	Station	Sampled	11DCA		12DCA		TCM		cis12DCE		PCE		TCE		VC	
ACL:			5		0.5		2		6		3		5		0.1	
MW-OU2-25-A	5	5/12/2026	<0.25	U	0.31	J	<0.25	U	0.76		0.28	J	0.39	J	<0.10	U
MW-OU2-27-A	3	5/12/2026	0.17	J	<0.25	U	0.28	JB	<0.25	U	2.5		<0.25	U	<0.10	U
MW-OU2-28-A	3	5/12/2026	<0.25	U	<0.25	U	0.20	JB	<0.25	U	1.0		0.14	J	<0.10	U
MW-OU2-30-A	2	5/13/2026	<0.25	U	<0.25	U	1.5		<0.25	U	<0.25	U	<0.25	U	<0.10	U
MW-OU2-40-A	3	5/11/2026	0.34	J	0.13	J	0.88	B	2.7		0.45	J	13.0		<0.10	U
MW-OU2-44-A	6	5/11/2026	1.4		0.27	J	0.19	JB	0.75		1.7		2.8		<0.10	U
MW-OU2-45-A	3	5/12/2026	<0.25	U	<0.25	U	0.18	JB	<0.25	U	0.55		0.24	J	<0.10	U
MW-OU2-46-A	6	5/12/2026	1.0		<0.25	U	0.68	B	<0.25	U	3.3		0.64		<0.10	U
MW-OU2-57-A	3	5/12/2026	<0.25	U	<0.25	U	<0.25	U	<0.25	U	<0.25	U	<0.25	U	<0.10	U
MW-OU2-73-A	6	5/11/2026	1.2		0.17	J	<0.25	U	2.1		1.5		0.27	J	0.97	
MW-OU2-74-A	5	5/11/2026	<0.25	U	0.68		<0.25	U	0.49	J	0.55		0.40	J	<0.10	U
MW-OU2-75-A	3	5/13/2026	5.1		0.13	J	3.4		0.30	J	5.3		4.6		<0.10	U
MW-OU2-76-A	6	5/12/2026	0.33	J	<0.25	U	0.11	JB	<0.25	U	<0.25	U	<0.25	U	<0.10	U
MW-OU2-79-A	6	5/11/2026	<0.25	U	0.14	J	<0.25	U	0.25	J	0.20	J	1.1		<0.10	U
MW-OU2-80-A	5	5/12/2026	0.23	J	<0.25	U	<0.25	U	<0.25	U	1.9		0.21	J	<0.10	U
MW-OU2-81-A	3	5/13/2026	0.31	J	1.9		0.23	J	1.1		2.0		1.9		<0.10	U
MW-OU2-83-A	6	5/13/2026	6.0		0.48	J	0.37	J	4.0		2.2		2.2		<0.10	U

Notes:


- *Preliminary data
- Results in micrograms per liter by EPA Method 8260-SIM
- B: lab calibration outside of range
- J: estimated detection below the limit of quantitation with a high (+) or low (-) bias
- U: not detected above the limit of detection shown
- <: not detected above the limit of detection shown
- Gray box with bold text is above the ACL

Analytes:

- 11DCA: 1,1-dichloroethane
- 12DCA: 1,2-dichloroethane
- cis12DCE: cis-1,2-dichloroethane
- PCE: tetrachloroethene
- TCE: trichloroethene
- TCM: trichloromethane (chloromethane)
- VC: vinyl chloride


 Increase in concentration above ACL compared to previous quarter

2026-2Q


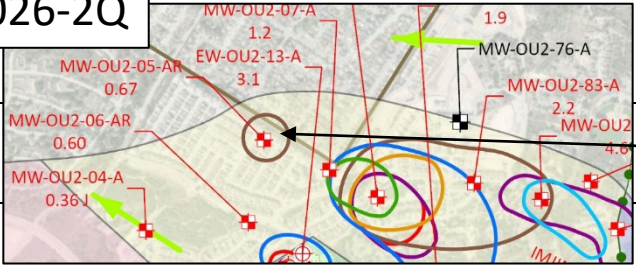


MW-OU2-05-AR


- 1,1-DCA above ACL 2022-2023, 2026-2Q
- VC above ACL 2022-2023, increasing
- All other COCs below ACL/ND since 2023

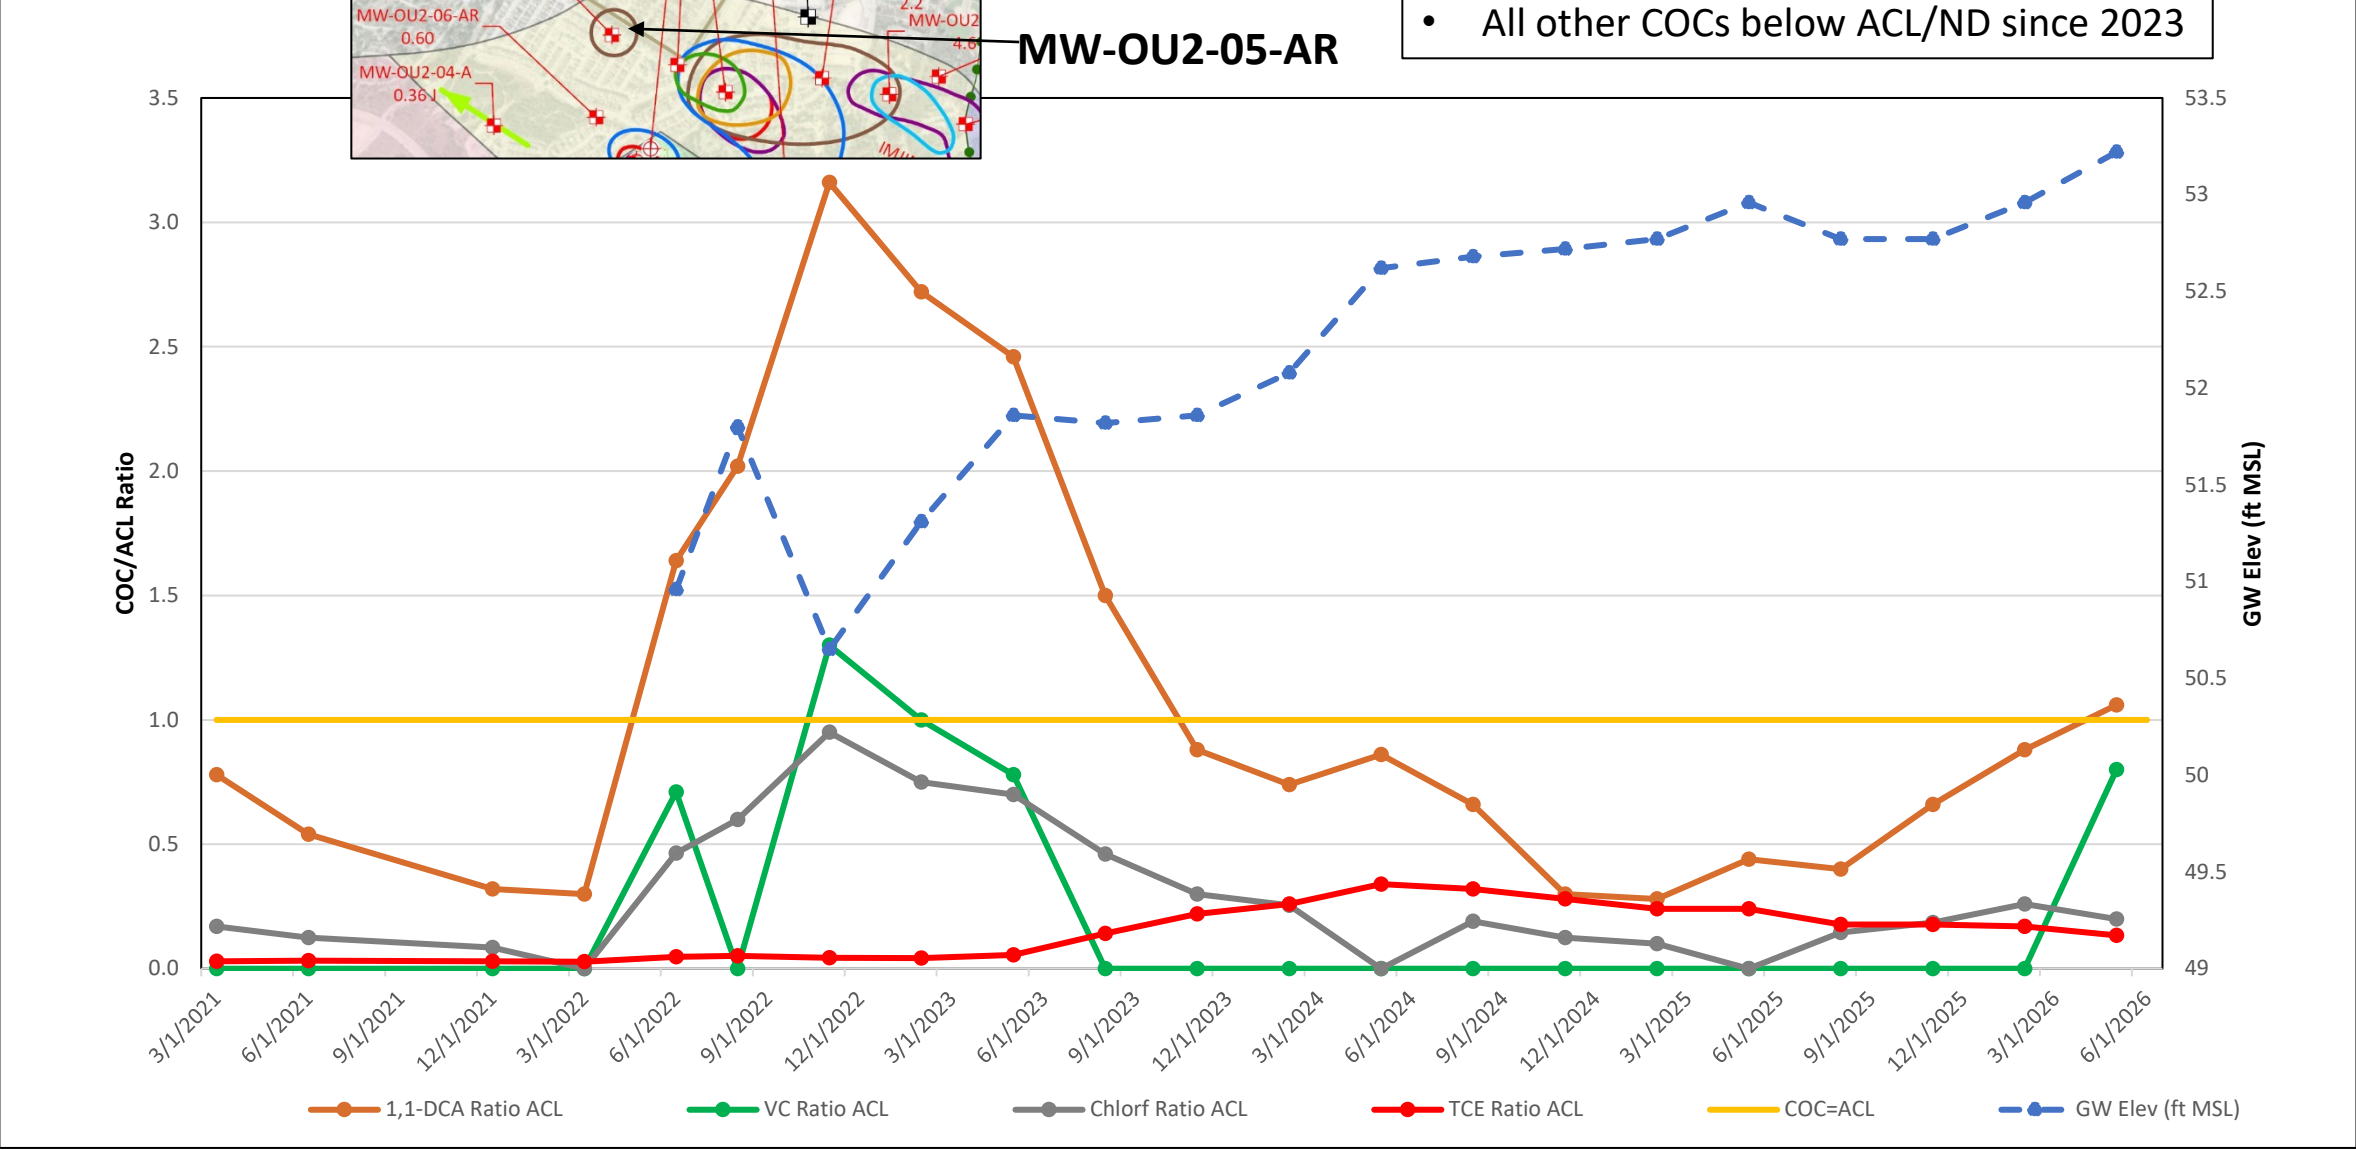


- 1,2-DCA above ACL 2019-2023
- PCE above ACL 2020
- TCE above ACL 2019-2022
- All COCs below ACL/ND since 2023

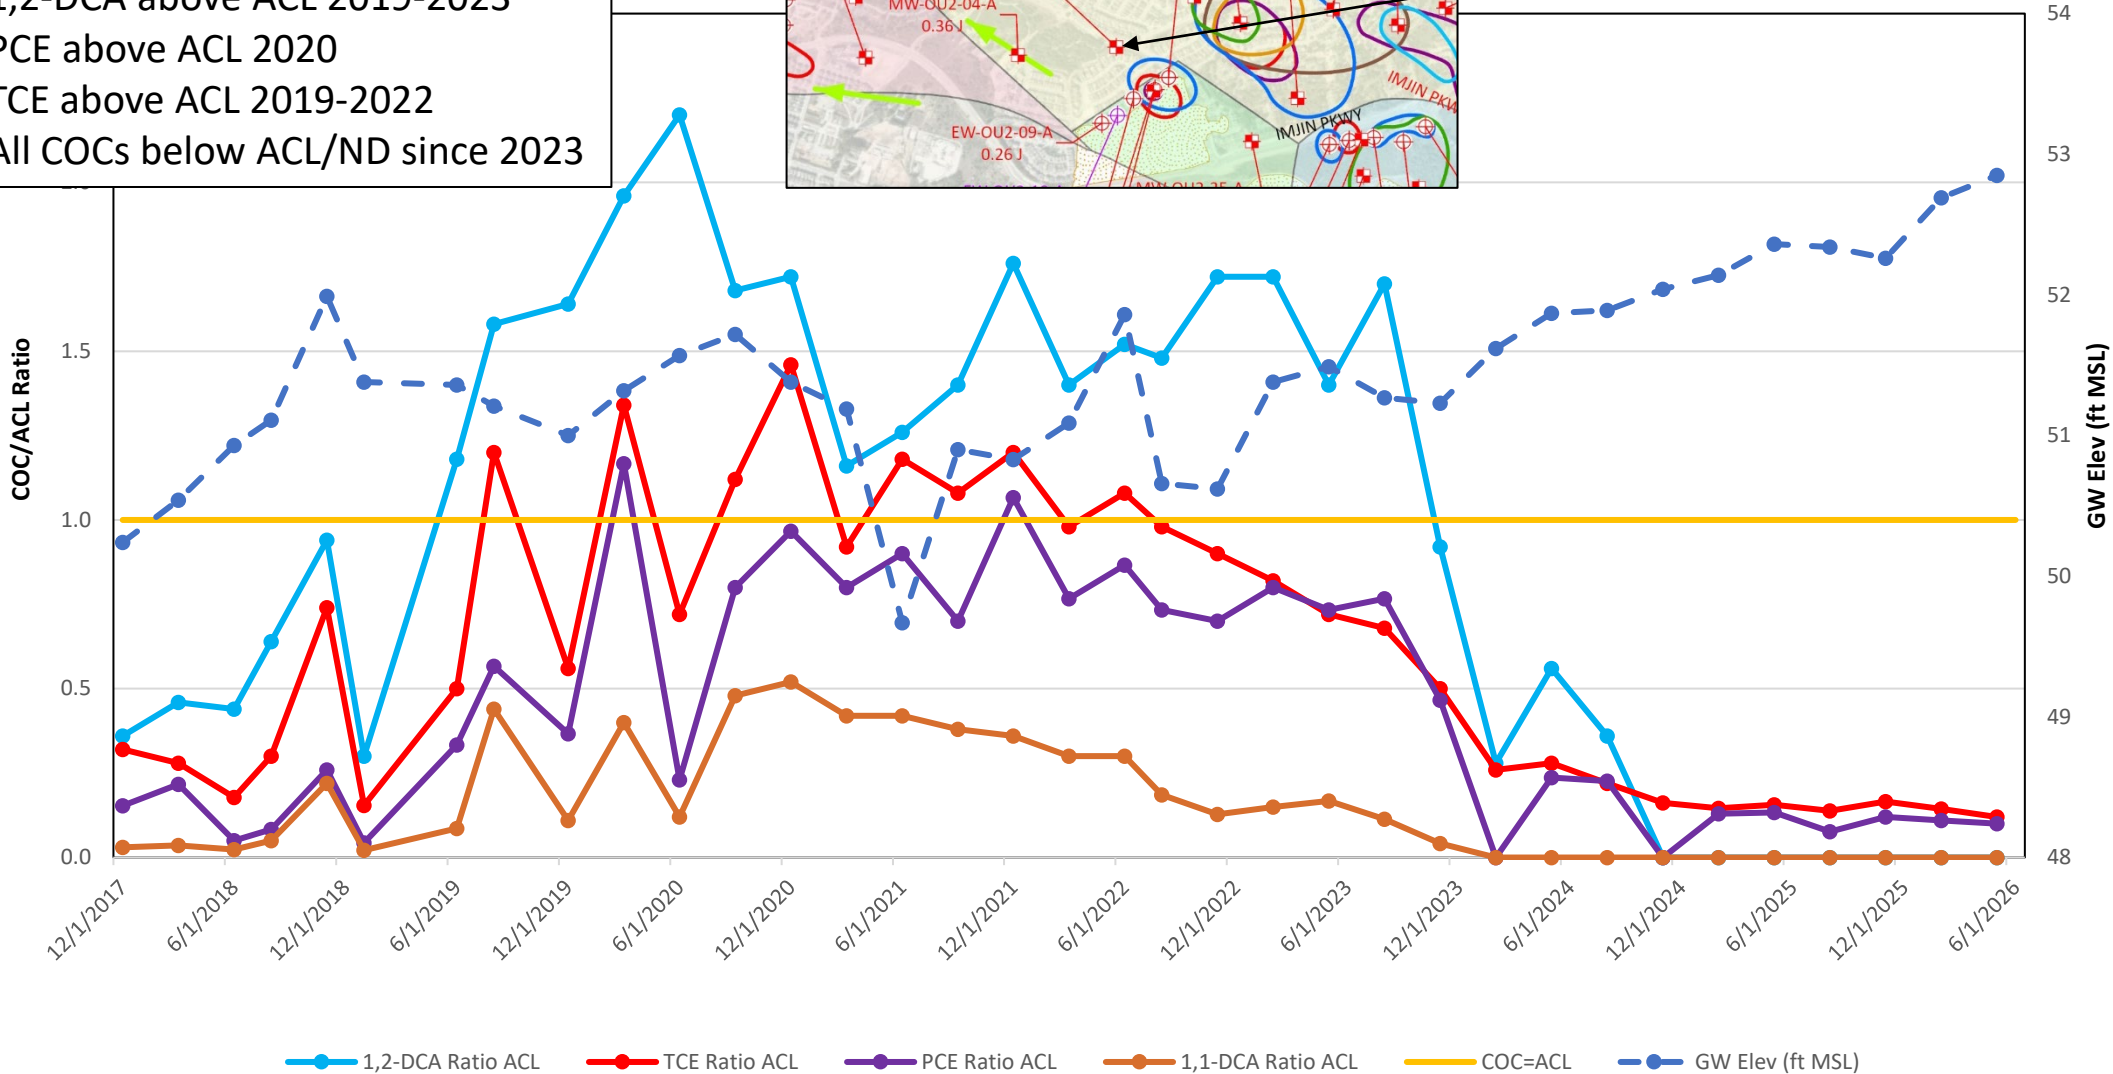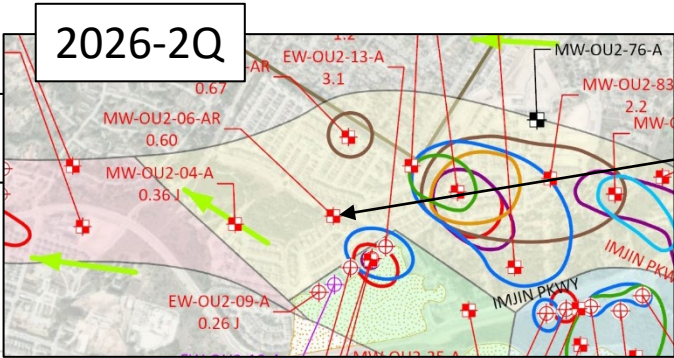


- 1,1-DCA above ACL 2019-2022, 2025-4Q-2026-1Q
- 1,2-DCA above ACL 2021-2022, 2025-4Q-2026-1Q
- Chloroform above ACL 2022
- PCE above ACL 2022
- VC above ACL 2019-2022, 2025-4Q-2026-1Q
- All other COCs below ACLs

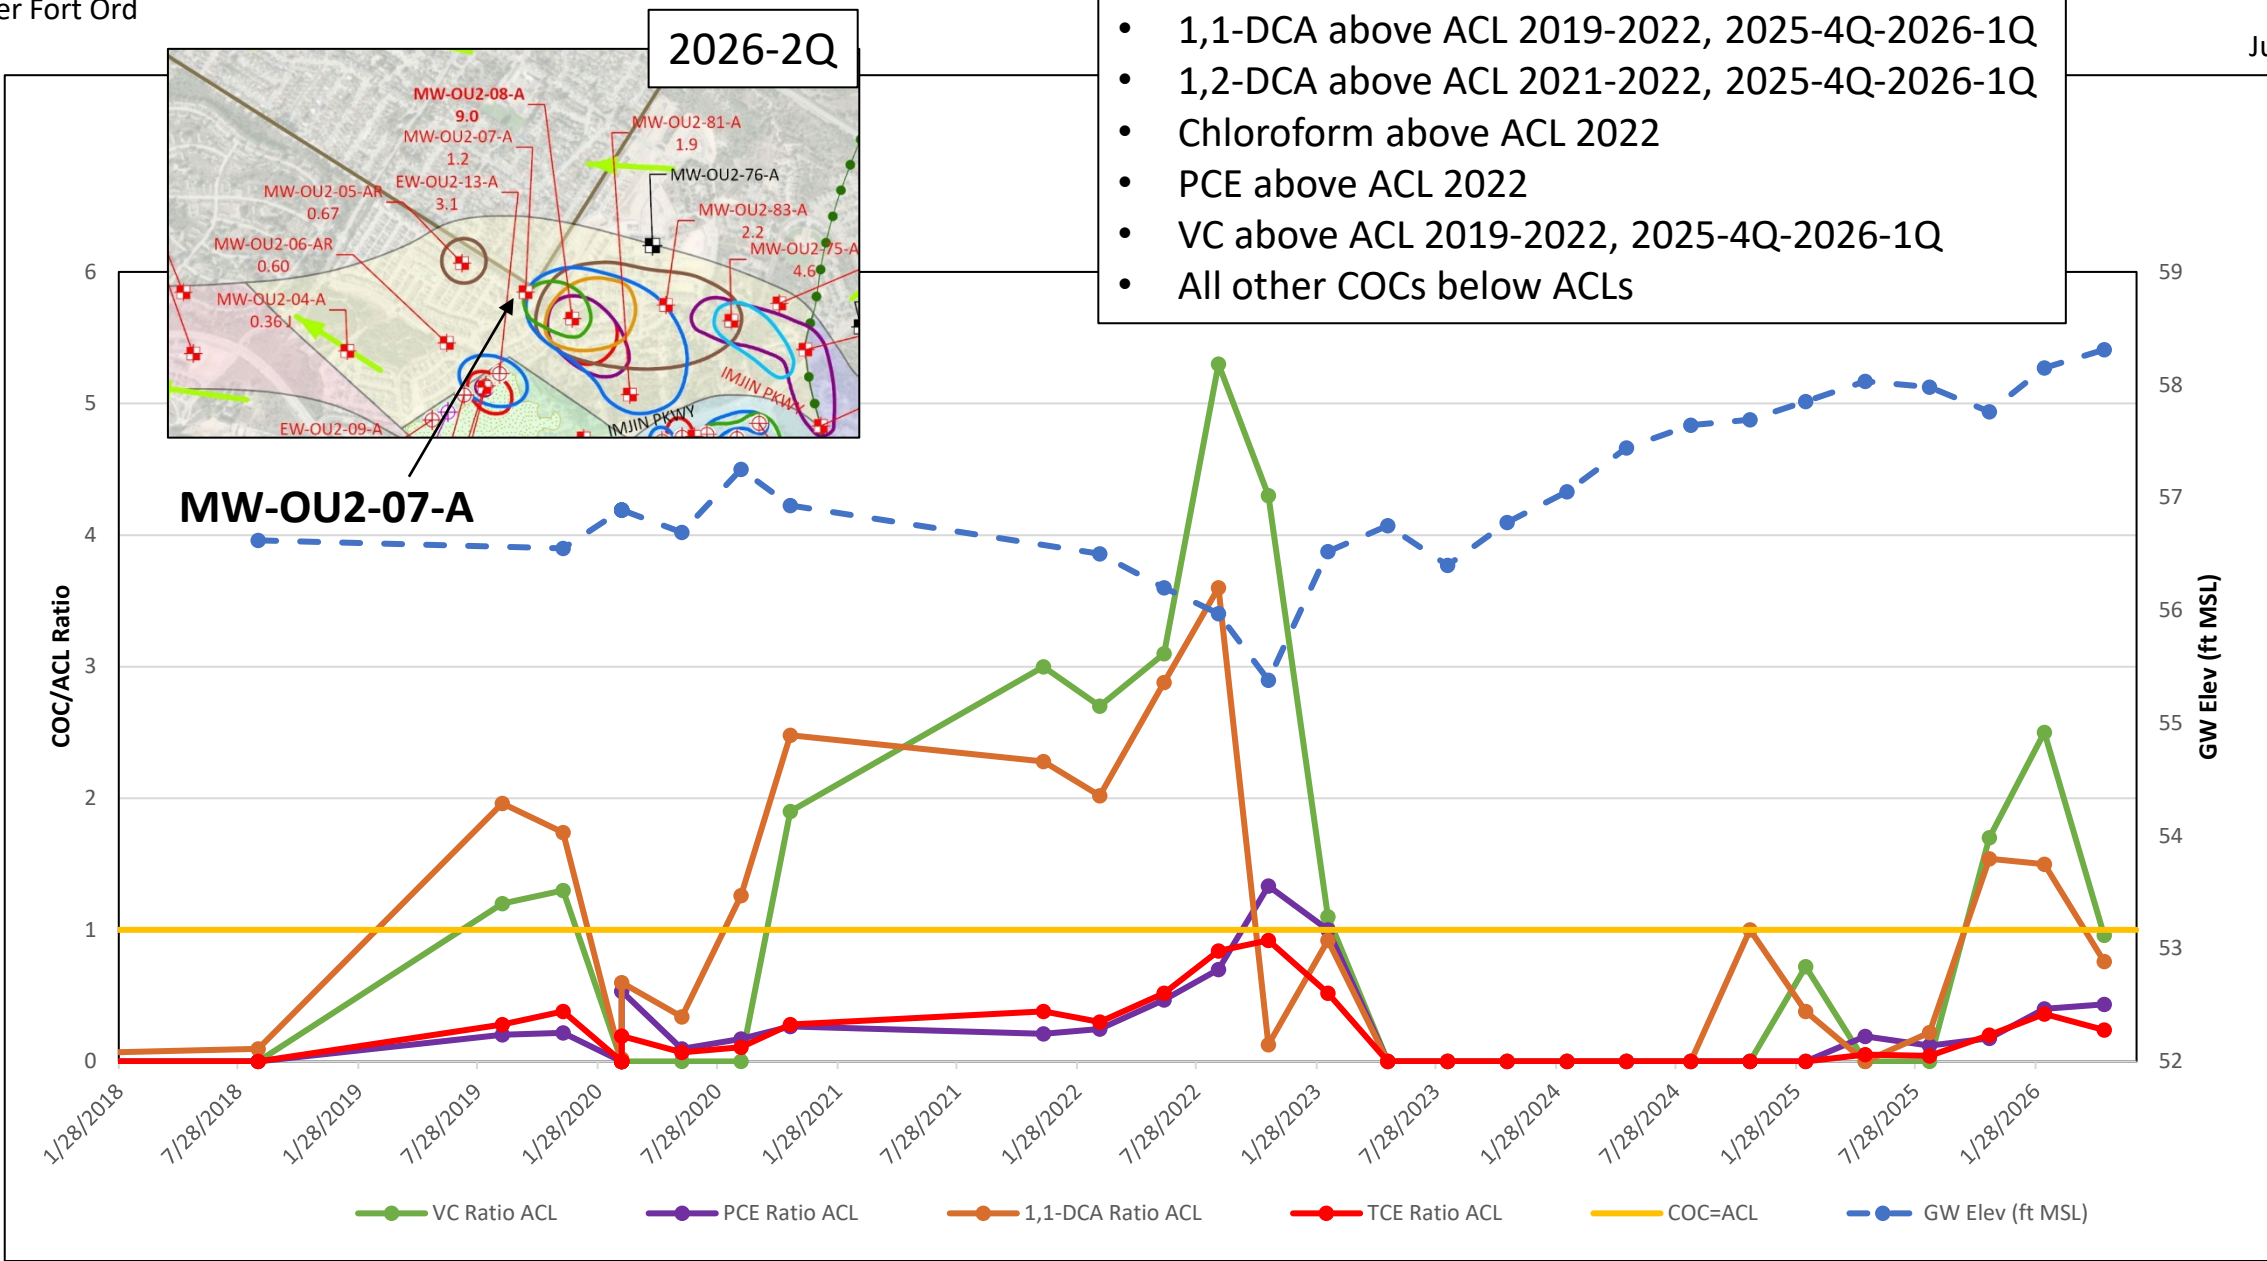

- 1,1-DCA above ACL 2024-present
- 1,2-DCA above ACL 2024-present
- Chloroform above and below ACL 2024-present
- Cis-1,2-DCE above ACL 2024-present
- PCE above ACL 2024-present
- TCE above ACL 2024-present
- VC above ACL 2024-present
- All other COCs below ACL/ND


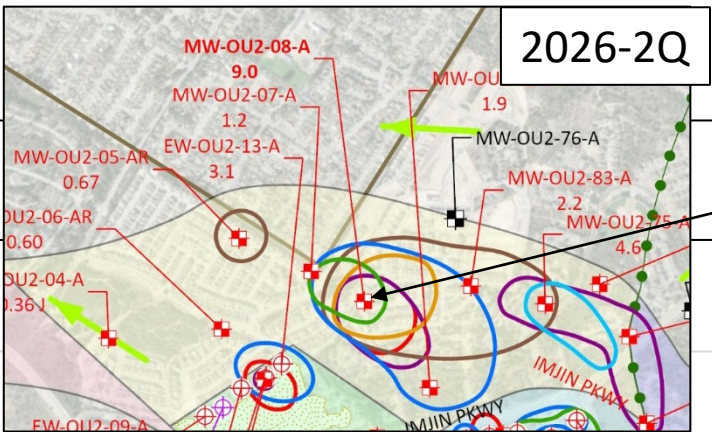


MW-OU2-08-A

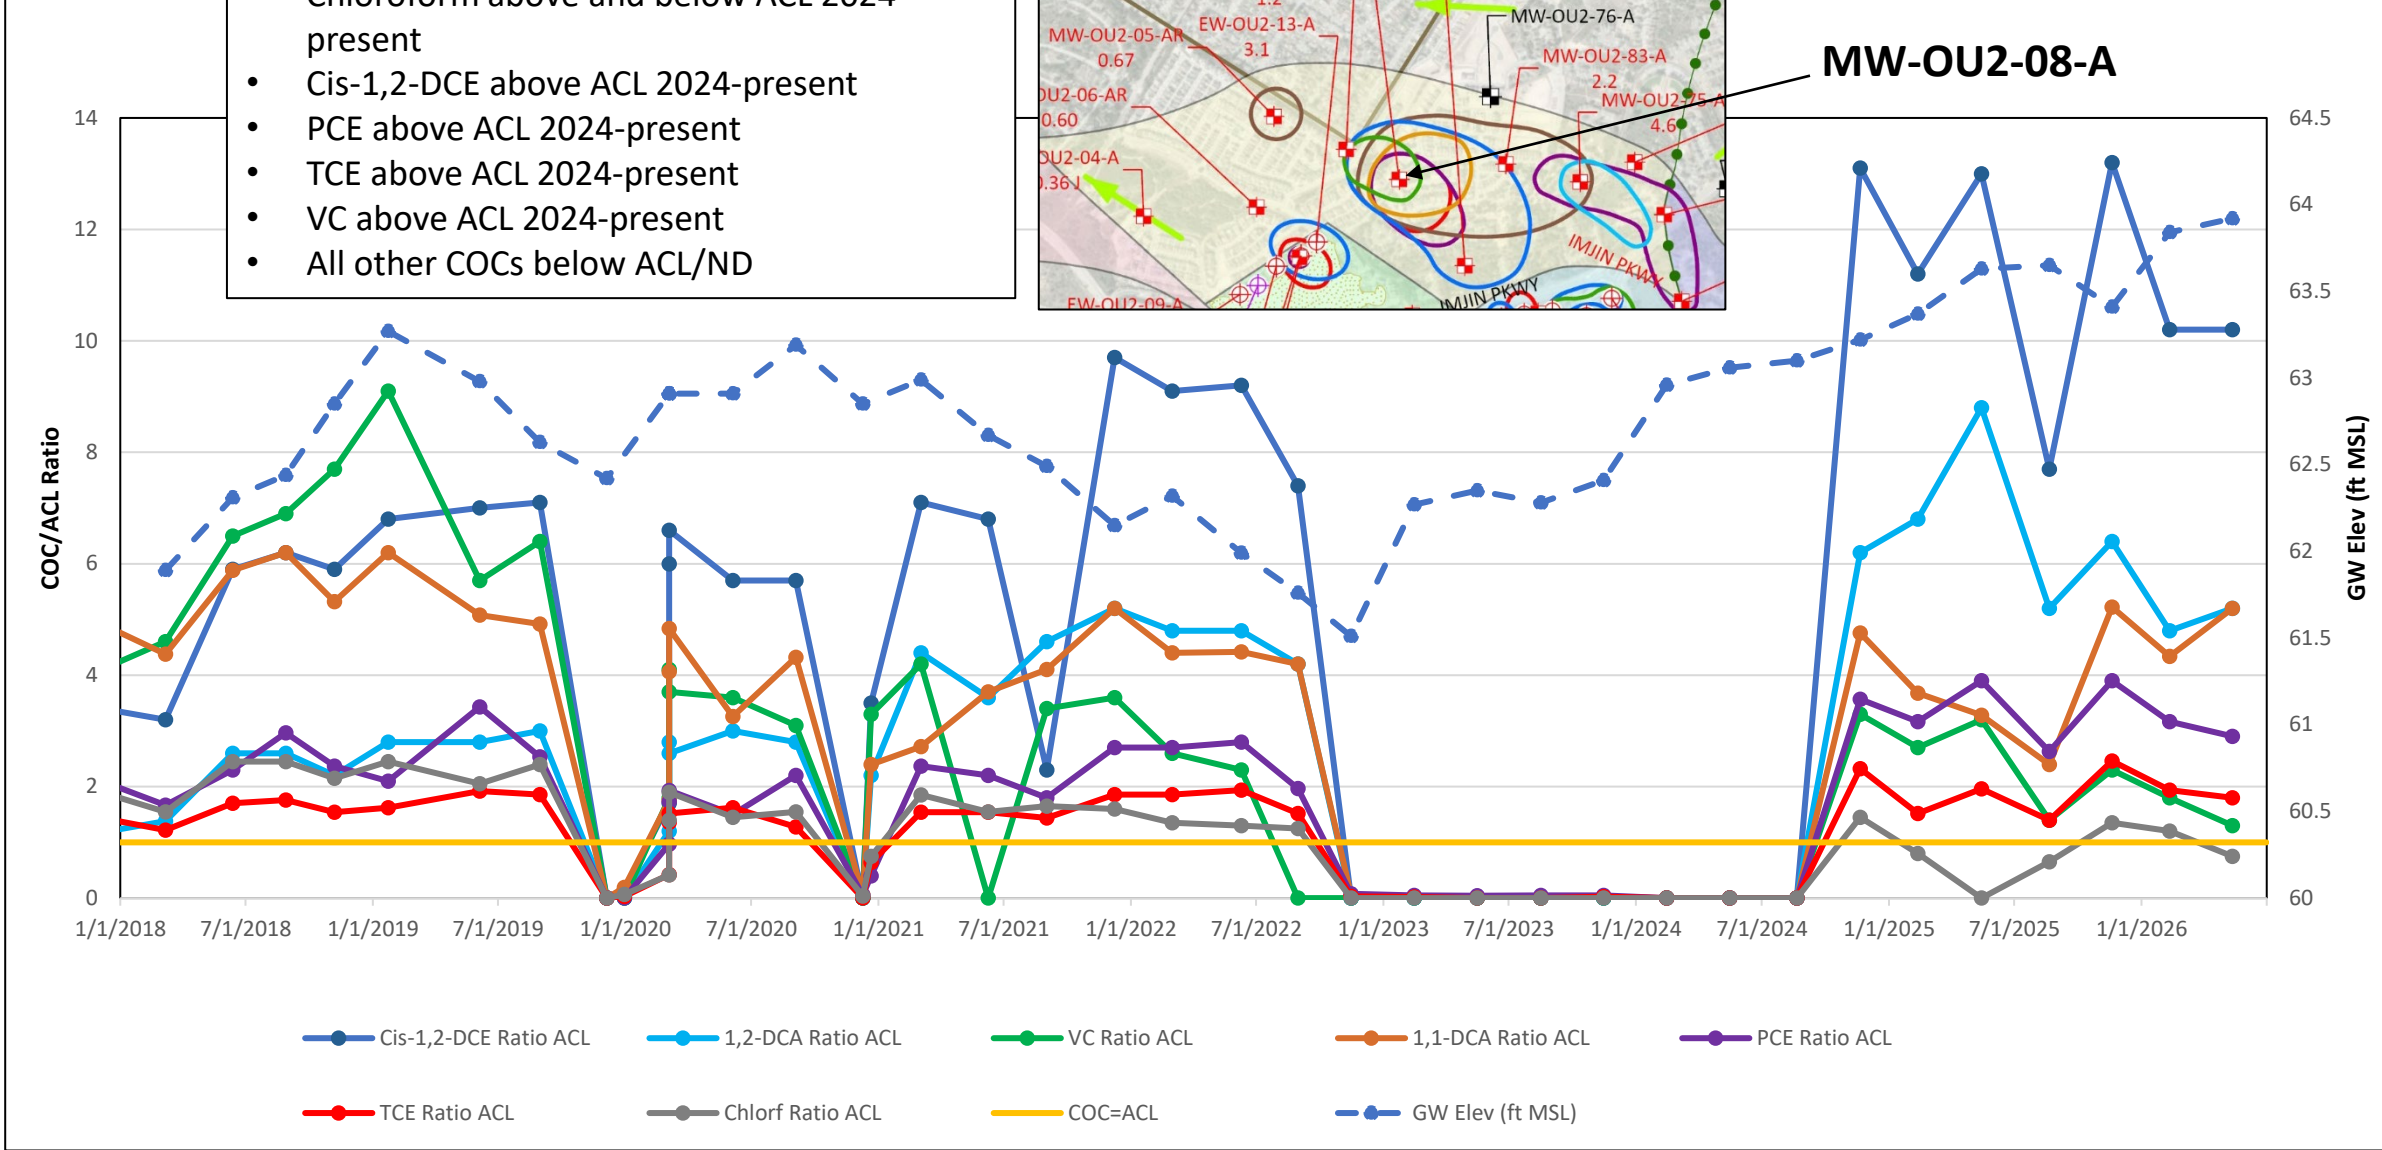

- 1,1-DCA above ACL 2017-2024, 2Q25 and 1Q26
- Chloroform above ACL 2018-present
- PCE above ACL 2017-present
- TCE above ACL 2019-2024, 2Q25
- VC above ACL 2019-2022
- All other COCs below ACL/ND

MW-OU2-75-A

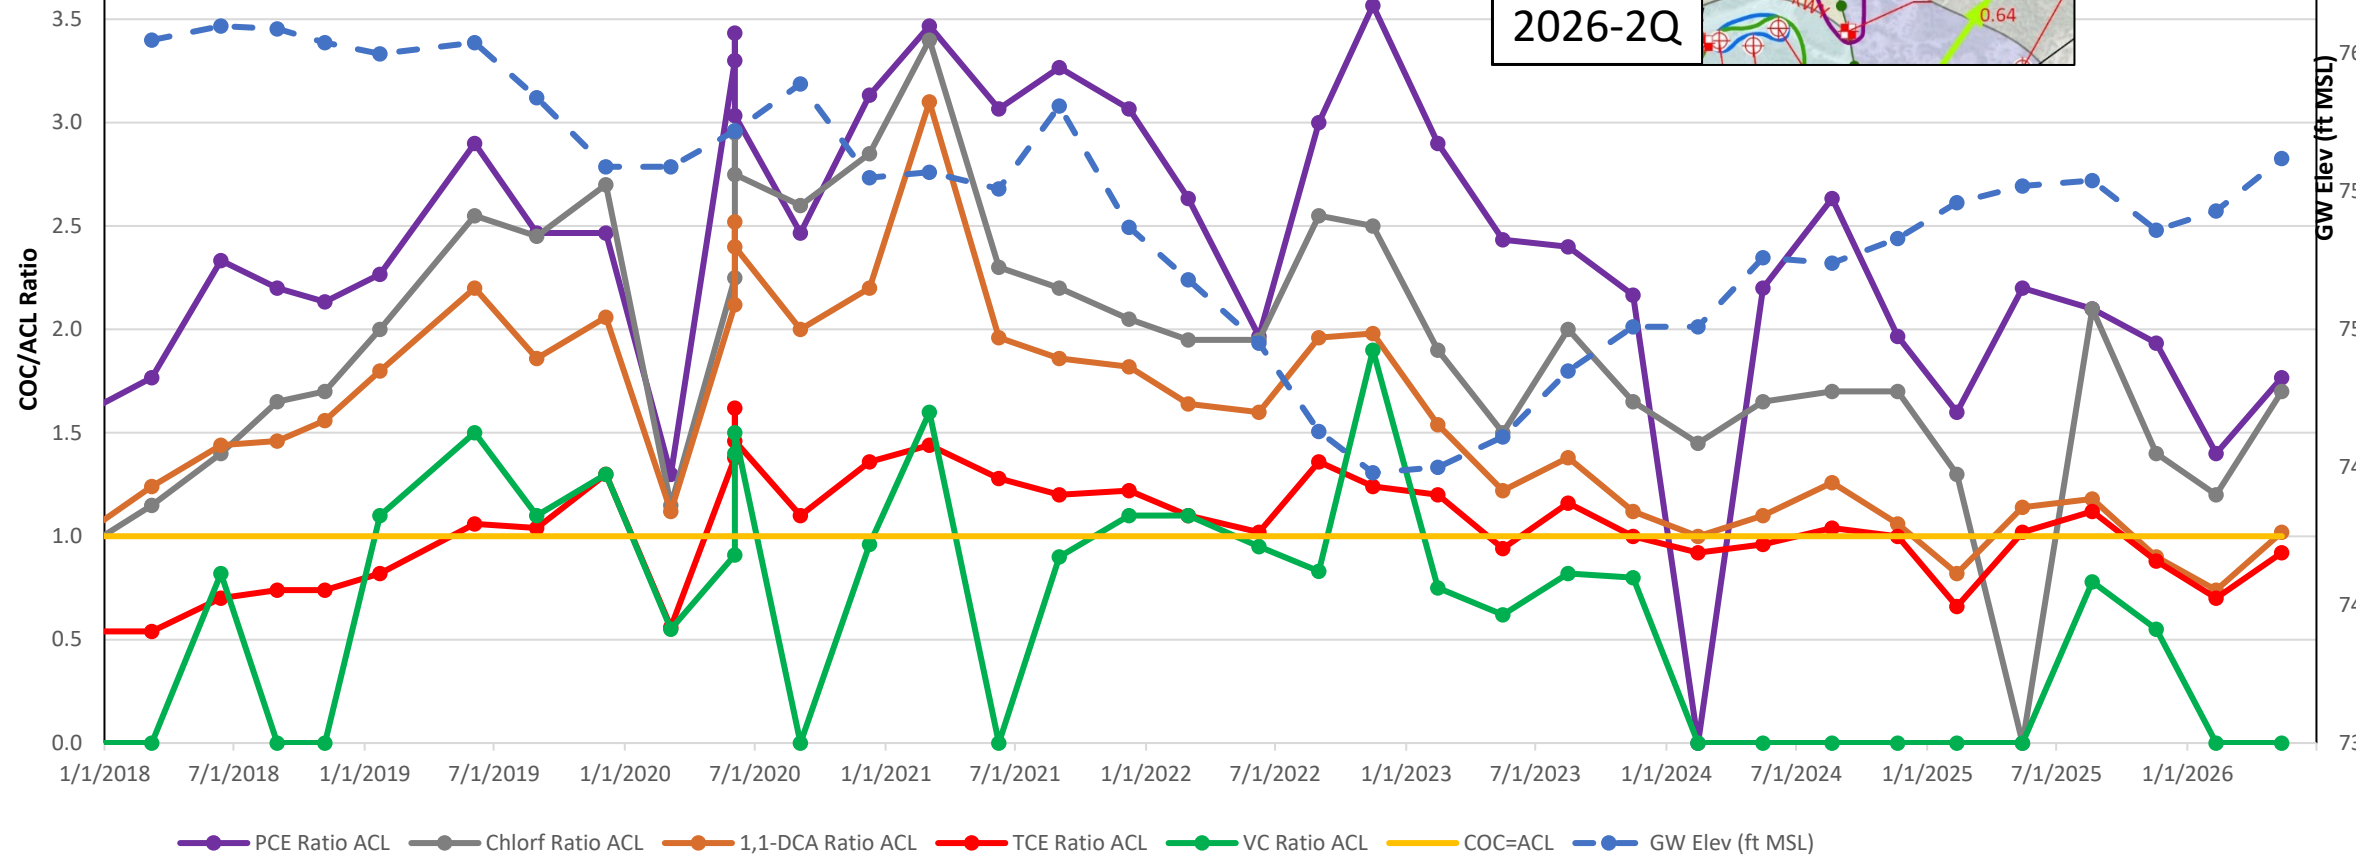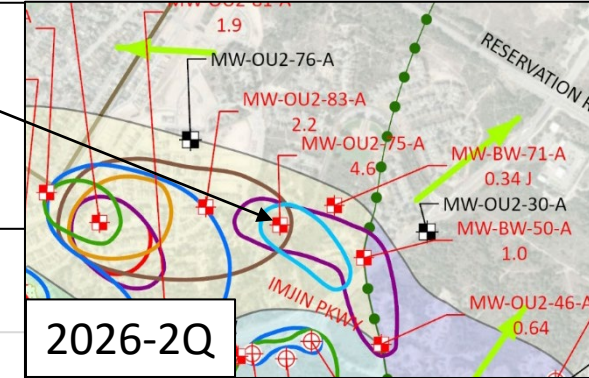


Well ID	Station	Sampled	TCE	
ACL:			5	
EW-OU2-01-180	3	5/12/2026	7.0	
EW-OU2-02-180R	-	5/6/2026	4.2	
EW-OU2-03-180	-	5/6/2026	5.7	
EW-OU2-05-180	-	5/6/2026	1.3	
EW-OU2-06-180	-	5/6/2026	2.4	
EW-OU2-08-180	-	5/6/2026	1.1	
EW-OU2-10-180	-	5/6/2026	5.9	
EW-OU2-12-180	-	5/6/2026	5.8	
EW-OU2-13-180	-	5/6/2026	0.36	J
MW-BW-14-180	1	5/12/2026	3.8	
MW-OU2-06-180R2	3	5/12/2026	0.68	
MW-OU2-20-180	2	5/12/2026	0.41	J
MW-OU2-23-180	4	5/12/2026	8.2	
MW-OU2-24-180	5	5/12/2026	4.5	
MW-OU2-28-180	3	5/12/2026	2.2	
MW-OU2-39-180	4	5/13/2026	0.58	
MW-OU2-43-180	3	5/12/2026	2.0	
MW-OU2-44-180	2	5/11/2026	8.8	
MW-OU2-46-180	5	5/12/2026	2.5	
MW-OU2-47-180	2	5/12/2026	1.5	
MW-OU2-50-180	2	5/11/2026	6.3	
MW-OU2-51-180	5	5/11/2026	0.53	
MW-OU2-53-180	6	5/14/2026	10.1	
MW-OU2-56-180	2	5/11/2026	4.5	
MW-OU2-62-180	3	5/12/2026	1.9	
MW-OU2-81-180	4	5/13/2026	1.0	
MW-OU2-84-180	1	5/12/2026	<0.25	U

Notes:

- *Preliminary data
- Results in micrograms per liter by EPA Method 8260-SIM
- J: estimated detection below the limit of quantitation with a high (+) or low (-) bias
- Gray box with bold text is above the ACL

Increase in concentration above ACL compared to previous quarter

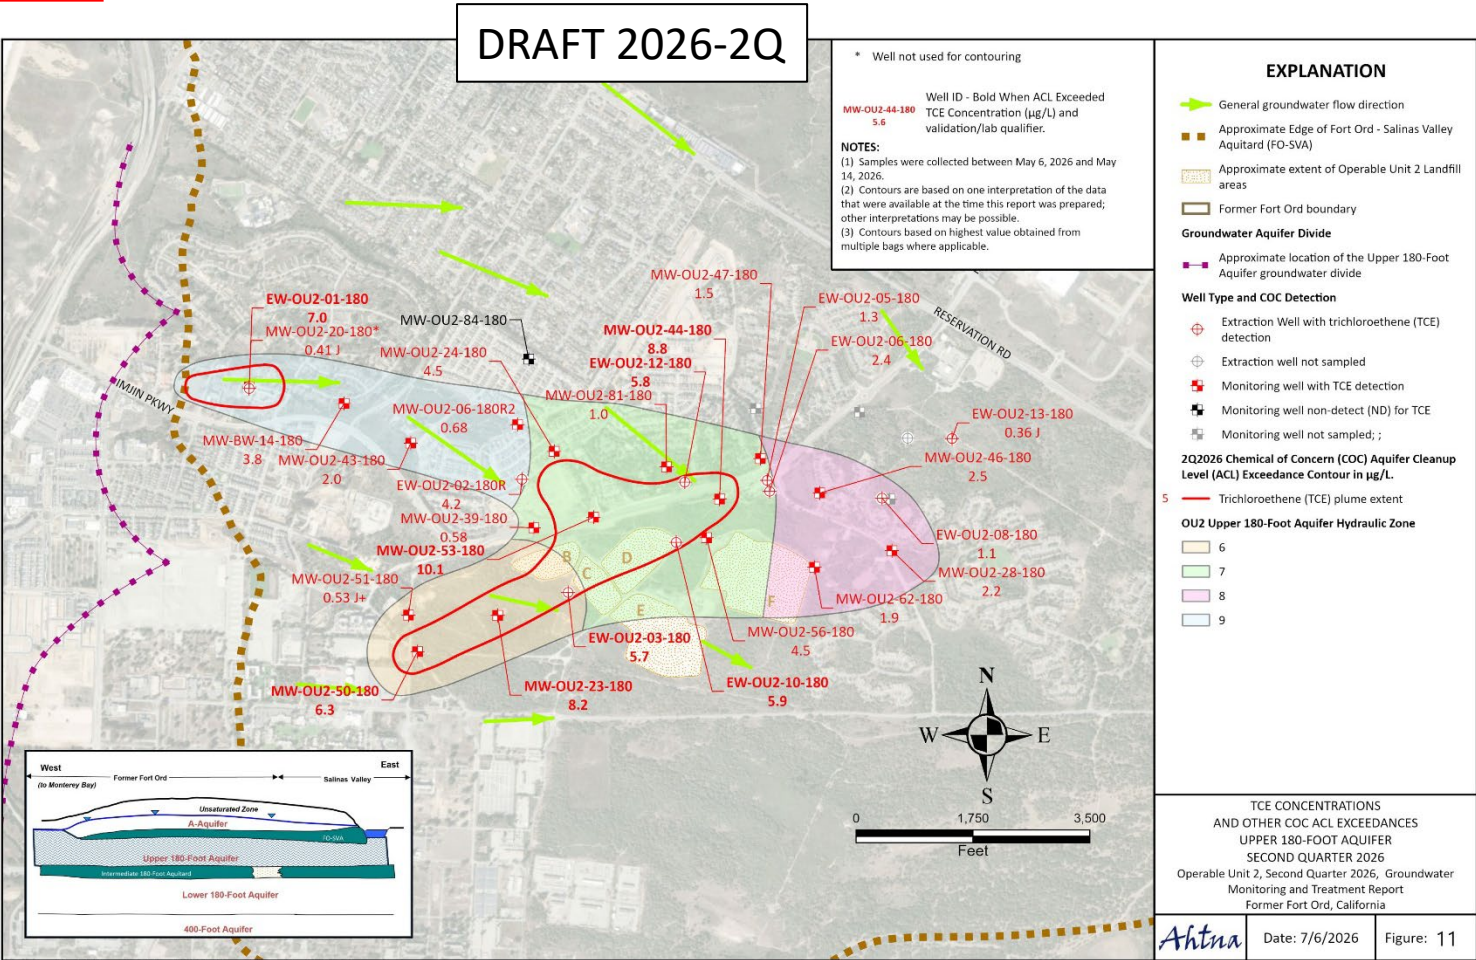

Service Layer Credits: Source: Esri, Maxar, Earthstar Geographics, and the GIS User Community
Imagery Date: March 9, 2025

