

Table 1: April 2026 and May 2026 Sites 2/12 GWTP and SVTU Statistics

Monthly Statistics	Volume Treated	Temporal Average Flow	Percent of Time Online	COC Mass Removed (pounds)
April 2026 GWTP	1,415,880	33 gpm	77 %	0.08
May 2026 GWTP	1,501,200	34 gpm	73 %	0.10
Total since April 1999	2.4 billion gal			501.2
April 2026 SVTU	0	0 scfm	0 %	0
May 2026 SVTU	0	0 scfm	0 %	0
Total since September 2015	1.68 billion scf			11.7

Notes:
gpm: gallon(s) per minute
gal: gallon(s)
COC: chemical of concern
NC: Not calculated
scf: standard cubic foot or feet
scfm: standard cubic feet per minute

April 2026 and May 2026 Sites 2/12 Treated Water at TS-212-INJ did not exceed discharge limits

Remedial Summary

- **8 COCs:** 1,1-DCE; 1,2-DCA; chloroform; cis-1,2-DCE; PCE; total 1,3-DCP; TCE; and VC.
- **Remediation:** Pump and treat with GAC in the unconfined Upper 180-Foot Aquifer since 1999. Extraction wells added in 2007 and 2015.
- **Monitoring:** Quarterly groundwater monitoring and reporting, including annual 3Q monitoring and reports. Described in the most recent Groundwater QAPP.

Recent Key Events

- Jan 14: EW-12-05-180M offline due to pump motor failure
- May 4-15: Second Quarter SGMP sampling event
- May 11-15: Second Quarter GWMP sampling event
- June 23-25 pump replacement at EW-12-05-180M and failed pump removal at EW-12-06-180M

Future Key Events

- Aug 3- Sep 3: Third Quarter (Annual) SGMP event
- Aug 10-14: Third Quarter (Annual) GWMP event



Table 2. Sites 2/12 Groundwater Extraction/Monitoring Well PCE Data

Well Identification ¹	PCE Concentrations (µg/L) ²							
	3Q2024	4Q2024	1Q2025	2Q2025	3Q2025	4Q2025	1Q2026	2Q2026*
ACL:	5.0							
EW-12-03-180M	ND (0.25)	NS	NS	NS	ND (0.25)	NS	NS	NS
EW-12-05-180M	NS	NS	NS	ND (0.25)	ND (0.25)	0.80	NS	NS
EW-12-07-180M	ND (0.25)	ND (0.25)	NS	NS	NS	NS	ND‡ ND‡ ND‡ ND	ND (0.25)
EW-12-08-180U	11.8 14.5 11.9 5.9 ³ 16.1 16.1 8.8 ³ 19.3 9.1 ⁴ ND (0.25)	7.5 ⁵ 16.1 10.4 J ⁴ 1.0 ⁶ 1.1 ⁷	ND (0.25) ⁵ ND (0.25) ⁹ 3.4 2.5 ⁵ 0.48 J ⁷	3.2 ⁵ 7.8 3.2 ⁵ ND (0.25) 3.1 ⁵ 7.8	3.8 ⁵ 8.1 ND (0.25) ⁴ ND (0.25) 5.4 ⁵ 7.7 5.3 ⁵ 13.7	ND (0.25) ⁶ 6.1 3.6 ⁶ 8.7 2.9 ⁵	ND (0.25) ND (0.25) ⁶ 5.4 3.0 ⁶ 8.2	2.5 ⁶ 6.5 4.0 ⁶ 7.9 4.6 ⁶
MW-12-09R-180	0.15 J	ND (0.25)	ND (0.25)	ND (0.25)	0.13 J	0.16 J	0.11 J	0.11 J
MW-12-14-180M	0.37 J	ND (0.25)	0.70	0.56	0.11 J	0.18 J	0.24 J	0.30 J
MW-12-16-180M	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)	ND (0.25)
MW-12-20-180U	39.8	4.8 ND (0.25)	0.55	0.72	0.8	0.49 J	0.36 J	2.7
MW-12-21-180U	0.27 J	ND (0.25)	ND (0.25)	ND (0.25)	0.25 J	0.27 J	0.21 J	0.25 J
MW-12-24-180U	32.1	ND (0.25)	2.4	1.9	3.4	0.33 J	0.52	4.6
MW-12-28-180U	0.39 J	NS	NS	NS	0.37 J	NS	NS	NS
MW-12-30-180U	0.36 J	NS	NS	NS	0.31 J	NS	NS	NS
MW-12-32-180U	0.49 J	NS	NS	NS	ND (0.25)	NS	NS	NS

Notes:

¹ Extraction wells not listed have met the QAPP decision rules to no longer operate.

² Concentration in **bold** and shaded exceeds the Aquifer Cleanup Level (ACL). Concentrations in gray text are ND.

³ Sample was collected following one week online

⁴ Sample was collected following two weeks online

⁵ Sample was collected following three weeks online

⁶ Sample was collected following four weeks online

⁷ Sample was collected following two weeks offline

⁸ Sample was collected following eight weeks offline

⁹ Sample was collected following six weeks online

J: Estimated results below the limit of quantitation (LOQ)

ND: The analyte was not detected at or above the limit of detection (LOD)

NS: No sample (annual well)


COC: chemical of concern

µg/L: micrograms per liter

* Preliminary results


‡ Profile of Stations 1-3

Ahtna

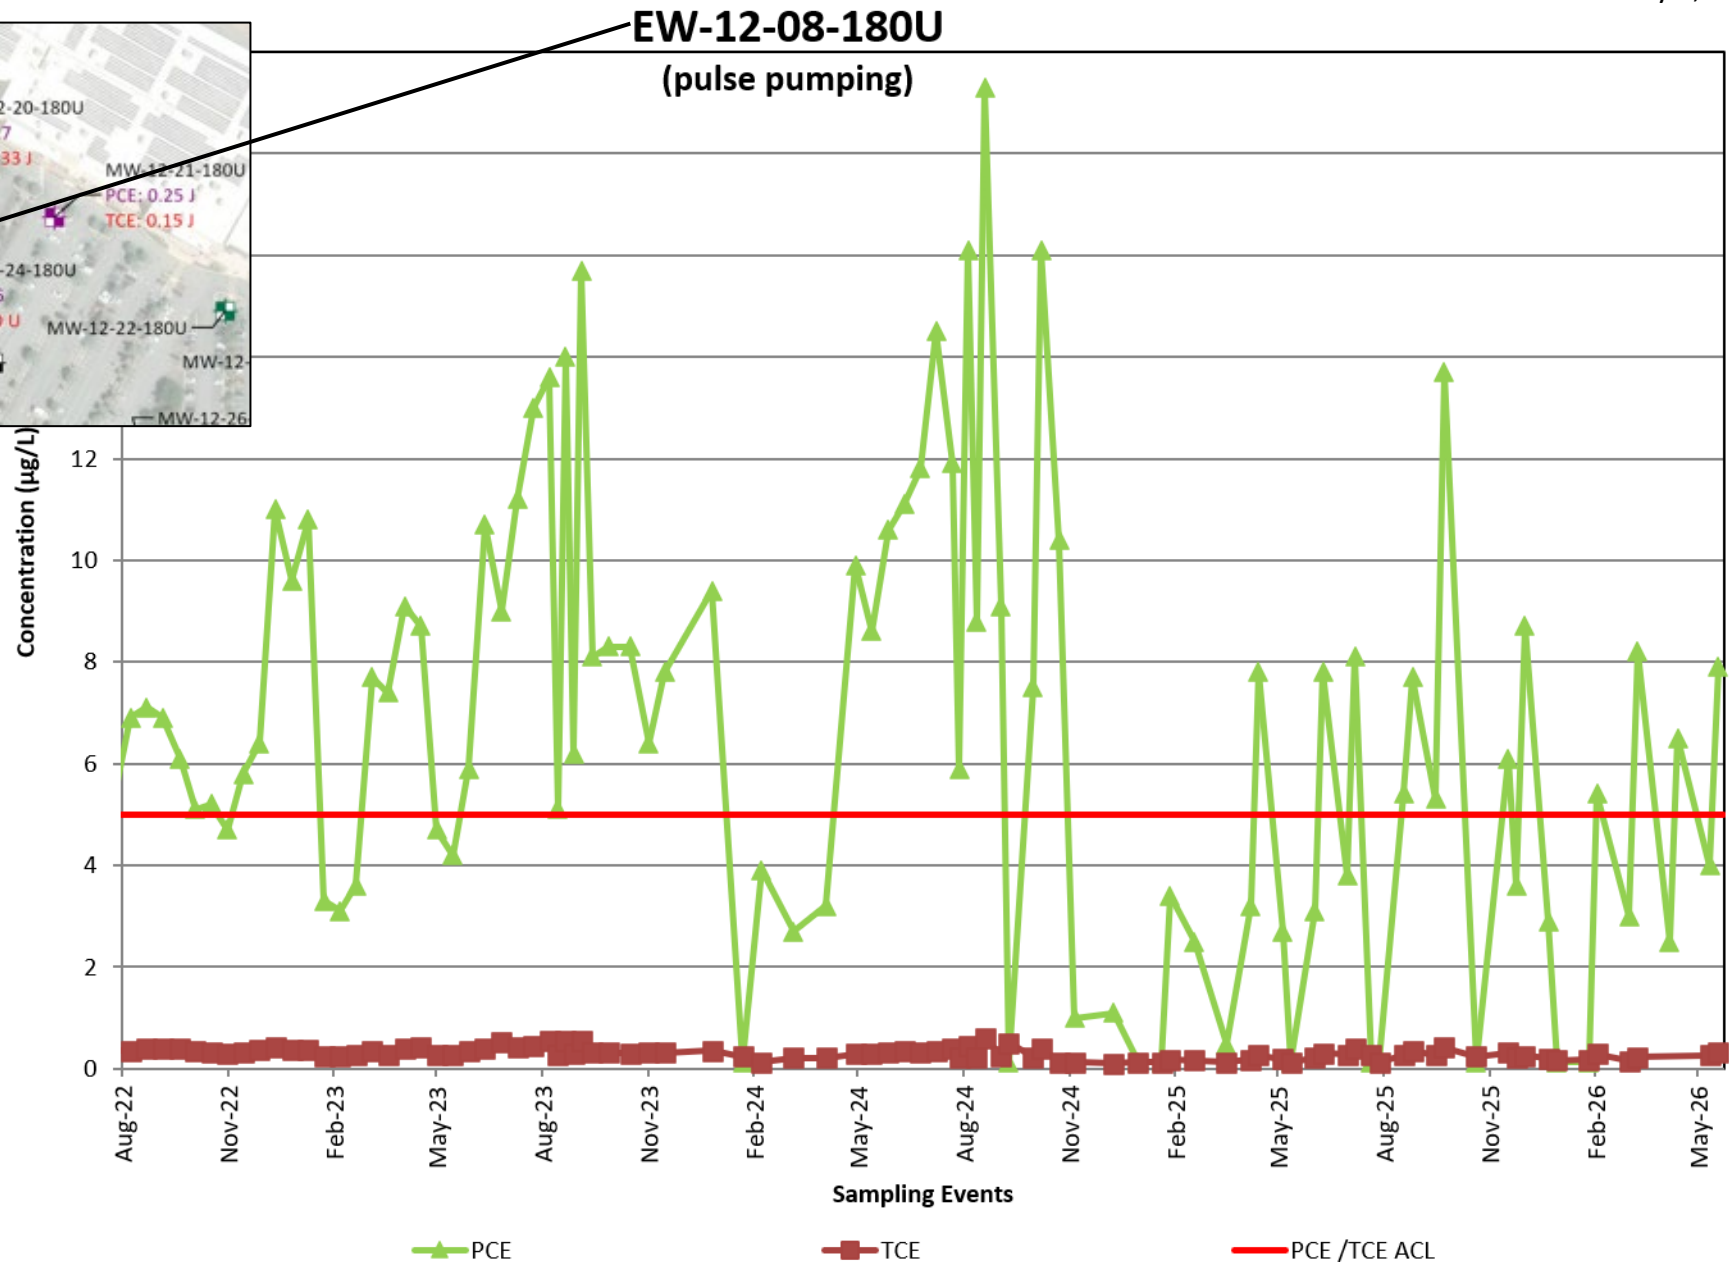



MW-12-20-180U

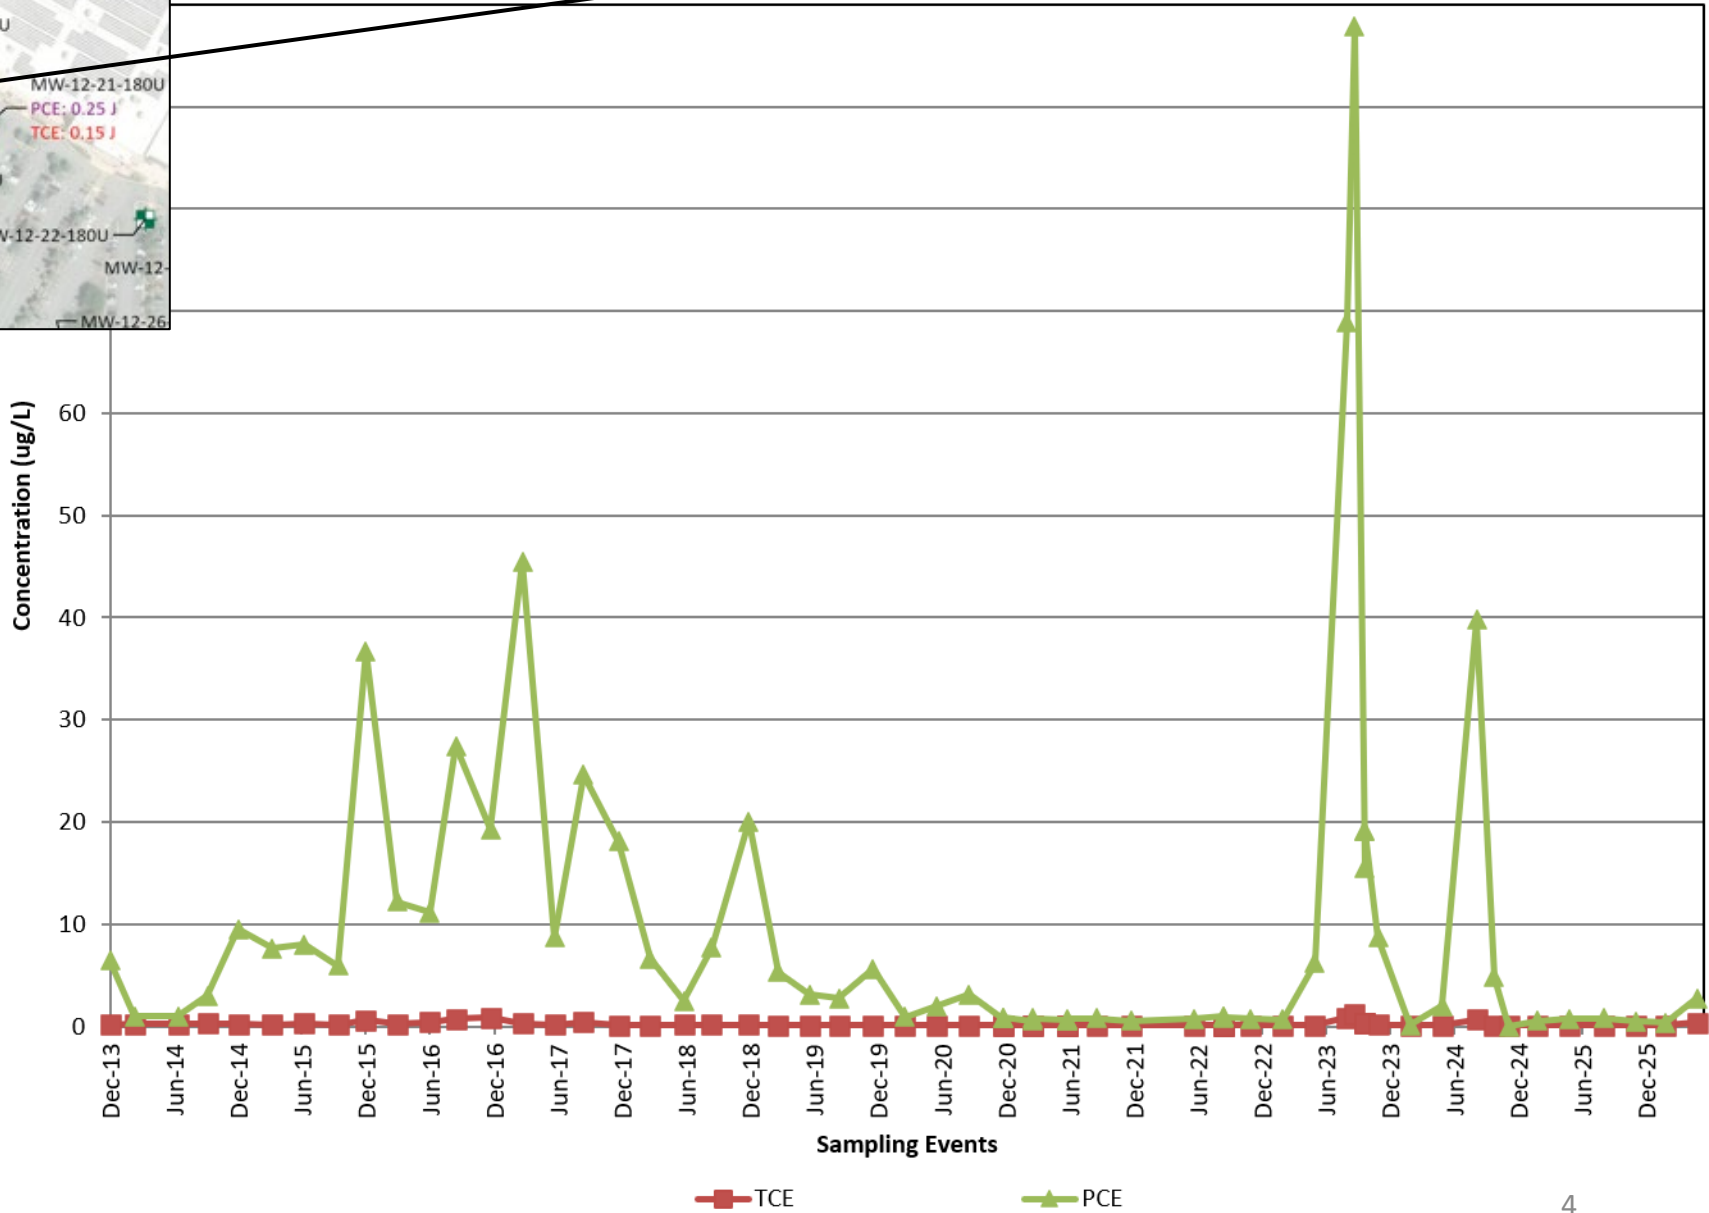




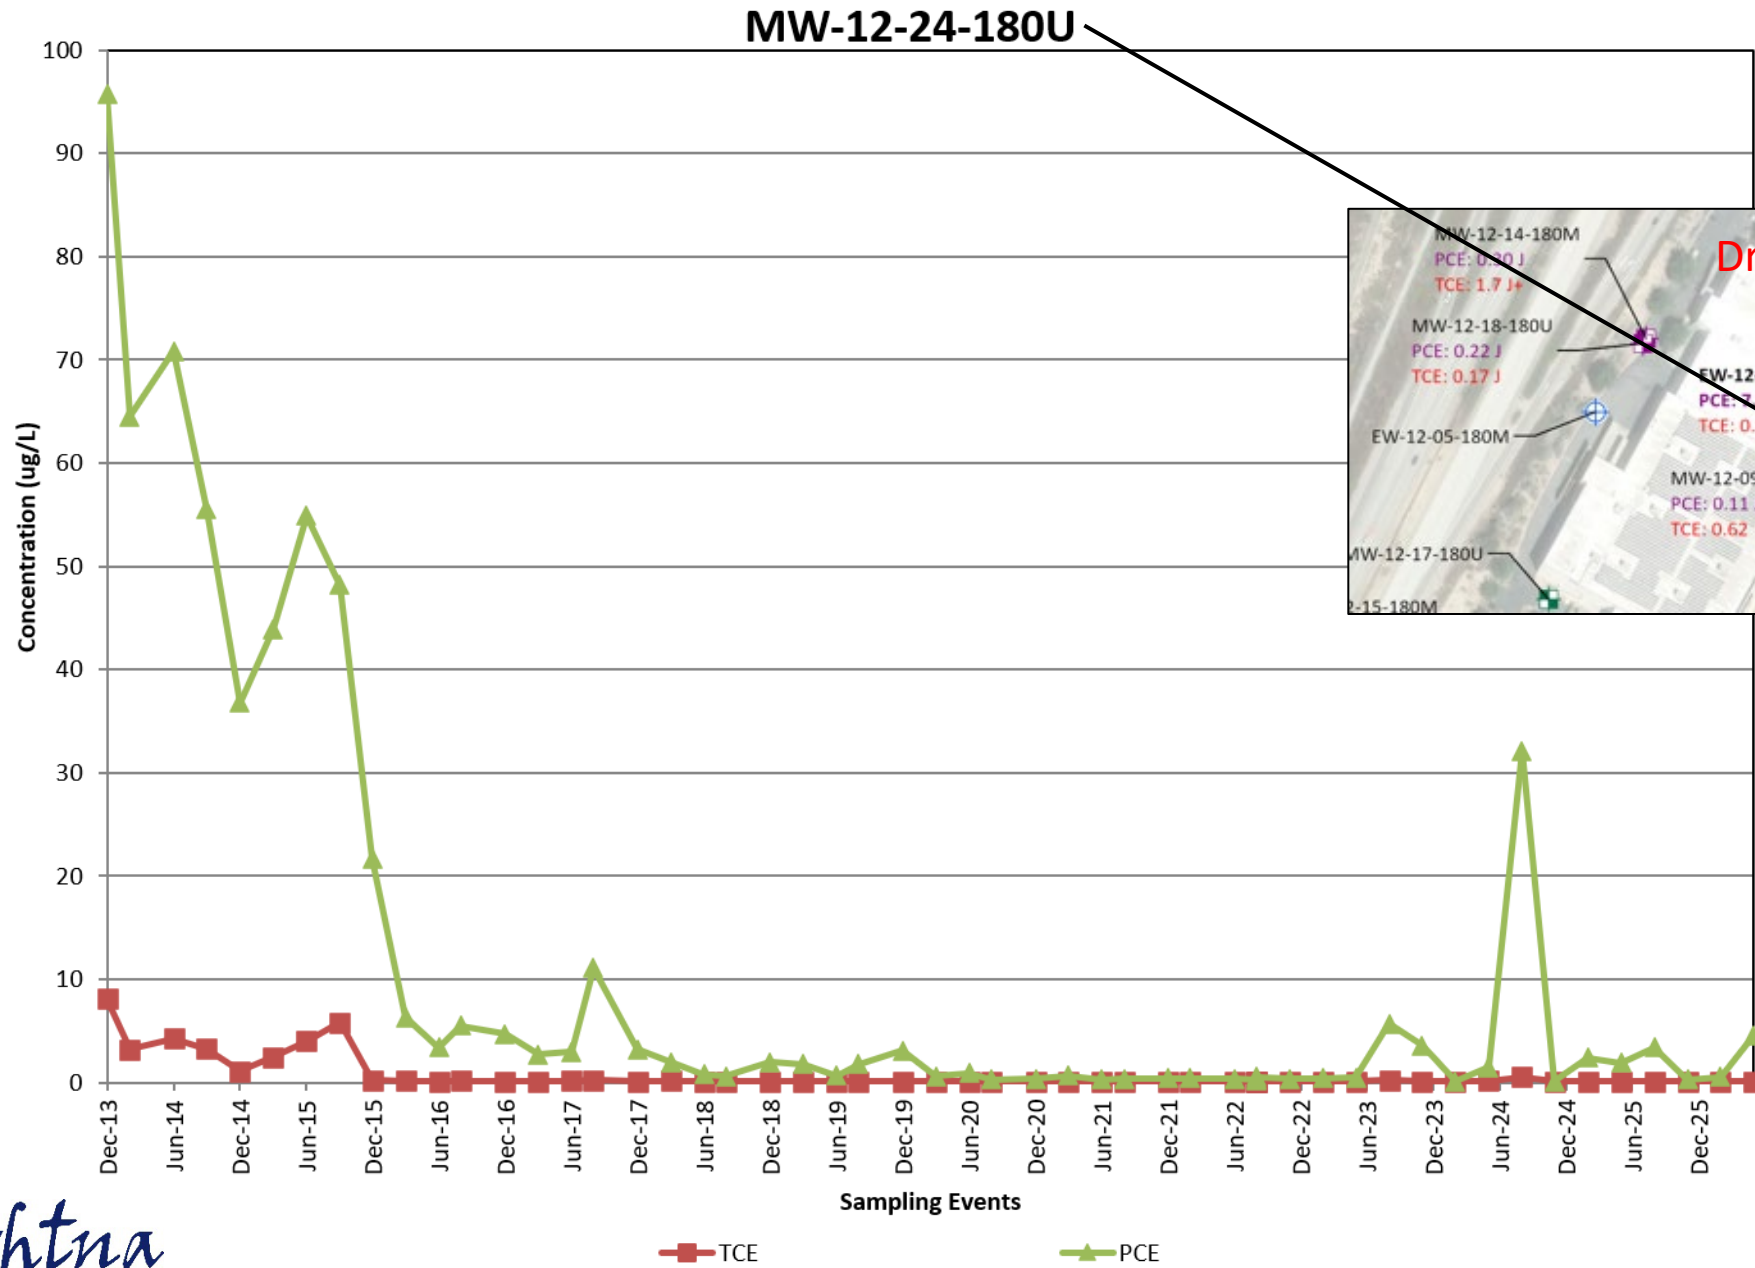


Table 3. Sites 2/12 Monitoring Well TCE Data

Well Identification ¹	Select COC Concentrations (µg/L) ²							
	2Q2024	3Q2024	4Q2024	1Q2025	2Q2025	3Q2025	1Q2026	2Q2026*
	TCE							
ACL:	5.0							
MW-02-13-180M	1.4	1.3	1.5	0.62	1.3	1.4	1.3	1.2
MW-12-14-180M	3.2	2.5	4.1	5.3	4.7	0.66	2.6	1.7

Notes:
Concentration in **bold** and shaded exceeds the Aquifer Cleanup Level (ACL).
COC: chemical of concern
µg/L: micrograms per liter
*Preliminary data

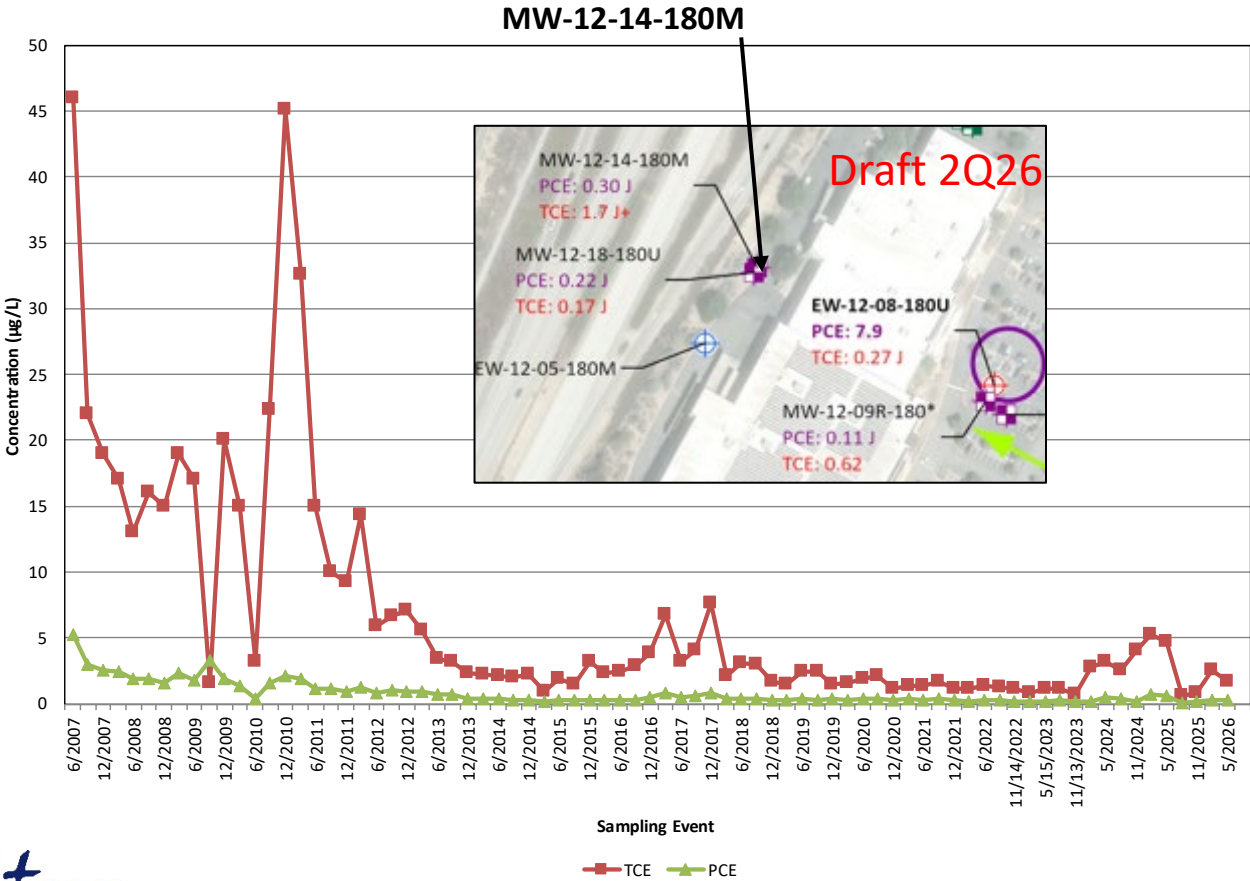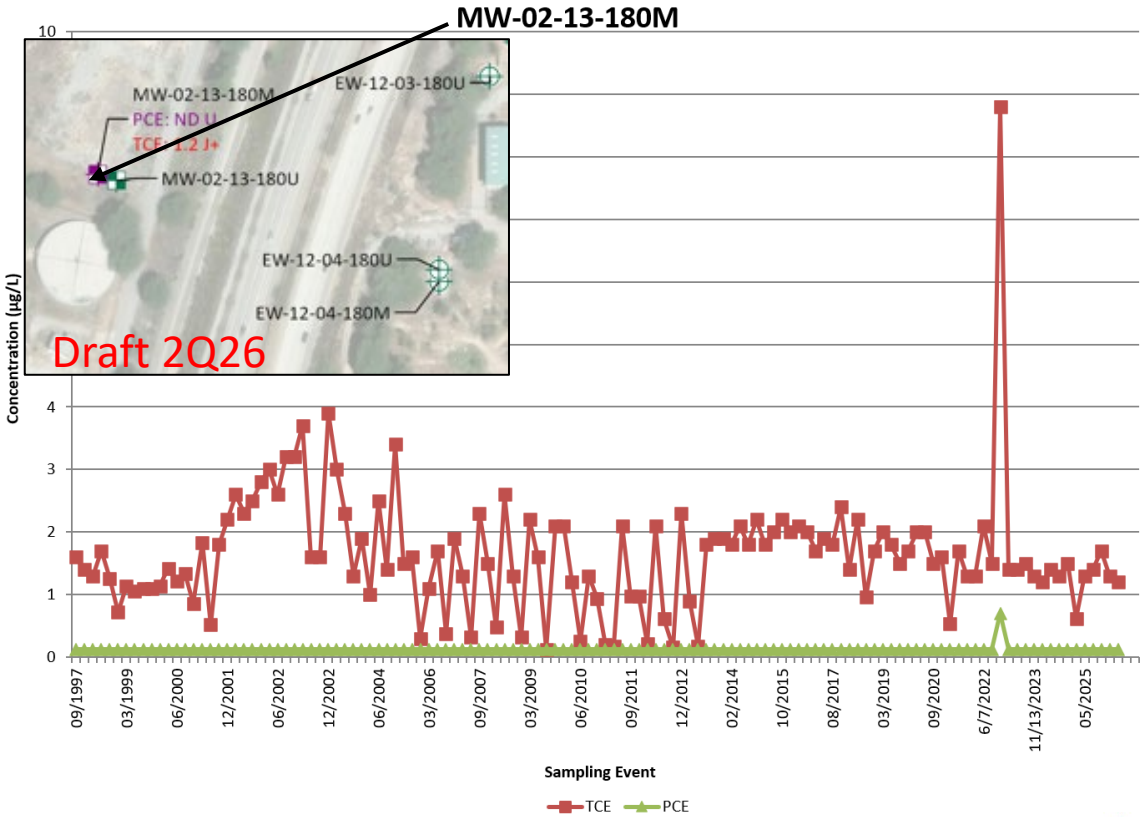

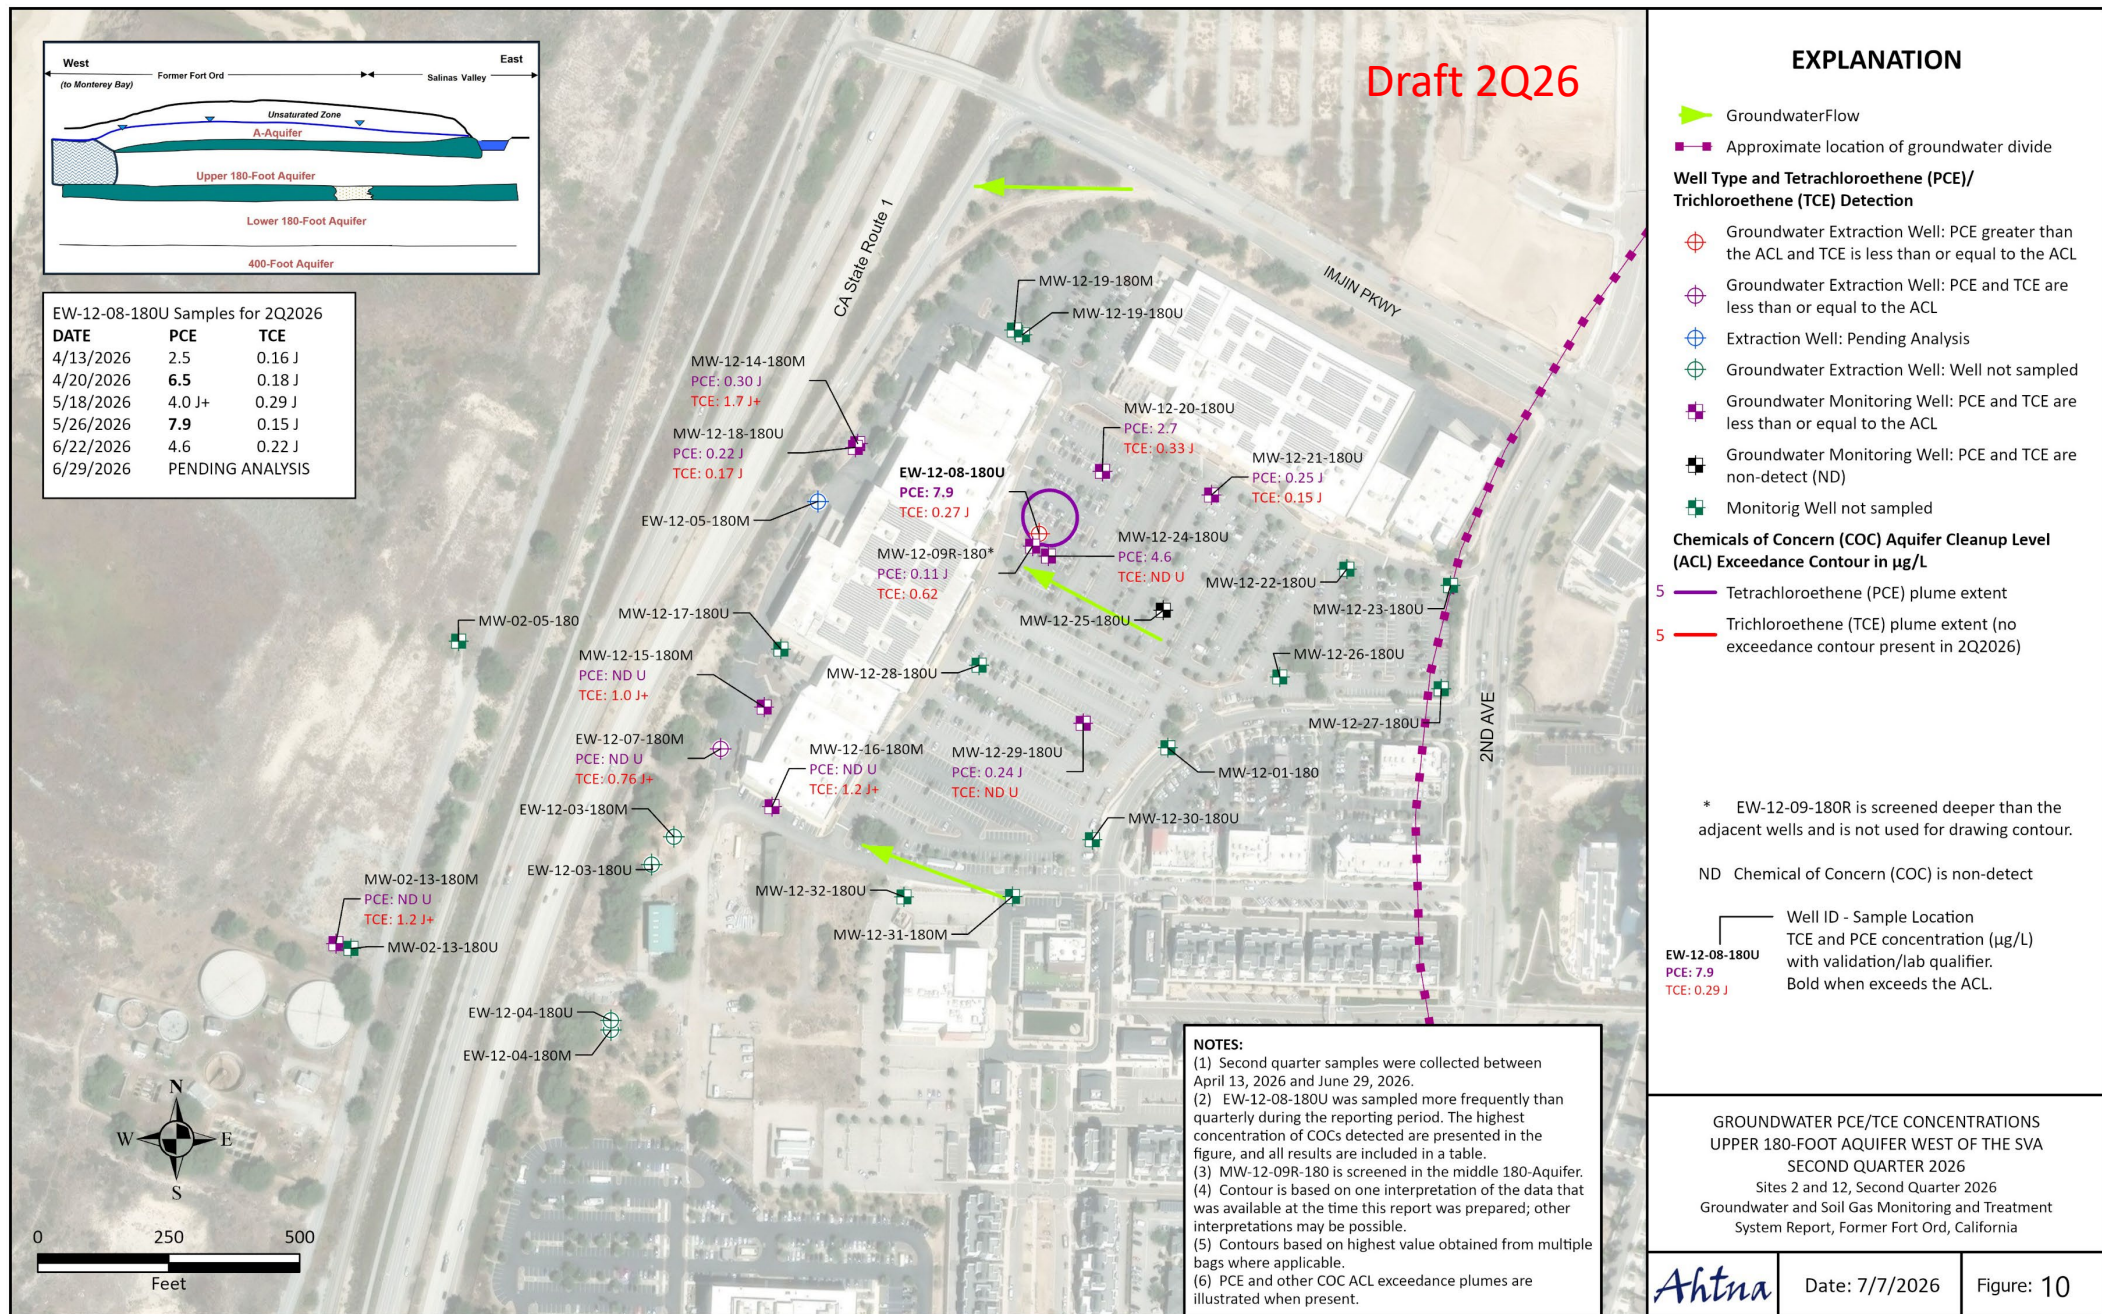

SVETS Operation Summary

- Rebound trends at SG-12-04 indicate TCE trigger level exceedance by 2Q2025.
- SVETS restarted on June 18, 2025
- SVETS shut down September 5, 2025 to assess rebound following 3Q2025 monitoring event.

Table 4. Sites 2/12 SVETS PCE and TCE Monitoring Results

SVETS ID	PCE								TCE							
	3Q24	4Q24	1Q25	2Q25	3Q25	4Q25	1Q26	2Q26	3Q24	4Q24	1Q25	2Q25	3Q25	4Q25	1Q26	2Q26
VE-12-02	ND	NS	NS	NS	NS	NS	NS	NS	ND	NS	NS	NS	NS	NS	NS	NS
VE-12-06	ND	NS	NS	84	ND	NS	NS	NS	ND	NS	NS	ND	ND	NS	NS	NS
VE-12-07	NS	NS	NS	69 J	ND	NS	NS	NS	NS	NS	NS	ND	ND	NS	NS	NS
VE-12-08	ND	NS	NS	85	ND	NS	NS	NS	ND	NS	NS	ND	ND	NS	NS	NS
VE-12-09	82	NS	NS	140	56 J	NS	NS	NS	ND	NS	NS	ND	ND	NS	NS	NS
SVTU-INF	33	NS	NS	75	44	NS	NS	NS	8.6	NS	NS	4.7	6.4	NS	NS	NS
SVTU-EFF	11	NS	NS	11	24	NS	NS	NS	8.5	NS	NS	5.5	6.9	NS	NS	NS

Notes:

*Preliminary results

J = estimated result below the limit of quantitation (LOQ)

ND = not detected above the limit of detection (LOD)

NS = not sampled

Concentrations in **bold** exceed the SGCL

Concentrations in *italics* exceed the SG-SL

Results reported in micrograms per cubic meter (µg/m³)

COC	SGCL (µg/m³)	SG-SL (µg/m³)
PCE	1,800	<i>603</i>
TCE	1,000	<i>888</i>

Table 5. Sites 2/12 Soil Gas PCE and TCE Monitoring Results

Soil Gas Probe ID	Schedule	3Q24	4Q24	1Q25	2Q25	3Q25	4Q25	1Q26	2Q26*	3Q24	4Q24	1Q25	2Q25	3Q25	4Q25	1Q26	2Q26*	Last Exceedance			
		PCE								TCE								PCE		TCE	
		SG-SL	SGCL	SG-SL	SGCL	SG-SL	SGCL	SG-SL	SGCL	SG-SL	SGCL	SG-SL	SGCL	SG-SL	SGCL	SG-SL	SGCL	SG-SL	SGCL	SG-SL	SGCL
SG-12-01-65	Q	260	340	240	390	200	300	260	300	ND	ND	ND	ND	ND	ND	ND	29	2Q15	4Q13	--	--
SG-12-02-10	Q ¹	<i>1,100</i>	<i>990</i>	<i>640</i>	<i>900</i>	<i>1,000</i>	<i>940</i>	<i>640</i>	<i>820</i>	ND	ND	ND	ND	ND	ND	ND	30	2Q26	3Q15	--	--
SG-12-02-20	A	770	NS	NS	NS	800	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	NS	3Q25	4Q13	--	--
SG-12-02-30	A	680	NS	NS	NS	710	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	NS	3Q25	--	--	--
SG-12-02-40	A	660	NS	NS	NS	460 J	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	NS	3Q24	--	--	--
SG-12-02-50	A	690	NS	NS	NS	660	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	NS	3Q25	--	--	--
SG-12-02-57	A	ND	NS	NS	NS	670	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	NS	3Q25	--	--	--
SG-12-02-65	R	NS	NS	NS	NS	540	NS	NS	NS	NS	NS	NS	NS	ND	NS	NS	NS	3Q18	--	--	--
SG-12-04-10	Q ³	ND	93	79	150	ND	53 J	57	77	34 J	180	340	790	ND	98	260	460	2Q15	--	2Q24	2Q24
SG-12-04-20	Q ³	44 J	79	78	140	ND	66 J	62	94	73 J	170	310	830	ND	94	270	520	3Q15	--	2Q24	2Q24
SG-12-04-40	Q ³	ND	95	85	140	ND	65 J	65	93	ND	100	340	820	ND	100	260	540	1Q15	--	2Q24	4Q22
SG-12-04-50	Q ³	ND	80	69	140	ND	76	73	90	43 J	140	290	640	ND	90	250	440	1Q15	--	3Q21	4Q22
SG-12-04-58	Q ³	ND	92	100	140	ND	71 J	89	95	ND	160	99	310	ND	60	160	270	1Q15	--	2Q22	4Q22
SG-12-04-65	Q ³	ND	86	79	140	ND	65 J	60	92	ND	180	290	800	ND	100	250	510	1Q15	--	2Q24	2Q24
SG-12-06-10	Q ¹	ND	67 J	100	120	ND	77	44 J	120	ND	ND	ND	ND	ND	ND	ND	29	3Q15	--	--	--
SG-12-06-70	Q ²	95	140	180	170	ND	200	91	75	ND	ND	ND	ND	ND	ND	ND	27	1Q17	--	--	--
SG-12-07-65	Q	ND	62 J	85	170	ND	43 J	110	140	ND	ND	ND	ND	ND	ND	9	28	4Q22	3Q15	--	--
SG-12-17-60	Q	ND	ND	ND	ND	1 J	1.3 J	1.9	2.3	35 J	87	110	140	210	370	340	270	--	--	--	4Q15
SG-12-20-10	A	420	NS	NS	NS	350	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	NS	3Q22	3Q15	--	--
SG-12-20-20	A	120	NS	NS	NS	75 J	NS	NS	NS	ND	NS	NS	NS	ND	NS	NS	NS	3Q22	2Q15	--	--
SG-12-20-70	Q	80	72 J	89	120	92	47 J	65 J	93	ND	ND	ND	ND	ND	ND	ND	28	3Q15	2Q15	--	--

Notes:

*Preliminary results

-- = Never

A = Annual

J = estimated result below the limit of quantitation (LOQ)

INV = investigation (adjacent probe above SGCL/SG-SL)

ND = not detected above the limit of detection (LOD)

NS = not sampled

Q = Quarterly

R = Removed

Concentrations in **bold** exceed the SGCL

Concentrations in *italics* exceed the SG-SL

Results reported in micrograms per cubic meter (µg/m³)



¹ Quarterly probe due to proximity of store front in an area of historical soil gas concentrations above the SGCL.

² Will continue to sample probe quarterly if it is within the vicinity of the current groundwater plume above the ACL (probe adjacent to deepest probe will be sampled in lieu if deepest probe is in saturated zone).

³ Quarterly probe due to concentration above SGCL.



	SGCL (µg/m ³)	SG-SL (µg/m ³)
PCE	1,800	<i>603</i>
TCE	1,000	<i>888</i>

Ahtna

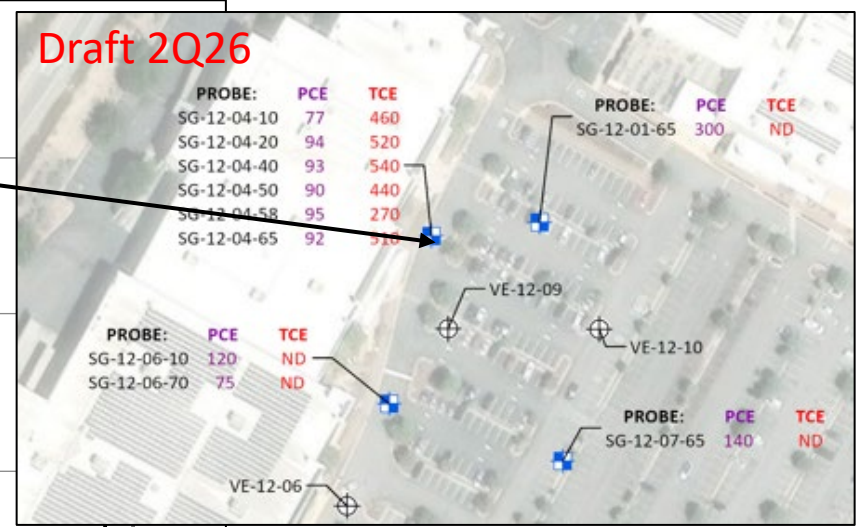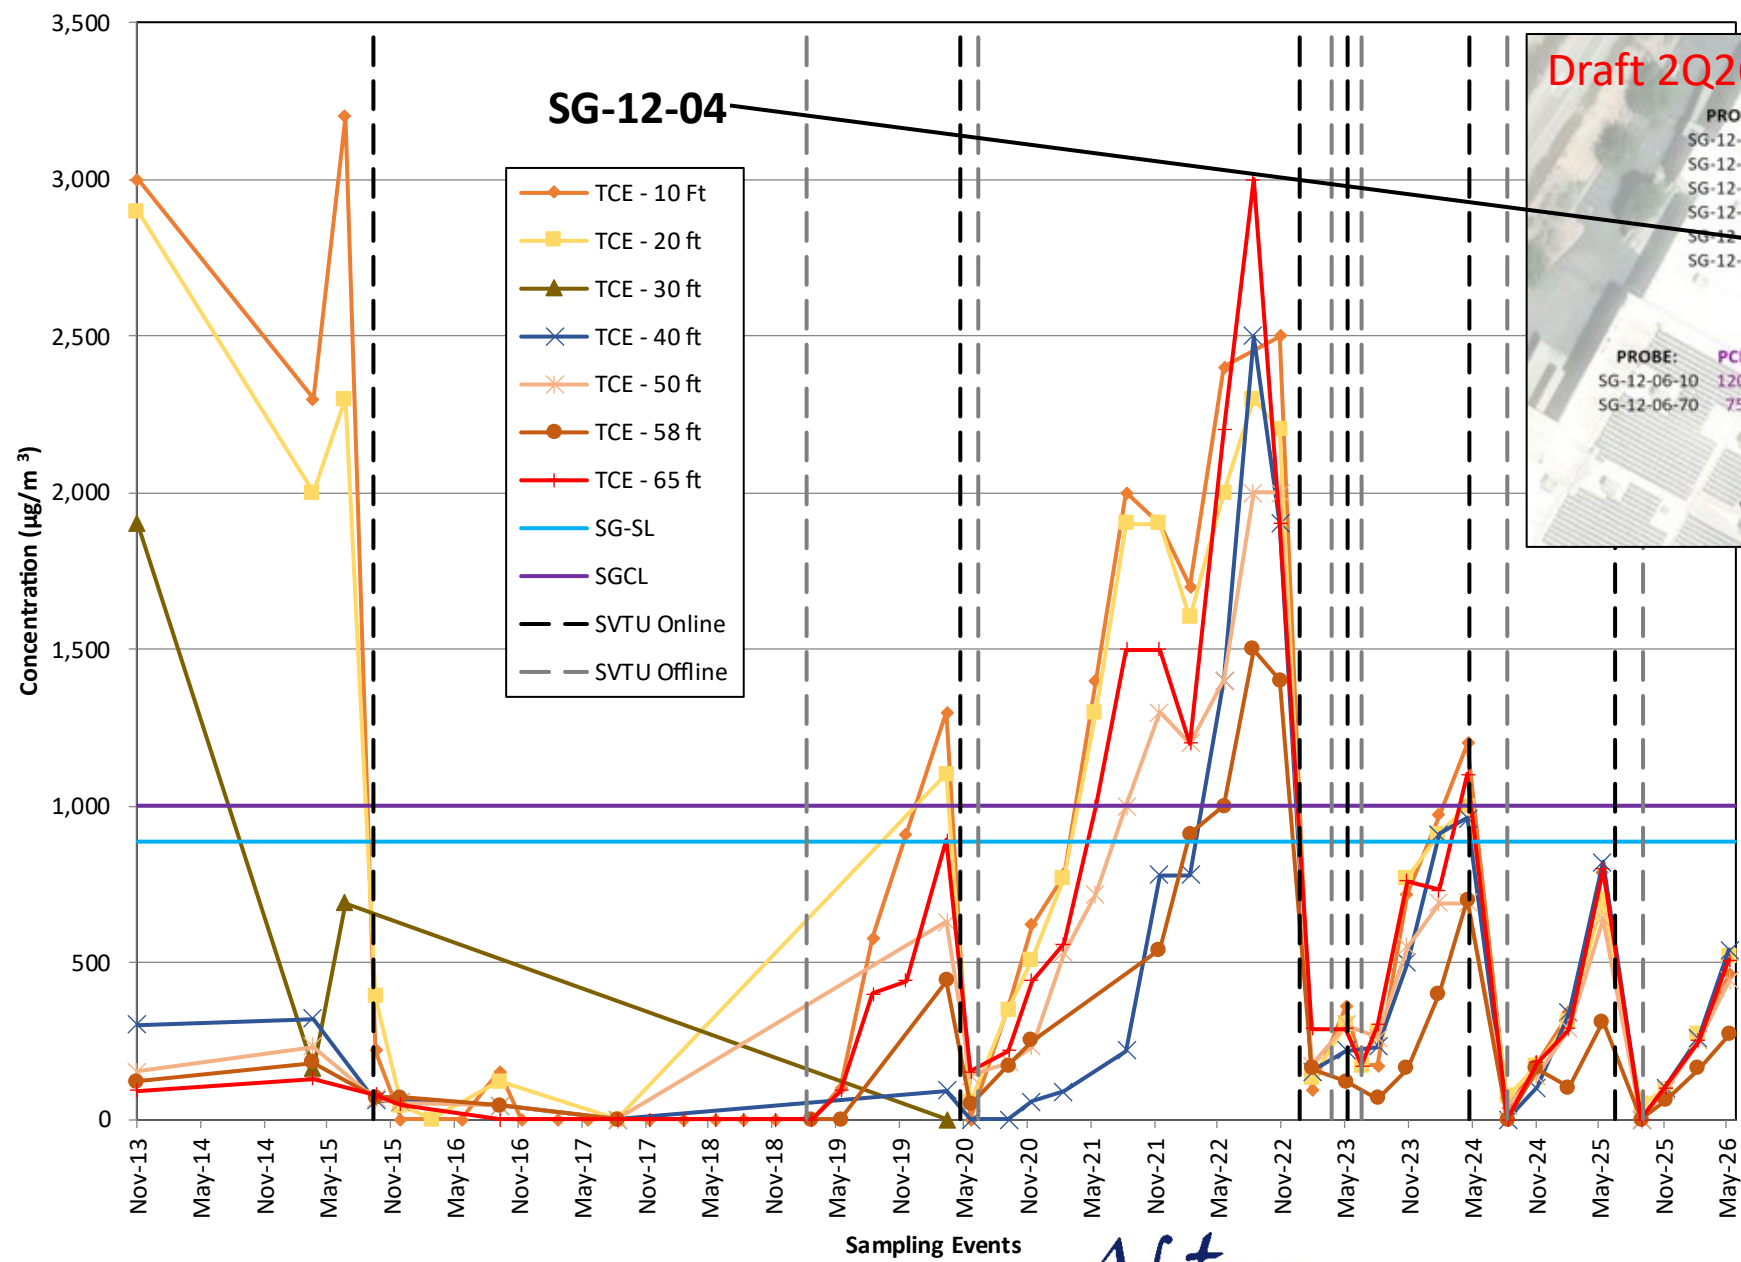


Ahtna

Draft 2Q26

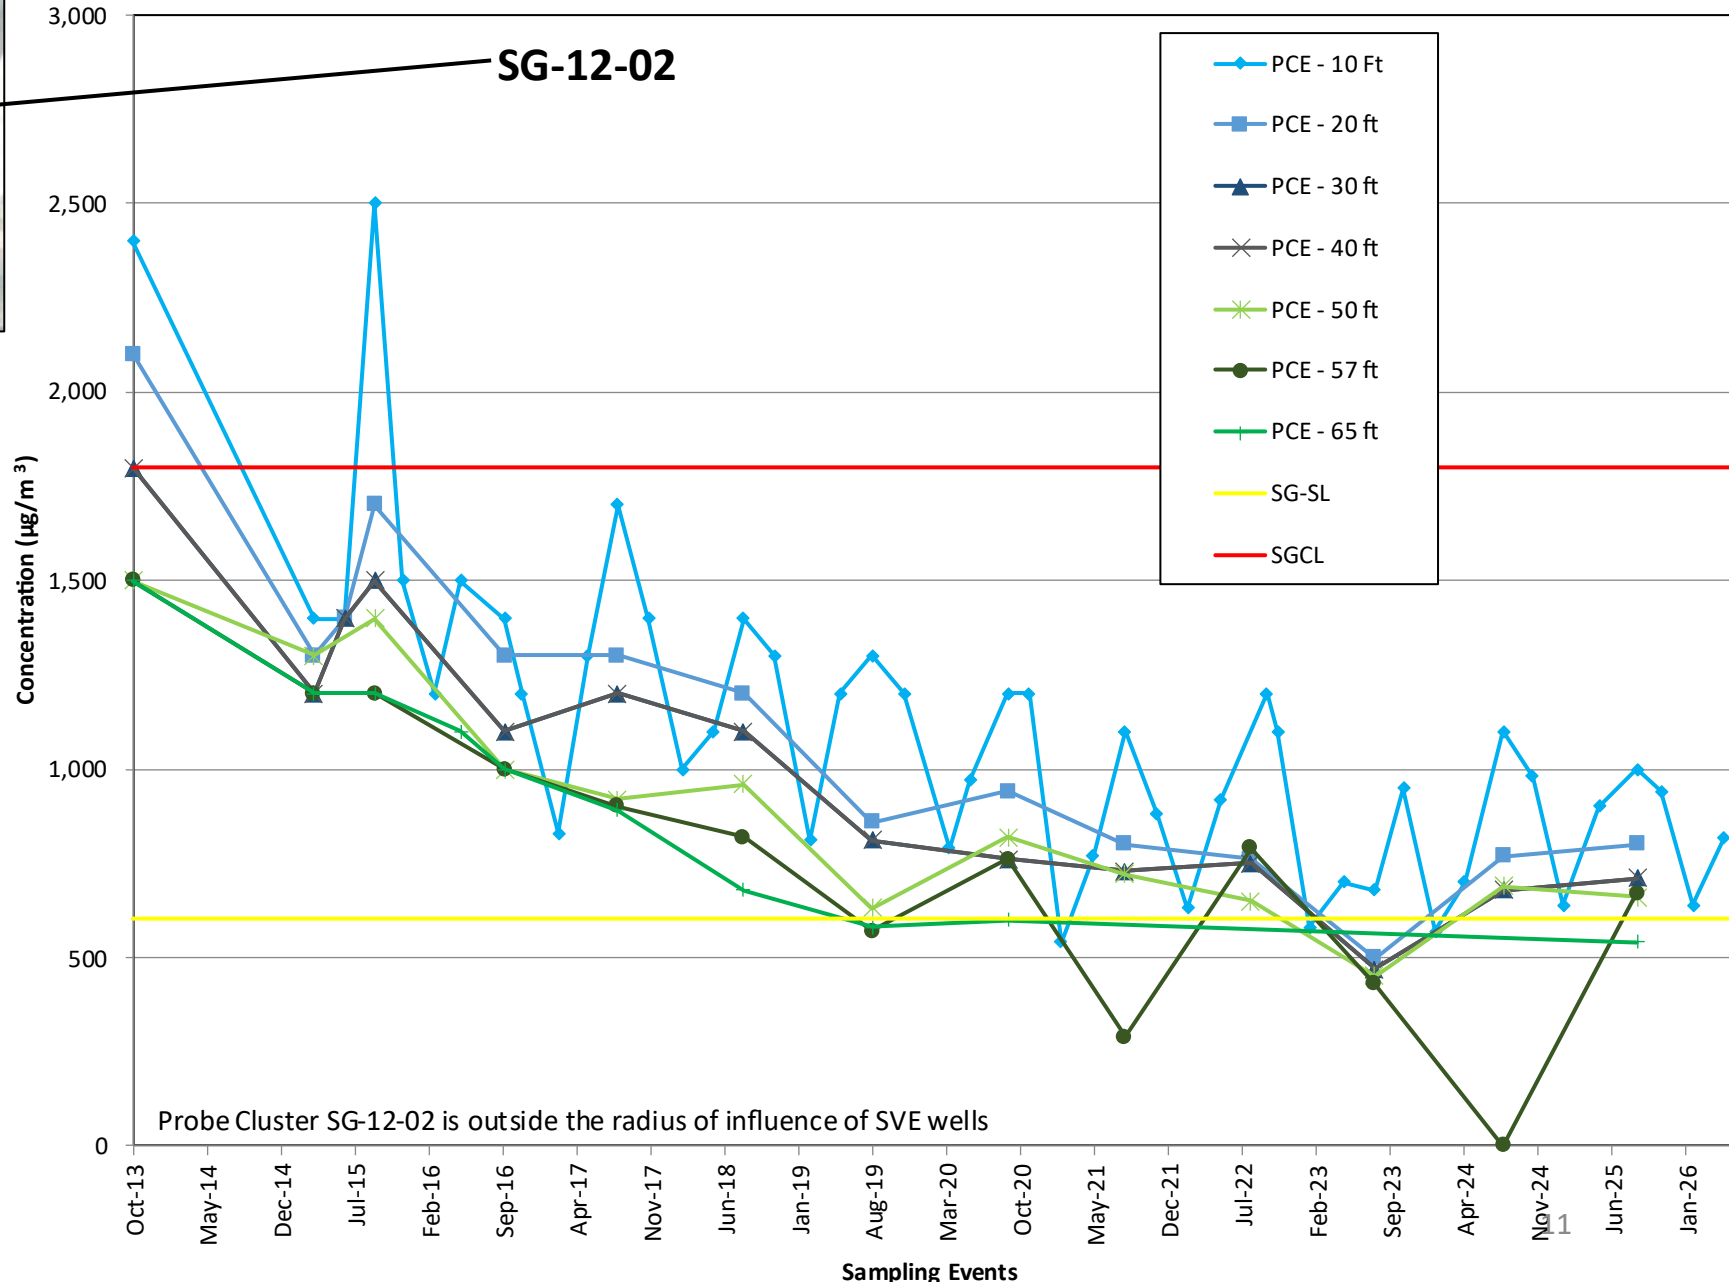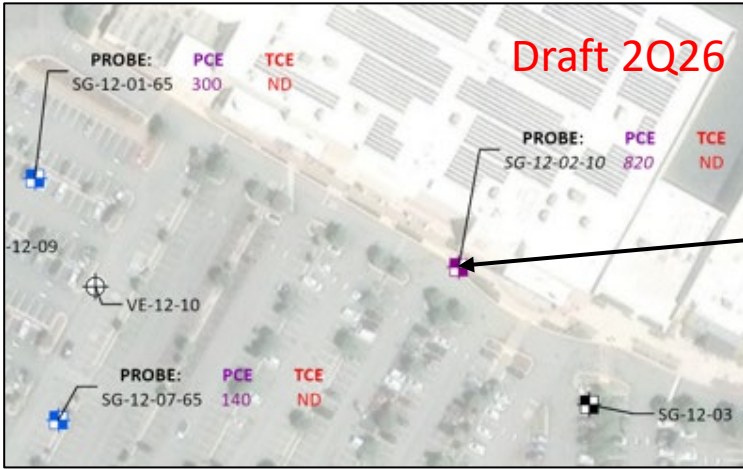

Ahtna

Draft 2Q26

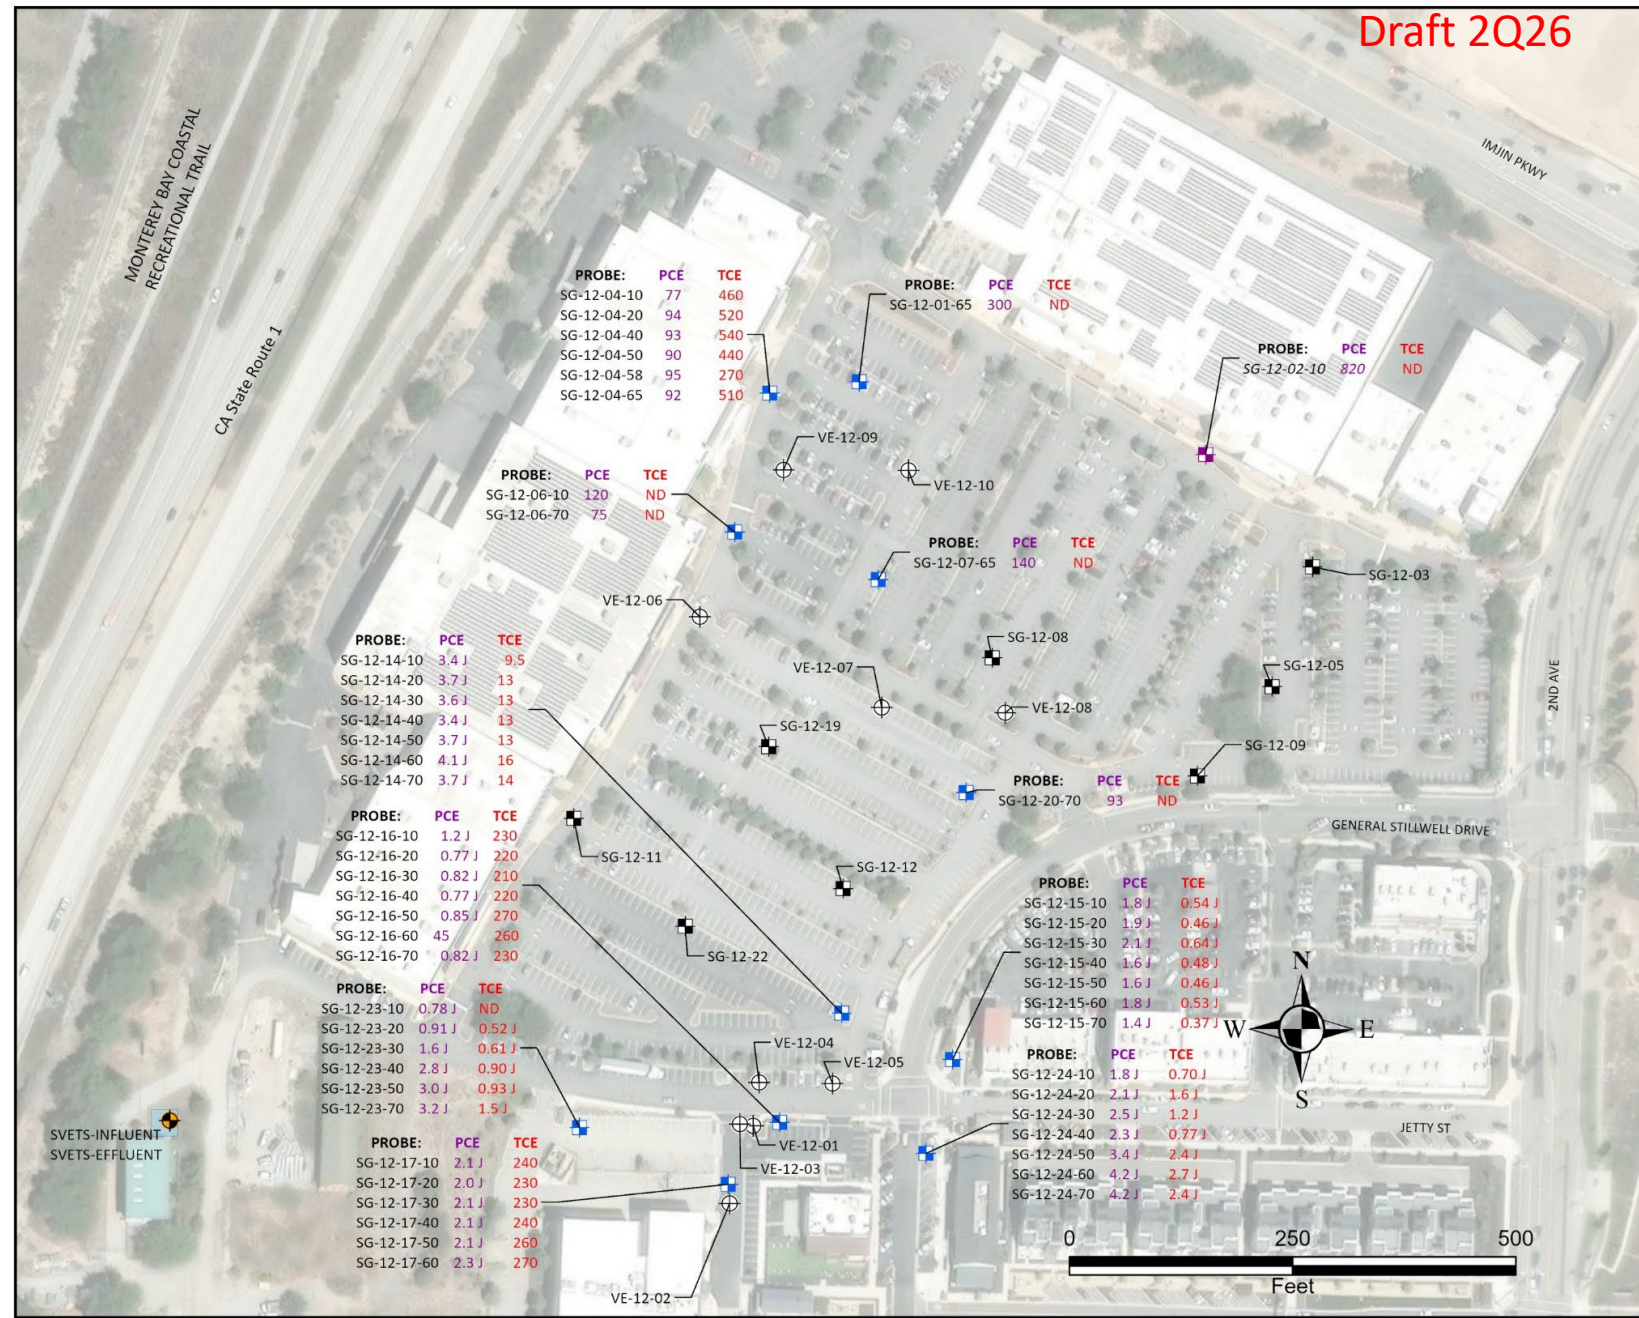

EXPLANATION

- SoilVaporTreatmentUnit
- Well Type and COC Concentration
 - Soil Gas Probe Cluster: Tetrachlorethane (PCE) is above the SG-SL but below the SGCL and trichloroethene (TCE) is below or equal to the SG-SL
 - Soil Gas Probe Cluster: PCE and TCE is below or equal to the SG-SL
 - Soil Gas Probe Cluster: Probes not sampled
 - Soil Vapor Extraction Well: Well not sampled
 - SVETS: Influent not sampled
 - SVETS: Effluent not sampled

ND Chemical of Concern (COC) is non-detect

Well ID - Sample Location and Probe Depth
TCE and PCE concentration (µg/L) with validation/lab qualifier.
Italics when exceeds the SG-SL
Bold when exceeds the SGCL.

NOTES:

- (1) Soil gas samples were collected between May 5, 2026 and May 13, 2025 while the SVETS was not in operation.
- (2) SGCL refers to Soil Gas Cleanup Level.
- (3) SG-SL refers to Soil Gas Screening Level.

SOIL GAS PCE/TCE CONCENTRATIONS
AND SGCL EXCEEDANCES
SECOND QUARTER 2026
Sites 2 and 12, Second Quarter 2026
Groundwater and Soil Gas Monitoring and Treatment
System Report, Former Fort Ord, California

Ahtna


Date: 7/5/2026

Figure: 14

Table 14. PRELIMINARY Second Quarter 2026 Data for Soil Gas
Probes in the Jetty Street Study Area

Probe Cluster	Depth (ft)	PCE (µg/m³)	TCE (µg/m³)
SG-12-14	10	3.4 J	9.5
	20	3.7 J	13
	30	3.6 J	13
	40	3.4 J	13
	50	3.7 J	13
	60	4.1 J	16
	70	3.7 J	14
SG-12-15	10	1.8 J	0.54 J
	20	1.9 J	0.46 J
	30	2.1 J	0.64 J
	40	1.6 J	0.48 J
	50	1.6 J	0.46 J
	60	1.8 J	0.53 J
	70	1.4 J	0.37 J
SG-12-16	10	1.2 J	230
	20	0.77 J	220
	30	0.82 J	210
	40	0.77 J	220
	50	0.85 J	270
	60	45	260
	70	0.82 J	230
Probe Cluster	Depth (ft)	PCE (µg/m³)	TCE (µg/m³)
SG-12-17	10	2.7 J	240
	20	2.0 J	230
	30	2.1 J	230
	40	2.1 J	240
	50	2.1 J	260
	60	2.3 J	270
	70*	--	--
SG-12-23	10	0.78 J	0.56 U
	20	0.91 J	0.52 J
	30	1.6 J	0.61 J
	40	2.8 J	0.90 J
	50	3.0 J	0.93 J
	60*	--	--
	70	3.2 J	1.5 J
SG-12-24	10	1.8 J	0.70 J
	20	2.1 J	1.6 J
	30	2.5 J	1.2 J
	40	2.3 J	0.77 J
	50	3.4 J	2.4 J
	60	4.2 J	2.7 J
	70	4.2 J	2.4 J

- SVETS is offline
- Soil Gas QAPP Addendum in progress

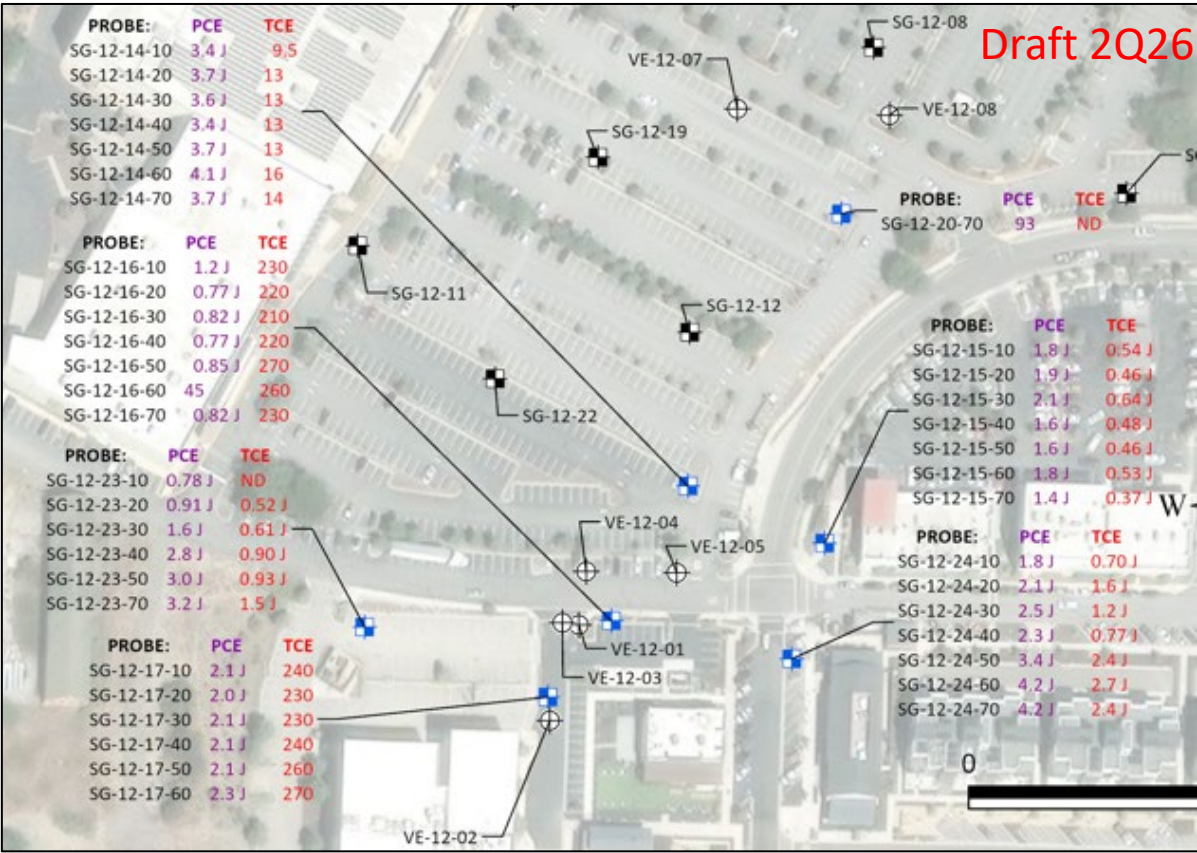

Jetty Street Study Area Soil Gas Sampling – TCE

- SVETS is offline
- Soil Gas QAPP Addendum in progress

Probe Cluster	TCE (µg/m³)						
	Depth (ft)	1Q25	2Q25	3Q25	4Q25	1Q26	2Q26
SG-12-14	10			1.4	5.8	7.8	9.5
	20			3.9	8.7	13	13
	30			3.7	9.1	13	13
	40			3.8	8.7	12	13
	50			5.4	9.1	13	13
	60			8.6	12	16	16
	70			5.1	9.7	14	14
SG-12-15	10	0.85	0.95	0.65	0.56	0.56	0.54
	20	0.69	0.85	0.62	1	1	0.46
	30	0.93	1.5	0.66	1	1	0.64
	40	0.89	0.87	0.57	0.34	0.34	0.48
	50			0.62	0.41	0.41	0.46
	60			0.62	0.5	0.5	0.53
	70			0.62	1.1	1.1	0.37
SG-12-16	10			310	220	220	230
	20			290	200	230	220
	30			300	190	190	210
	40			280	230	210	220
	50			200	220	210	270
	60			300	230	200	260
	70			310	220	190	230

Table 15. Data for Soil Gas Probes in the Jetty Street Area

Action	Commercial		Residential	
	TCE (µg/m³)	PCE (µg/m³)	TCE (µg/m³)	PCE (µg/m³)
No Action ¹	≤100	≤1570	≤16	≤360
Additional Probe Cluster Installation ¹	>100	>1570	>16	>360
Sub-Slab Soil Gas, Indoor Air, and Ambient Air Sampling	≥300 ²	N/A ⁴	≥69 ²	≥1395 ⁵
SVETS Operation	≥800 ³	≥1800 ⁶	≥200 ³	≥1800 ⁶

*Probe non-functional
Second Quarter 2026 Data is PRELIMINARY

Ahtna

Probe Cluster	TCE (µg/m³)						
	Depth (ft)	1Q25	2Q25	3Q25	4Q25	1Q26	2Q26
SG-12-17	10	87	110	120	290	330	240
	20	87	110	130	270	270	230
	30	78	110	95	290	290	230
	40			190	290	320	240
	50			200	340	300	260
	60	110	140	210	370	340	270
	70*						
SG-12-23	10			0.61	0.14	0.094	0.56
	20			0.6	0.5	0.47	0.52
	30			0.63	0.71	0.71	0.61
	40			0.78	1	1	0.9
	50			1.1	1	1	0.93
	60*						
	70			1.9	1.8	2	1.5
SG-12-24	10	0.92	0.93	0.61	0.7	0.75	0.7
	20	1.2	1.6	0.98	1.4	1.6	1.6
	30	0.79	1.1	1.3	0.95	1.2	1.2
	40	0.86	0.94	0.62	0.63	0.98	0.77
	50			2.2	1.9	2.5	2.4
	60			2.2	2.2	2.3	2.7
	70			2.3	1.9	2.1	2.4

