

**Table 1:** June 2026 and July 2026 Sites 2/12 GWTP and SVTU Statistics

| Monthly Statistics                | Volume Treated          | Temporal Average Flow | Percent of Time Online | COC Mass Removed (pounds) |
|-----------------------------------|-------------------------|-----------------------|------------------------|---------------------------|
| June 2026 GWTP                    | 1,467,840               | 34 gpm                | 73 %                   | 0.10                      |
| July 2026 GWTP                    | 4,692,600               | 105 gpm               | 85 %                   | 0.31                      |
| <i>Total since April 1999</i>     | <i>2.4 billion gal</i>  |                       |                        | <i>501.3</i>              |
| June 2026 SVTU                    | 0                       | 0 scfm                | 0 %                    | 0                         |
| July 2026 SVTU                    | 10,761,216              | 701 scfm              | 36 %                   | 0.03                      |
| <i>Total since September 2015</i> | <i>1.69 billion scf</i> |                       |                        | <i>11.7</i>               |

**Notes:**

gpm: gallon(s) per minute

gal: gallon(s)

COC: chemical of concern

NC: Not calculated

scf: standard cubic foot or feet

scfm: standard cubic feet per minute

## Remedial Summary

- **8 COCs:** 1,1-DCE; 1,2-DCA; chloroform; cis-1,2-DCE; PCE; total 1,3-DCP; TCE; and VC.
- **Remediation:** Pump and treat with GAC in the unconfined Upper 180-Foot Aquifer since 1999. Extraction wells added in 2007 and 2015.
- **Monitoring:** Quarterly groundwater monitoring and reporting, including annual 3Q monitoring and reports. Described in the most recent Groundwater QAPP.

## Recent Key Events

- June 29: EW-12-05-180M brought back online after pump replacement
- July 21: SVETS online
- July 28: Treated water pipeline at INF-02-03-180 repaired
- Aug 17 – Aug 31: Third Quarter (Annual) SGMP event
- Aug 20: SVETS offline
- Aug 31 – Sep 3: Third Quarter (Annual) GWMP event
- Sep 4: Installation of MW-12-33-180U

## Future Key Events

- Sep 10: Well development MW-12-33-180U
- Nov 2-13: Fourth Quarter SGMP event
- Nov 16-20: Fourth Quarter GWMP event

June – July 2026 Sites 2/12 Treated Water at TS-212-INJ did not exceed discharge limits.

**Table 2.** Sites 2/12 Groundwater Extraction/Monitoring Well PCE Data

| Well Identification <sup>1</sup> | PCE Concentrations (µg/L) <sup>2</sup>                                                                                                                                |                                                                                                                            |                                                                                                    |                                                                                                   |                                                                                                                                                          |                                                                                            |                                                                                     |                                                                                                     |                                        |
|----------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------|----------------------------------------|
|                                  | 3Q2024                                                                                                                                                                | 4Q2024                                                                                                                     | 1Q2025                                                                                             | 2Q2025                                                                                            | 3Q2025                                                                                                                                                   | 4Q2025                                                                                     | 1Q2026                                                                              | 2Q2026                                                                                              | 3Q2026*                                |
| <b>ACL:</b>                      | <b>5.0</b>                                                                                                                                                            |                                                                                                                            |                                                                                                    |                                                                                                   |                                                                                                                                                          |                                                                                            |                                                                                     |                                                                                                     |                                        |
| EW-12-03-180M                    | ND (0.25)                                                                                                                                                             | NS                                                                                                                         | NS                                                                                                 | NS                                                                                                | ND (0.25)                                                                                                                                                | NS                                                                                         | NS                                                                                  | NS                                                                                                  |                                        |
| EW-12-05-180M                    | NS                                                                                                                                                                    | NS                                                                                                                         | NS                                                                                                 | ND (0.25)                                                                                         | ND (0.25)                                                                                                                                                | 0.80                                                                                       | NS                                                                                  | NS                                                                                                  |                                        |
| EW-12-07-180M                    | ND (0.25)                                                                                                                                                             | ND (0.25)                                                                                                                  | NS                                                                                                 | NS                                                                                                | NS                                                                                                                                                       | NS                                                                                         | ND‡<br>ND‡<br>ND‡<br>ND                                                             | ND (0.25)                                                                                           |                                        |
| EW-12-08-180U                    | <b>11.8</b><br><b>14.5</b><br><b>11.9</b><br><b>5.9</b> <sup>3</sup><br><b>16.1</b><br><b>8.8</b> <sup>3</sup><br><b>19.3</b><br><b>9.1</b> <sup>4</sup><br>ND (0.25) | <b>7.5</b> <sup>5</sup><br><b>16.1</b><br><b>10.4 J</b> <sup>4</sup><br><b>1.0</b> <sup>6</sup><br><b>1.1</b> <sup>7</sup> | ND (0.25) <sup>5</sup><br>ND (0.25) <sup>9</sup><br>3.4<br>2.5 <sup>5</sup><br>0.48 J <sup>7</sup> | 3.2 <sup>5</sup><br><b>7.8</b><br>3.2 <sup>5</sup><br>ND (0.25)<br>3.1 <sup>5</sup><br><b>7.8</b> | 3.8 <sup>5</sup><br><b>8.1</b><br>ND (0.25) <sup>4</sup><br>ND (0.25)<br><b>5.4</b> <sup>5</sup><br><b>7.7</b><br><b>5.3</b> <sup>5</sup><br><b>13.7</b> | ND (0.25) <sup>6</sup><br><b>6.1</b><br>3.6 <sup>6</sup><br><b>8.7</b><br>2.9 <sup>5</sup> | ND (0.25)<br>ND (0.25) <sup>6</sup><br><b>5.4</b><br>3.0 <sup>6</sup><br><b>8.2</b> | 2.5 <sup>6</sup><br><b>6.5</b><br>4.0 <sup>6</sup><br><b>7.9</b><br>4.6 <sup>6</sup><br><b>12.1</b> | <b>6.1</b> <sup>6</sup><br><b>19.4</b> |
| MW-12-09R-180                    | 0.15 J                                                                                                                                                                | ND (0.25)                                                                                                                  | ND (0.25)                                                                                          | ND (0.25)                                                                                         | 0.13 J                                                                                                                                                   | 0.16 J                                                                                     | 0.11 J                                                                              | 0.11 J                                                                                              |                                        |
| MW-12-14-180M                    | 0.37 J                                                                                                                                                                | ND (0.25)                                                                                                                  | 0.70                                                                                               | 0.56                                                                                              | 0.11 J                                                                                                                                                   | 0.18 J                                                                                     | 0.24 J                                                                              | 0.30 J                                                                                              |                                        |
| MW-12-16-180M                    | ND (0.25)                                                                                                                                                             | ND (0.25)                                                                                                                  | ND (0.25)                                                                                          | ND (0.25)                                                                                         | ND (0.25)                                                                                                                                                | ND (0.25)                                                                                  | ND (0.25)                                                                           | ND (0.25)                                                                                           |                                        |
| MW-12-20-180U                    | <b>39.8</b>                                                                                                                                                           | 4.8<br>ND (0.25)                                                                                                           | 0.55                                                                                               | 0.72                                                                                              | 0.8                                                                                                                                                      | 0.49 J                                                                                     | 0.36 J                                                                              | 2.7                                                                                                 |                                        |
| MW-12-21-180U                    | 0.27 J                                                                                                                                                                | ND (0.25)                                                                                                                  | ND (0.25)                                                                                          | ND (0.25)                                                                                         | 0.25 J                                                                                                                                                   | 0.27 J                                                                                     | 0.21 J                                                                              | 0.25 J                                                                                              |                                        |
| MW-12-24-180U                    | <b>32.1</b>                                                                                                                                                           | ND (0.25)                                                                                                                  | 2.4                                                                                                | 1.9                                                                                               | 3.4                                                                                                                                                      | 0.33 J                                                                                     | 0.52                                                                                | 4.6                                                                                                 |                                        |
| MW-12-28-180U                    | 0.39 J                                                                                                                                                                | NS                                                                                                                         | NS                                                                                                 | NS                                                                                                | 0.37 J                                                                                                                                                   | NS                                                                                         | NS                                                                                  | NS                                                                                                  |                                        |
| MW-12-30-180U                    | 0.36 J                                                                                                                                                                | NS                                                                                                                         | NS                                                                                                 | NS                                                                                                | 0.31 J                                                                                                                                                   | NS                                                                                         | NS                                                                                  | NS                                                                                                  |                                        |
| MW-12-32-180U                    | 0.49 J                                                                                                                                                                | NS                                                                                                                         | NS                                                                                                 | NS                                                                                                | ND (0.25)                                                                                                                                                | NS                                                                                         | NS                                                                                  | NS                                                                                                  |                                        |

**Notes:**

<sup>1</sup> Extraction wells not listed have met the QAPP decision rules to no longer operate.

<sup>2</sup> Concentration in **bold** and shaded exceeds the Aquifer Cleanup Level (ACL). Concentrations in gray text are ND.

<sup>3</sup> Sample was collected following one week online

<sup>4</sup> Sample was collected following two weeks online

<sup>5</sup> Sample was collected following three weeks online

<sup>6</sup> Sample was collected following four weeks online

<sup>7</sup> Sample was collected following two weeks offline

<sup>8</sup> Sample was collected following eight weeks offline

<sup>9</sup> Sample was collected following six weeks online

J: Estimated results below the limit of quantitation (LOQ)

ND: The analyte was not detected at or above the limit of detection (LOD)

NS: No sample (annual well)

COC: chemical of concern

µg/L: micrograms per liter

\* Preliminary results


‡ Profile of Stations 1-3

Ahtna



**EW-12-08-180U**  
(pulse pumping)

Pulse pumping schedule modified from four weeks on/one week off to six weeks on/one week off

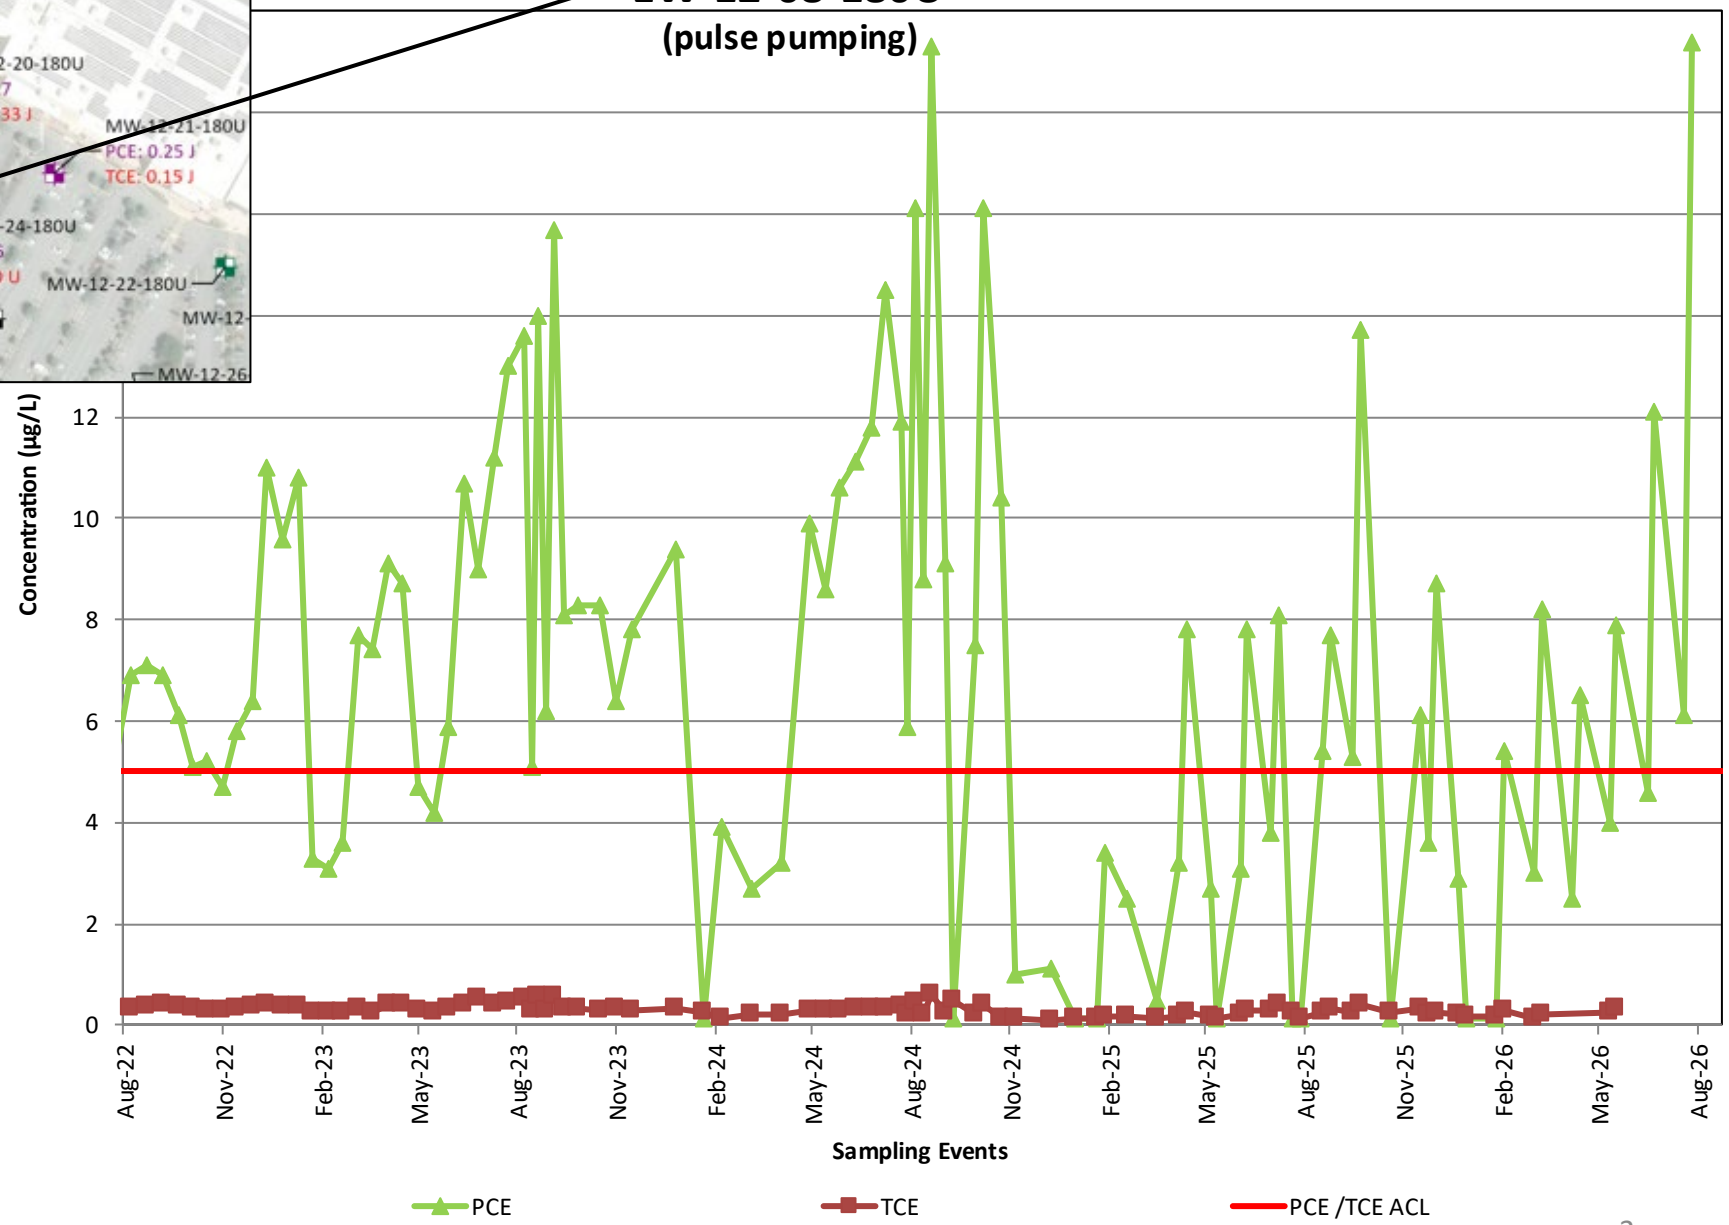

## SVETS Operation Summary

- Rebound trends at SG-12-04 indicate TCE concentrations were projected to exceed 800 µg/m<sup>3</sup> in 3Q2026
- SVETS restarted on July 21, 2026
- SVETS shut down September 20, 2026, to assess rebound following 3Q2026 monitoring event

**Table 3.** Sites 2/12 SVETS PCE and TCE Monitoring Results

| SVETS ID | PCE  |      |      |      |      |      |      |      | TCE  |      |      |      |      |      |      |       |
|----------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|-------|
|          | 4Q24 | 1Q25 | 2Q25 | 3Q25 | 4Q25 | 1Q26 | 2Q26 | 3Q26 | 4Q24 | 1Q25 | 2Q25 | 3Q25 | 4Q25 | 1Q26 | 2Q26 | 3Q26  |
| VE-12-02 | NS   | NS   | NS   | NS   | NS   | NS   | NS   | NS   | NS   | NS   | NS   | NS   | NS   | NS   | NS   | NS    |
| VE-12-06 | NS   | NS   | 84   | ND   | NS   | NS   | NS   | 41 J | NS   | NS   | ND   | ND   | NS   | NS   | NS   | ND    |
| VE-12-07 | NS   | NS   | 69 J | ND   | NS   | NS   | NS   | ND   | NS   | NS   | ND   | ND   | NS   | NS   | NS   | ND    |
| VE-12-08 | NS   | NS   | 85   | ND   | NS   | NS   | NS   | 78   | NS   | NS   | ND   | ND   | NS   | NS   | NS   | ND    |
| VE-12-09 | NS   | NS   | 140  | 56 J | NS   | NS   | NS   | 110  | NS   | NS   | ND   | ND   | NS   | NS   | NS   | ND    |
| SVTU-INF | NS   | NS   | 75   | 44   | NS   | NS   | NS   | 44   | NS   | NS   | 4.7  | 6.4  | NS   | NS   | NS   | 3.5 J |
| SVTU-EFF | NS   | NS   | 11   | 24   | NS   | NS   | NS   | 10   | NS   | NS   | 5.5  | 6.9  | NS   | NS   | NS   | 10    |

**Notes:**

\*Preliminary results

J = estimated result below the limit of quantitation (LOQ)

ND = not detected above the limit of detection (LOD)


NS = not sampled

Concentrations in **bold** exceed the SGCL

Concentrations in *italics* exceed the SG-SL

Results reported in micrograms per cubic meter (µg/m<sup>3</sup>)

| COC | SGCL<br>(µg/m <sup>3</sup> ) | SG-SL<br>(µg/m <sup>3</sup> ) |
|-----|------------------------------|-------------------------------|
| PCE | <b>1,800</b>                 | <i>603</i>                    |
| TCE | <b>1,000</b>                 | <i>888</i>                    |

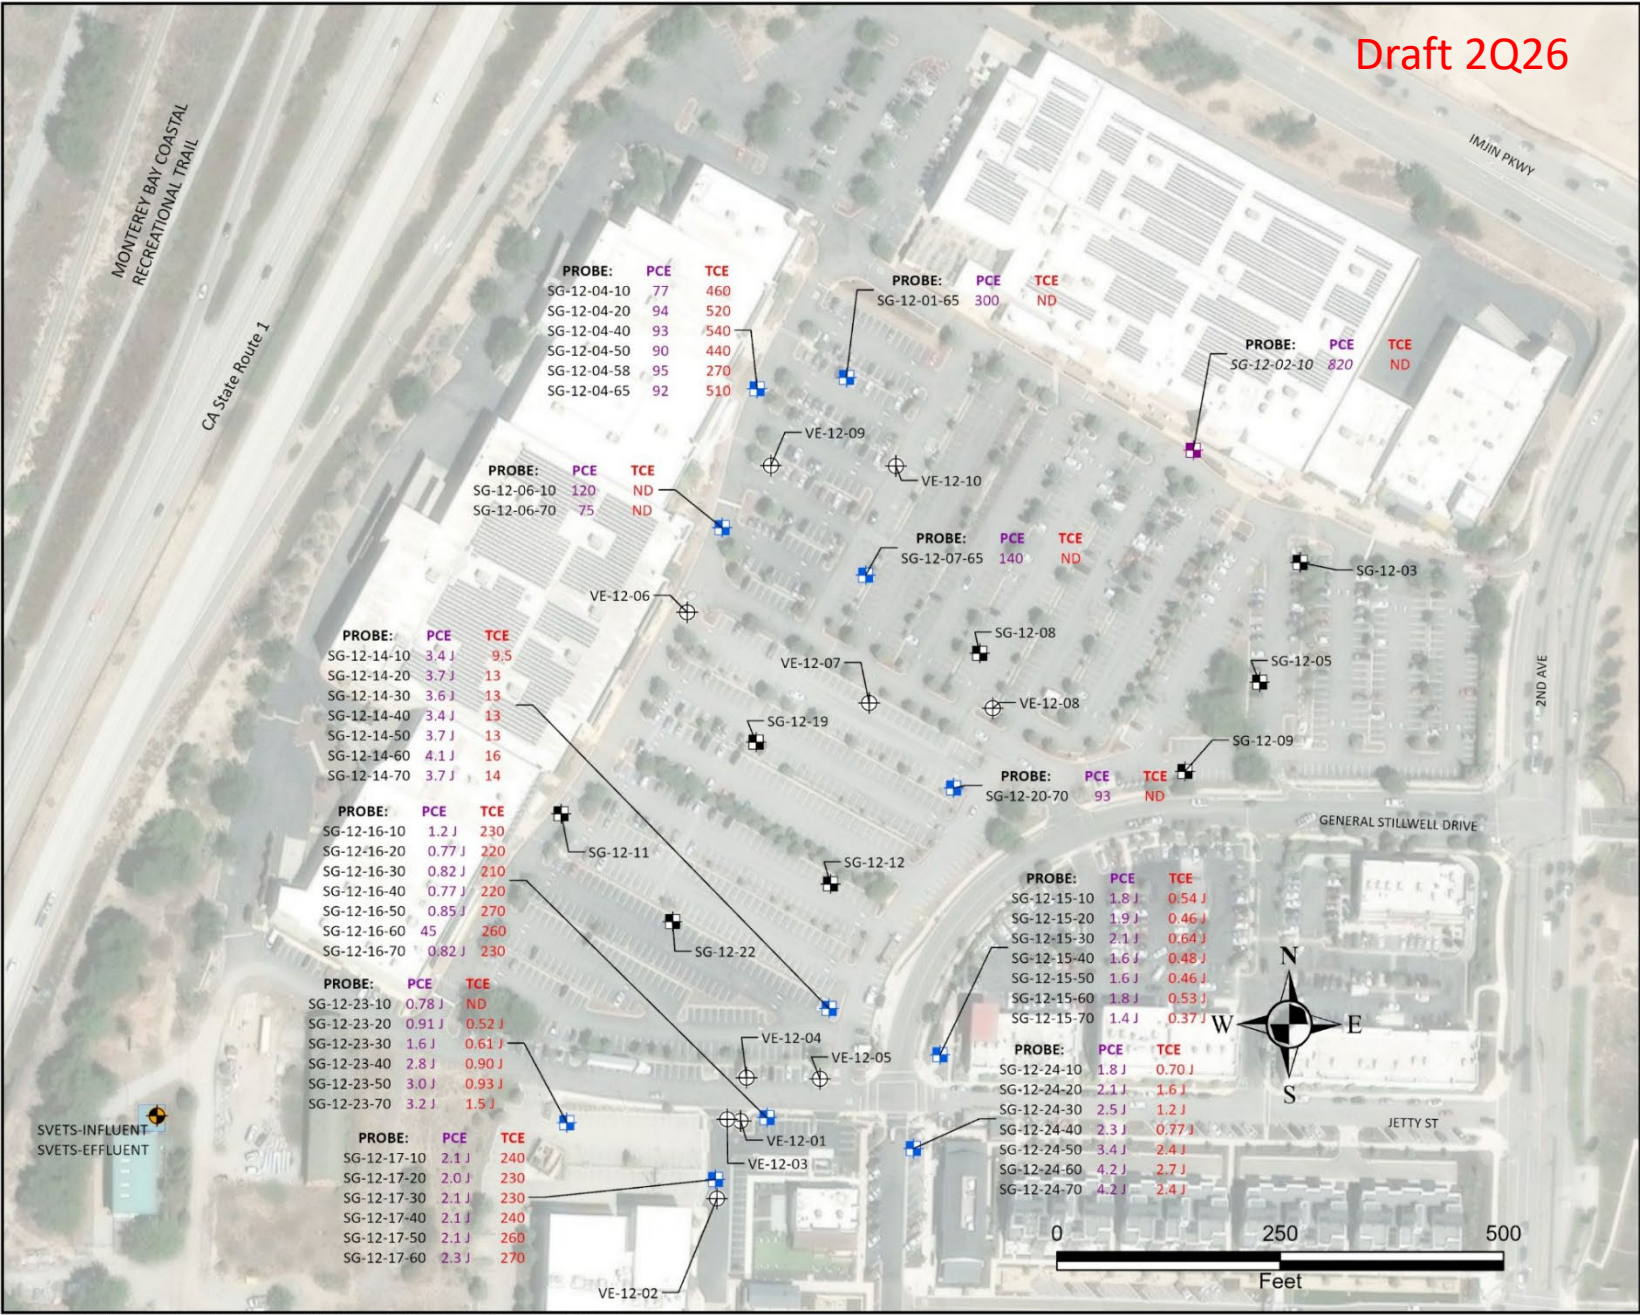

Service Layer Credits: Service Layer Credits: Source: Esri, Maxar, Earthstar Geographics, and the GIS User Community  
Imagery Date: March 9, 2025

**EXPLANATION**

SoilVaporTreatmentUnit

**Well Type and COC Concentration**

- Soil Gas Probe Cluster: Tetrachlorethane (PCE) is above the SG-SL but below the SGCL and trichloroethene (TCE) is below or equal to the SG-SL
- Soil Gas Probe Cluster: PCE and TCE is below or equal to the SG-SL
- Soil Gas Probe Cluster: Probes not sampled
- Soil Vapor Extraction Well: Well not sampled
- SVETS: Influent not sampled
- SVETS: Effluent not sampled

ND Chemical of Concern (COC) is non-detect

Well ID - Sample Location and Probe Depth  
TCE and PCE concentration (µg/L) with validation/lab qualifier.  
Italics when exceeds the SG-SL  
Bold when exceeds the SGCL.

**Probe PCE TCE**  
SG-12-04-10 77 460

- NOTES:**
- (1) Soil gas samples were collected between May 5, 2026 and May 13, 2025 while the SVETS was not in operation.
  - (2) SGCL refers to Soil Gas Cleanup Level.
  - (3) SG-SL refers to Soil Gas Screening Level.

SOIL GAS PCE/TCE CONCENTRATIONS  
AND SGCL EXCEEDANCES  
SECOND QUARTER 2026  
Sites 2 and 12, Second Quarter 2026  
Groundwater and Soil Gas Monitoring and Treatment  
System Report, Former Fort Ord, California